# REPUBLIC OF KENYA



# MINISTRY OF WATER & SANITATION AND IRRIGATION



# NORTHERN WATER WORKS DEVELOPMENT AGENCY

TENDER DOCUMENT FOR CONSTRUCTION OF IJARA WATER SUPPLY PROJECT:~

# PROPOSED CONSTRUCTION OF MASALANI~GABABA PIPELINE EXTENSION & ANCILLARY WORKS

TENDER NO. NWWDA/CW/T/004/2022~2023

# PROCURING ENTITY

NORTHERN WATER WORKS DEVELOPMENT AGENCY
Maji House, Kismayu Road
PO Box 495 – 70100 Garissa, Kenya
Tel: +254~46~2103598/3797

E-mail: info@nwwda.go.ke

ISSUE DATE: 29th December, 2022

# TABLE OF CONTENTS

INV	VITATION TO TENDER	V
API	PENDIX TO THE PREFACE	vii
GU	IDELINES FOR PREPARATION OF TENDER DOCUMENTS	vii
2.	PART 1 - TENDERING PROCEDURES	vii
3.	PART 2 - PROCUREMENT ENTITY'S REQUIREMENTS	
4.	PART 3 - CONDITIONS OF CONTRACT AND CONTRACT FORMS	
TNIX	/ITATION TO TENDER	v
S <u>EC</u>	CTION I - INSTRUCTIONS TO TENDERERS	<u>1</u>
A.	General Provisions	
1.	Scope of Tender	
2.	Fraud and Corruption	
3.	Eligible Tenderers	
4.	Eligible Goods, Equipment, and Services	
5.	Tenderer's Responsibilities	3
B.	Contents of Tender Documents	
6.	Sections of Tender Document	
7.	Site visit	
8.	Pre-Tender Meeting	
9.	Clarification and amendment of Tender Documents	
10.	Amendment of Tender Documents	5
C.	Preparation of Tenders	
11.	Cost of Tendering.	
12.	Language of Tender	
13.	Documents Comprising the Tender	5
14.	Form of Tender and Schedules	
15.	Alternative Tenders	
16.	Tender Prices and Discounts	
17.	Currencies of Tender and Payment	
18.	Documents Comprising the Technical Proposal	/
19. 20.	Documents Establishing the Eligibility and Qualifications of the Tenderer Period of Validity of Tenders	0
20.	Tender Security	
22.	Format and Signing of Tender	
D	Sealing and Marking of Tenders	0
	Sealing and Marking of Tenders	
23. 24.	Deadline for Submission of Tenders	
2 <del>4</del> . 25.	Late Tenders	
26.	Withdrawal, Substitution, and Modification of Tenders	
20. 27.	Tender Opening	
<b>E.</b> 28.	Evaluation and Comparison of Tenders  Confidentiality	
20. 29.	Clarification of Tenders	
<i>29.</i> 30.	Deviations, Reservations, and Omissions	
31.	Determination of Responsiveness	
32.	Non-material Non-conformities	
33.	Arithmetical Errors	
34.	Conversion to Single Currency	
35.	Margin of Preference and Reservations	
	<u> </u>	

37.	Evaluation of Tenders	13
38.	Comparison of Tenders	14
39.	Abnormally Low Tenders	14
40.	Abnormally High Tenders	
41.	Unbalanced and/or Front-Loaded Tenders	14
42.	Qualifications of the Tenderer	
43.	Best Evaluated Tender	
44.	Procuring Entity's Right to Accept Any Tender, and to Reject Any or All Tenders	15
F.	Award of Contract	15
45.	Award Criteria	
46.	Notice of Intention to enter into a Contract	15
47.	Standstill Period	16
48.	Debriefing by the Procuring Entity	16
49.	Letter of Award	16
50.	Signing of Contract	16
51.	Appointment of Adjudicator	16
52.	Performance Security.	
53.	Publication of Procurement Contract.	
53.	Procurement Related Complaints	17
SEC	TION II-TENDER DATA SHEET(TDS)	18
SEC	TION III - EVALUATION AND QUALIFY ON CRITERIA	23
1.	General Provisions	
2.	Preliminary examination for Determination of Responsiveness	
3.	Tender Evaluation (ITT 35)	
4.	Multiple Contracts	
5.	Alternative Tenders (ITT 13.1)	
6.	Margin of Preference is not applicable	24
7.	Post qualification and Contract award (ITT 39), more specifically	24
SEC	TION IV – TENDERING FORMS	25
QUA	ALIFICATION FORMS	28
	1. Form Equ. Equipment	28
	2. Form per-1	
	•	
	4. FORM PER-2:	30
5.	TENDERERS QUALIFICATION WITHOUT PRE-QUALIFICATION	32
	FORM ELI -1.1	
	FORM ELI -1.2	
	FORM CON – 2	
5.4	FORM FIN – 3.1:	
5.5	FORM FIN – 3.2:	37
5.6	FORM FIN – 3.3:	38
5.7	FORM FIN – 3.4:	38
5.8	FORM EXP - 4.1	39
5.9	FORM EXP - 4.2(a)	40
5.11	FORM EXP - 4.2(b)	41
ОТН	IER FORMS	42
6.	FORM OF TENDER	42
	a) TENDERER'S ELIGIBILITY- CONFIDENTIAL BUSINESS QUESTIONNAIRE	15
	a) TENDERER'S ELIGIBILITY- CONFIDENTIAL BUSINESS QUESTIONNAIREb) CERTIFICATE OF INDEPENDENT TENDER DETERMINATION	
	o, certificate of independent lender delicities with the commission of the commissio	, <del>T</del> O

	c) SELF-DECLARA	ΓΙΟΝ FORM - SELF DECLARATION OF THE TENDERER	49
		AUD AND CORRUPTION	
	,		
7.	FORM OF TENDER SE	CURITY - DEMAND BANK GUARANTEE	54
8.		CURITY (INSURANCE GUARANTEE)	
9.	FORM OF TENDER-SE	CURING DECLARATION	56
10.		R	
PART	'II - WORK REQUIRE	MENTS	58
CECT			70
		NVG	
		NS	
SECI		ANTITIES	
		<u> </u>	
		y:	
	4. The Bills of Quanti	ties	39
PART	III-CONDITIONS OF	CONTRACT AND CONTRACT FORMS	60
SECT	ION VIII - GENERAL C	ONDITIONS OF CONTRACT	60
	A. General		
			61
		Decisions	
		500151011B	
		pment	
	10. Procuring Entity's a	and Contractor's Risks	63
		Risks	
		truct the Works	
		ompleted by the Intended Completion Date	
		oject Manager	
	11 2		
	•		
		ite	
	21. Access to the Site		65
		ctions and Audits	
	· •	Adjudicator	
		ns and Disputes	
		on	
	•		
B. Ti	me Control		68
	C	tended Completion Date	
		т	
		the Project Manager	
		ngs	
	6 Farly Warning		70

C.	Quality Control	69
1.	Identifying Defects	
2.	Tests	
3.	Correction of Defects	69
4.	Uncorrected Defects	
D.	Cost Control	70
1.	Contract Price	
2.	Changes in the Contract Price.	
3.	Variations	
4.	Cash Flow Forecasts.	
5.	Payment Certificates	
6.	Payments	
7.	Compensation Events	
8.	Tax	
9.	Currency y of Payment	
10.	Price Adjustment	
11.	Retention	
12.	Liquidated Damages.	
13.	Bonus	
14.	Advance Payment	
15.	Securities	
16.	Day works	
17.	Cost of Repairs	
17.	Cost of Repairs	, 13
E.	Finishing the Contract	75
1.	Completion	
2.	Taking Over	75
3.	Final Account	75
4.	Operating and Maintenance Manuals	75
5.	Termination	
6.	Payment upon Termination	76
7.	Property	
8.	Release from Performance	
SEC	TION IX - SPECIAL CONDITIONS OF CONTRACT	77
	TION X - CONTRACT FORMS	
<b>FOR</b>	M No. 1 - NOTIFICATION OF INTENTION TO AWARD	80
	M No. 2 – REQUEST FOR REVIEW	
<b>FOR</b>	M No. 3 - LETTER OF AWARD	83
	M No. 4 - CONTRACT AGREEMENT	
	M No. 5 - PERFORMANCE SECURITY [Option 1 - Unconditional Demand Bank Guarantee]	
FOR	M No. 6- PERFORMANCE SECURITY [Option 2– Performance Bond]	86
FOR	M No. 7- ADVANCE PAYMENT SECURITY	88
	M No. 8- RETENTION MONEY SECURITY	
	M No. 9- BENEFICIAL OWNERSHIP DISCLOSURE FORM	

#### **INVITATION TO TENDER**

# Open National Tender for Construction of :IJARA WATER SUPPLY PROJECT:PROPOSED CONSTRUCTION OF MASALANI-GABABA PIPELINE EXTENSION & ANCILLARY WORKS PROJECT

- 1. The Northern Water Works Development Agency invites sealed tenders for the Construction of IJARA WATER SUPPLY PROJECT:-PROPOSED CONSTRUCTION OF MASALANI-GABABA PIPELINE EXTENSION & ANCILLARY WORKS
- 2. Tendering will be conducted under open competitive tendering method using a standardized tender document and is open to all qualified and interested **Tenderers**.
- 3. Qualified and interested tenderers may obtain further information and inspect the Tender Documents during office hours **0900 to 1700 hours** at the address given below. Tender documents may be viewed and/or downloaded from the website www.nwwda.go.ke or www.tender.go.ke free of charge
- 4. Alternatively, a complete set of tender documents may be purchased or obtained by interested tenders upon payment of a non- refundable fees of Kshs 1,000.00 in cash or Banker's Cheque and payable to the address given below. Tender documents obtained electronically will be free of charge.
- 5. Tender documents may be viewed and downloaded for free from the website <a href="www.nwwda.go.ke">www.nwwda.go.ke</a> . Tenderers who download the tender document must forward their particulars immediately to <a href="mailto:info@nwwda.go.ke">info@nwwda.go.ke</a> to facilitate any further clarification or addendum.
- 6. Tenders shall be quoted be in Kenya Shillings and shall include all taxes. Tenders shall remain valid for 90 days from the date of opening of tenders.
- 7. All Tenders must be accompanied by a "tender Security" of Kshs 600,000/= (Bank Guarantee)
- 8. The Tenderer shall chronologically serialize all pages of the tender documents submitted.
- 9. Completed tenders must be delivered to the address below on or before **26**<sup>th</sup> **January 2023 at 11.00 am.** *Electronic* Tenders *will* **not** be permitted.
- 10. Tenders will be opened on 26<sup>th</sup> January 2023 at 11.30 am immediately after the deadline date and time specified above or any dead line date and time specified later. Tenders will be publicly opened in the presence of the Tenderers' designated representatives who choose to attend at the address below.
- 11. Late tenders will be rejected.
- 12. The addresses referred to above are:

Chief Executive Officer


Northern Water Works Development Agency

Maji House, Kismayu Road, Ground Floor Room A3

PO Box 495 – 70100 Garissa, Kenya

Tel: +254-46-2103598/3797

E-mail: info@nwwda.go.ke

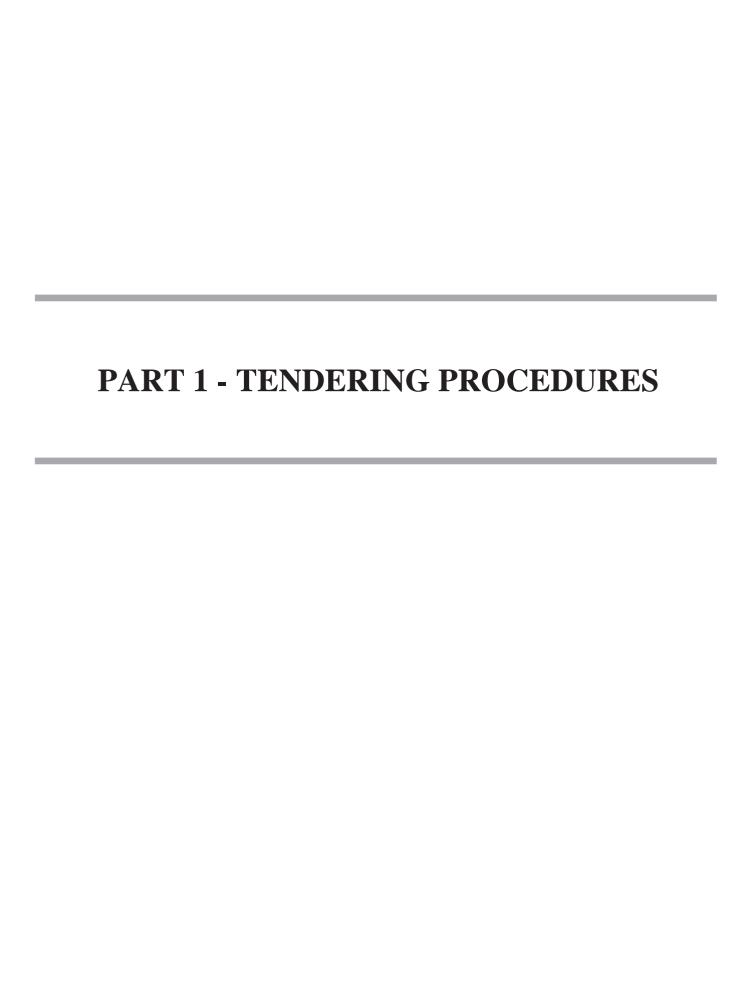

#### SECTION I: INSTRUCTIONS TO TENDERERS

#### A General Provisions

# 1. Scope of Tender

1.1 The Procuring Entity as defined in the Appendix to Conditions of Contract invites tenders for Works Contract as described in the tender documents. The name, identification, and number of lots (contracts) of this Tender Document are **specified in the TDS**.

#### 2. Fraud and Corruption

- 2.1 The Procuring Entity requires compliance with the provisions of the Public Procurement and Asset Disposal Act, 2015, Section 62 "Declaration not to engage in corruption". The tender submitted by a person shall include a declaration that the person shall not engage in any corrupt or fraudulent practice and a declaration that the person or his or her sub-contractors are not debarred from participating in public procurement proceedings.
- 2.2 The Procuring Entity requires compliance with the provisions of the Competition Act 2010, regarding <u>collusive</u> <u>practices</u> in contracting. Any tenderer found to have engaged in collusive conduct shall be disqualified and criminal and/or civil sanctions may be imposed. To this effect, Tenders shall be required to complete and sign the "Certificate of Independent Tender Determination" annexed to the Form of Tender.
- 2.3 Unfair Competitive Advantage Fairness and transparency in the tender process require that the firms or their Affiliates competing for a specific assignment do not derive a competitive advantage from having provided consulting services related to this tender. To that end, the Procuring Entity shall indicate in the **Data Sheet** and make available to all the firms together with this tender document all information that would in that respect give such firm any unfair competitive advantage over competing firms.
- 2.4 Unfair Competitive Advantage -Fairness and transparency in the tender process require that the Firms or their Affiliates competing for a specific assignment do not derive a competitive advantage from having provided consulting services related to this tender being tendered for. The Procuring Entity shall indicate in the **TDS** firms (if any) that provided consulting services for the contract being tendered for. The Procuring Entity shall check whether the owners or controllers of the Tenderer are same as those that provided consulting services. The Procuring Entity shall, upon request, make available to any tenderer information that would give such firm unfair competitive advantage over competing firms.

#### 3. Eligible Tenderers

- 3.1 A Tenderer may be a firm that is a private entity, a state-owned enterprise or institution subject to ITT 3.7 or any combination of such entities in the form of a joint venture (JV) under an existing agreement or with the intent to enter into such an agreement supported by a letter of intent. Public employees and their close relatives (*spouses*, *children*, *brothers*, *sisters and uncles and aunts*) are not eligible to participate in the tender. In the case of a joint venture, all members shall be jointly and severally liable for the execution of the entire Contract in accordance with the Contract terms. The JV shall nominate a Representative who shall have the authority to conduct all business for and on behalf of any and all the members of the JV during the tendering process and, in the event the JV is awarded the Contract, during contract execution. The maximum number of JV members shall be specified in the **TDS**.
- 3.2 Public Officers of the Procuring Entity, their Spouses, Child, Parent, Brothers or Sister. Child, Parent, Brother or Sister of a Spouse, their business associates or agents and firms/organizations in which they have a substantial or controlling interest shall not be eligible to tender or be awarded a contract. Public Officers are also not allowed to participate in any procurement proceedings.
- 3.3 A Tenderer shall not have a conflict of interest. Any tenderer found to have a conflict of interest shall be disqualified. A tenderer may be considered to have a conflict of interest for the purpose of this tendering process, if the tenderer:
  - a) Directly or indirectly controls, is controlled by or is under common control with another tenderer; or
  - b) Receives or has received any direct or indirect subsidy from another tenderer; or
  - c) Has the same legal representative as another tenderer; or
  - d) Has a relationship with another tenderer, directly or through common third parties, that puts it in a position to influence the tender of another tenderer, or influence the decisions of the Procuring Entity regarding this

- tendering process; or
- e) Any of its affiliates participated as a consultant in the preparation of the design or technical specifications of the works that are the subject of the tender; or
- f) any of its affiliates has been hired (or is proposed to be hired) by the Procuring Entity as Engineer for the Contract implementation; or
- g) Would be providing goods, works, or non-consulting services resulting from or directly related to consulting services for the preparation or implementation of the contract specified in this Tender Document or
- h) Has a close business or family relationship with a professional staff of the Procuring Entity who:
  - i) are directly or indirectly involved in the preparation of the Tender document or specifications of the Contract, and/or the Tender evaluation process of such contract; or
  - ii) would be involved in the implementation or supervision of such Contract unless the conflict stemming from such relationship has been resolved in a manner acceptable to the Procuring Entity throughout the tendering process and execution of the Contract.
- 3.4 A tenderer shall not be involved in corrupt, coercive, obstructive, collusive or fraudulent practice. A tenderer that is proven to have been involved any of these practices shall be automatically disqualified.
- 3.5 A Tenderer (either individually or as a JV member) shall not participate in more than one Tender, except for permitted alternative tenders. This includes participation as a subcontractor in other Tenders. Such participation shall result in the disqualification of all Tenders in which the firm is involved. A firm that is not a tenderer or a JV member may participate as a subcontractor in more than one tender. Members of a joint venture may not also make an individual tender, be a subcontractor in a separate tender or be part of another joint venture for the purposes of the same Tender.
- 3.6 A Tenderer may have the nationality of any country, subject to the restrictions pursuant to ITT 4.8.A Tenderer shall be deemed to have the nationality of a country if the Tenderer is constituted, incorporated or registered in and operates in conformity with the provisions of the laws of that country, as evidenced by its articles of incorporation (or equivalent documents of constitution or association) and its registration documents, as the case may be. This criterion also shall apply to the determination of the nationality of proposed subcontractors or subconsultants for any part of the Contract including related Services.
- 3.7 Tenderer that has been debarred from participating in public procurement shall be ineligible to tender or be awarded a contract. The list of debarred firms and individuals is available from the website of PPRA www.ppra.go.ke.
- 3.8 Tenderers that are state-owned enterprises or institutions may be eligible to compete and be awarded a Contract(s) only if they are accredited by PPRA to be (i) a legal public entity of the state Government and/or public administration, (ii) financially autonomous and not receiving any significant subsidies or budget support from any public entity or Government, and (iii) operating under commercial law and vested with legal rights and liabilities similar to any commercial enterprise to enable it compete with firms in the private sector on an equal basis.
- 3.9 A Firms and individuals may be ineligible if their countries of origin (a) as a matter of law or official regulations, Kenya prohibits commercial relations with that country, or (b) by an act of compliance with a decision of the United Nations Security Council taken under Chapter VII of the Charter of the United Nations, Kenya prohibits any import of goods or contracting of works or services from that country, or any payments to any country, person, or entity in that country. A tenderer shall provide such documentary evidence of eligibility satisfactory to the Procuring Entity, as the Procuring Entity shall reasonably request.
- 3.10 Foreign tenderers are required to source at least forty (40%) percent of their contract inputs (in supplies, subcontracts and labor) from national suppliers and contractors. To this end, a foreign tenderer shall provide in its tender documentary evidence that this requirement is met. Foreign tenderers not meeting this criterion will be automatically disqualified. Information required to enable the Procuring Entity determine if this condition is met shall be provided in for this purpose is be provided in "SECTION III EVALUATION AND QUALIFICATION CRITERIA, Item 9".
- 3.11 Pursuant to the eligibility requirements of ITT 4.10, a tender is considered a foreign tenderer, if the tenderer is not registered in Kenya or if the tenderer is registered in Kenya and has less than 51 percent ownership by Kenyan

Citizens. JVs are considered as foreign tenderers if the individual member firms are not registered in Kenya or if are registered in Kenya and have less than 51 percent ownership by Kenyan citizens. The JV shall not subcontract to foreign firms more than 10 percent of the contract price, excluding provisional sums.

- 3.12 The National Construction Authority Act of Kenya requires that all local and foreign contractors be registered with the National Construction Authority and be issued with a Registration Certificate before they can undertake any construction works in Kenya. Registration shall not be a condition for tender, but it shall be a condition of contract award and signature. A selected tenderer shall be given opportunity to register before such award and signature of contract. Application for registration with National Construction Authority may be accessed from the website www.nca.go.ke.
- 3.13 The Competition Act of Kenya requires that firms wishing to tender as Joint Venture undertakings which may prevent, distort or lessen competition in provision of services are prohibited unless they are exempt in accordance with the provisions of Section 25 of the Competition Act, 2010. JVs will be required to seek for exemption from the Competition Authority. Exemption shall not be a condition for tender, but it shall be a condition of contract award and signature. A JV tenderer shall be given opportunity to seek such exemption as a condition of award and signature of contract. Application for exemption from the Competition Authority of Kenya may be accessed from the website www.cak.go.ke
- 3.14 A Kenyan tenderer shall provide evidence of having fulfilled his/her tax obligations by producing a valid tax clearance certificate or tax exemption certificate issued by the Kenya Revenue Authority.

#### 4. Eligible Goods, Equipment, and Services

- 4.1 Goods, equipment and services to be supplied under the Contract may have their origin in any country that is not eligible under ITT 3.9. At the Procuring Entity's request, Tenderers may be required to provide evidence of the origin of Goods, equipment and services.
- 4.2 Any goods, works and production processes with characteristics that have been declared by the relevant national environmental protection agency or by other competent authority as harmful to human beings and to the environment shall not be eligible for procurement.

#### 5. Tenderer's Responsibilities

- 5.1 The tenderer shall bear all costs associated with the preparation and submission of his/her tender, and the Procuring Entity will in no case be responsible or liable for those costs.
- 5.2 The tenderer, at the tenderer's own responsibility and risk, is encouraged to visit and examine the Site of the Works and its surroundings, and obtain all information that may be necessary for preparing the tender and entering into a contract for construction of the Works. The costs of visiting the Site shall be at the tenderer's own expense.
- 5.3 The Tenderer and any of its personnel or agents will be granted permission by the Procuring Entity to enter upon its premises and lands for the purpose of such visit. The Tenderer shall indemnify the Procuring Entity against all liability arising from death or personal injury, loss of or damage to property, and any other losses and expenses incurred as a result of the inspection.
- 5.4 The tenderer shall provide in the Form of Tender and Qualification Information, a preliminary description of the proposed work method and schedule, including charts, as necessary or required.

#### **B.** Contents of Tender Documents

#### 6. Sections of Tender Document

6.1 The tender document consists of Parts 1, 2, and 3, which includes all the sections specified below, and which should be read in conjunction with any Addenda issued in accordance with ITT 8.

#### **PART 1 Tendering Procedures**

- i) Section I Instructions to Tenderers (ITT)
- ii) Section II Tender Data Sheet (TDS)
- iii) Section III Evaluation and Qualification Criteria
- iv) Section IV Tendering Forms

#### **PART 2 Works Requirements**

- i) Section V Drawings
- ii) Section VI Specifications
- iii) Section VII Bills of Quantities

#### **PART 3 Conditions of Contract and Contract Forms**

- i) Section VIII General Conditions of Contract (GCC)
- ii) Section IX Special Conditions of Contract (SC)
- iii) Section X Contract Forms
- 6.2 The Invitation to Tender Document (ITT) issued by the Procuring Entity is not part of the Contract documents.
- 6.3 Unless obtained directly from the Procuring Entity, the Procuring Entity is not responsible for the completeness of the Tender document, responses to requests for clarification, the minutes of the pre-Tender meeting (if any), or Addenda to the Tender document in accordance with ITT 8. In case of any contradiction, documents obtained directly from the Procuring Entity shall prevail.

The Tenderer is expected to examine all instructions, forms, terms, and specifications in the Tender Document and to furnish with its Tender all information and documentation as is required by the Tender document.

#### 7. Site Visit

7.1 The Tenderer, at the Tenderer's own responsibility and risk, is encouraged to visit and examine and inspect the Site of the Required Services and its surroundings and obtain all information that may be necessary for preparing the Tender and entering into a contract for the Services. The costs of visiting the Site shall be at the Tenderer's own expense.

#### 8. Pre-Tender Meeting

- 8.1 The Procuring Entity shall specify in the **TDS** if a pre-tender meeting will be held, when and where. The Procuring Entity shall also specify in the **TDS** if a pre-arranged pretender site visit will be held and when. The Tenderer's designated representative is invited to attend a pre-arranged pretender visit of the site of the works. The purpose of the meeting will be to clarify issues and to answer questions on any matter that may be raised at that stage.
- 8.2 The Tenderer is requested to submit any questions in writing, to reach the Procuring Entity not later than the period specified in the **TDS** before the meeting.
- 8.3 Minutes of the pre-Tender meeting and the pre-arranged pretender site visit of the site of the works, if applicable, including the text of the questions asked by Tenderers and the responses given, together with any responses prepared after the meeting, will be transmitted promptly to all Tenderers who have acquired the Tender Documents in accordance with ITT 6.3. Minutes shall not identify the source of the questions asked.
- 8.4 The Procuring Entity shall also promptly publish anonym zed (*no names*) Minutes of the pre-Tender meeting and the pre-arranged pretender visit of the site of the works at the web page identified in the **TDS**. Any modification to the Tender Documents that may become necessary as a result of the pre-tender meeting and the pre-arranged pretender site visit, shall be made by the Procuring Entity exclusively through the issue of an Addendum pursuant to ITT 8 and not through the minutes of the pre-Tender meeting. Nonattendance at the pre-Tender meeting will not be a cause for disqualification of a Tenderer.

#### 9. Clarification and amendments of Tender Documents

9.1 A Tenderer requiring any clarification of the Tender Document shall contact the Procuring Entity in writing at the Procuring Entity's address specified in the **TDS** or raise its enquiries during the pre-Tender meeting and the pre-

arranged pretender visit of the site of the works if provided for in accordance with ITT 8.4. The Procuring Entity will respond in writing to any request for clarification, provided that such request is received no later than the period specified in the **TDS** prior to the deadline for submission of tenders. The Procuring Entity shall forward copies of its response to all tenderers who have acquired the Tender Documents in accordance with ITT 6.3, including a description of the inquiry but without identifying its source. If specified in the **TDS**, the Procuring Entity shall also promptly publish its response at the web page identified in the **TDS**. Should the clarification result in changes to the essential elements of the Tender Documents, the Procuring Entity shall amend the Tender Documents appropriately following the procedure under ITT 8.4.

#### 10. Amendment of Tendering Document

- 10.1 At any time prior to the deadline for submission of Tenders, the Procuring Entity may amend the Tendering document by issuing addenda.
- 10.2 Any addendum issued shall be part of the tendering document and shall be communicated in writing to all who have obtained the tendering document from the Procuring Entity in accordance with ITT 6.3. The Procuring Entity shall also promptly publish the addendum on the Procuring Entity's web page in accordance with ITT 8.4.
- 10.3 To give prospective Tenderers reasonable time in which to take an addendum into account in preparing their Tenders, the Procuring Entity shall extend, as necessary, the deadline for submission of Tenders, in accordance with ITT 25.2 below.

#### C. Preparation of Tenders

#### 11. Cost of Tendering

11.1 The Tenderer shall bear all costs associated with the preparation and submission of its Tender, and the Procuring Entity shall not be responsible or liable for those costs, regardless of the conduct or outcome of the tendering process.

#### 12. Language of Tender

12.1 The Tender, as well as all correspondence and documents relating to the tender exchanged by the tenderer and the Procuring Entity, shall be written in the English Language. Supporting documents and printed literature that are part of the Tender may be in another language provided they are accompanied by an accurate and notarized translation of the relevant passages into the English Language, in which case, for purposes of interpretation of the Tender, such translation shall govern.

#### 13. Documents Comprising the Tender

- 13.1 The Tender shall comprise the following:
  - a) Form of Tender prepared in accordance with ITT 14;
  - b) Schedules including priced Bill of Quantities, completed in accordance with ITT 14 and ITT 16;
  - c) Tender Security or Tender-Securing Declaration, in accordance with ITT 21.1;
  - d) Alternative Tender, if permissible, in accordance with ITT 15;
  - e) Authorization: written confirmation authorizing the signatory of the Tender to commit the Tenderer, in accordance with ITT 22.3;
  - f) Qualifications: documentary evidence in accordance with ITT 19 establishing the Tenderer's qualifications to perform the Contract if its Tender is accepted;
  - g) Conformity: a technical proposal in accordance with ITT 18;
  - h) Any other document required in the **TDS**.
- 13.2 In addition to the requirements under ITT 11.1, Tenders submitted by a JV shall include a copy of the Joint Venture Agreement entered into by all members. Alternatively, a letter of intent to execute a Joint Venture Agreement in the event of a successful Tender shall be signed by all members and submitted with the Tender,

- together with a copy of the proposed Agreement. The Tenderer shall chronologically serialize pages of all tender documents submitted.
- 13.3 The Tenderer shall furnish in the Form of Tender information on commissions and gratuities, if any, paid or to be paid to agents or any other party relating to this Tender.

#### 14. Form of Tender and Schedules

14.1 The Form of Tender and Schedules, including the Bill of Quantities, shall be prepared using the relevant forms furnished in Section IV, Tendering Forms. The forms must be completed without any alterations to the text, and no substitutes shall be accepted except as provided under ITT 20.3. All blank spaces shall be filled in with the information requested.

#### 15. Alternative Tenders

- 15.1 Unless otherwise specified in the **TDS**, alternative Tenders shall not be considered.
- 15.2 When alternative times for completion are explicitly invited, a statement to that effect will be included in the **TDS**, and the method of evaluating different alternative times for completion will be described in Section III, Evaluation and Qualification Criteria.
- 15.3 Except as provided under ITT 13.4 below, Tenderers wishing to offer technical alternatives to the requirements of the Tender Documents must first price the Procuring Entity's design as described in the Tender Documents and shall further provide all information necessary for a complete evaluation of the alternative by the Procuring Entity, including drawings, design calculations, technical specifications, breakdown of prices, and proposed construction methodology and other relevant details. Only the technical alternatives, if any, of the Tenderer with the Winning Tender conforming to the basic technical requirements shall be considered by the Procuring Entity. When specified in the **TDS**, Tenderers are permitted to submit alternative technical solutions for specified parts of the Works, and such parts will be identified in the **TDS**, as will the method for their evaluating, and described in Section VII, Works' Requirements.

#### 16. Tender Prices and Discounts

- 16.1 The prices and discounts (including any price reduction) quoted by the Tenderer in the Form of Tender and in the Bill of Quantities shall conform to the requirements specified below.
- 16.2 The Tenderer shall fill in rates and prices for all items of the Works described in the Bill of Quantities. Items against which no rate or price is entered by the Tenderer shall be deemed covered by the rates for other items in the Bill of Quantities and will not be paid for separately by the Procuring Entity. An item not listed in the priced Bill of Quantities shall be assumed to be not included in the Tender, and provided that the Tender is determined substantially responsive notwithstanding this omission, the average price of the item quoted by substantially responsive Tenderers will be added to the Tender price and the equivalent total cost of the Tender so determined will be used for price comparison.
- 16.3 The price to be quoted in the Form of Tender, in accordance with ITT 14.1, shall be the total price of the Tender, including any discounts offered.
- 16.4 The Tenderer shall quote any discounts and the methodology for their application in the Form of Tender, in accordance with ITT 14.1.
- 16.5 It will be specified in the **TDS** if the rates and prices quoted by the Tenderer are or are not subject to adjustment during the performance of the Contract in accordance with the provisions of the Conditions of Contract, except in cases where the contract is subject to fluctuations and adjustments, not fixed price. In such a case, the Tenderer shall furnish the indices and weightings for the price adjustment formulae in the Schedule of Adjustment Data and the Procuring Entity may require the Tenderer to justify its proposed indices and weightings.
- 16.6 Where tenders are being invited for individual lots (contracts) or for any combination of lots (packages), tenderers wishing to offer discounts for the award of more than one Contract shall specify in their Tender the price reductions applicable to each package, or alternatively, to individual Contracts within the package. Discounts shall be submitted in accordance with ITT 16.4, provided the Tenders for all lots (contracts) are opened at the same time.

16.7 All duties, taxes, and other levies payable by the Contractor under the Contract, or for any other cause, as of the date 30 days prior to the deadline for submission of Tenders, shall be included in the rates and prices and the total Tender Price submitted by the Tenderer.

#### 17. Currencies of Tender and Payment

17.1 Tenderers shall quote entirely in Kenya Shillings. The unit rates and the prices shall be quoted by the Tenderer in the Bill of Quantities, entirely in Kenya shillings. A Tenderer expecting to incur expenditures in other currencies for inputs to the Works supplied from outside Kenya shall device own ways of getting foreign currency to meet those expenditures.

#### 18. Documents Comprising the Technical Proposal

18.1 The Tenderer shall furnish a technical proposal including a statement of work methods, equipment, personnel, schedule and any other information as stipulated in Section IV, Tender Forms, in sufficient detail to demonstrate the adequacy of the Tenderer's proposal to meet the work's requirements and the completion time.

#### 19. Documents Establishing the Eligibility and Qualifications of the Tenderer

- 19.1 Tenderers shall complete the Form of Tender, included in Section IV, Tender Forms, to establish Tenderer's eligibility in accordance with ITT 4.
- 19.2 In accordance with Section III, Evaluation and Qualification Criteria, to establish its qualifications to perform the Contract the Tenderer shall provide the information requested in the corresponding information sheets included in Section IV, Tender Forms.
- 19.3 A margin of preference will not be allowed. Preference and reservations will be allowed, individually or in joint ventures. Applying for eligibility for Preference and reservations shall supply all information required to satisfy the criteria for eligibility specified in accordance with ITT 33.1.
- 19.4 Tenderers shall be asked to provide, as part of the data for qualification, such information, including details of ownership, as shall be required to determine whether, according to the classification established by the Procuring Entity, a contractor or group of contractors qualifies for a margin of preference. Further the information will enable the Procuring Entity identify any actual or potential conflict of interest in relation to the procurement and/or contract management processes, or a possibility of collusion between tenderers, and thereby help to prevent any corrupt influence in relation to the procurement process or contract management.
- 19.5 The purpose of the information described in ITT 19.4 above overrides any claims to confidentiality which a tenderer may have. There can be no circumstances in which it would be justified for a tenderer to keep information relating to its ownership and control confidential where it is tendering to undertake public sector work and receive public sector funds. Thus, confidentiality will not be accepted by the Procuring Entity as a justification for a Tenderer's failure to disclose, or failure to provide required information on its ownership and control.
- 19.6 The Tenderer shall provide further documentary proof, information or authorizations that the Procuring Entity may request in relation to ownership and control which information on any changes to the information which was provided by the tenderer under ITT 6.3. The obligations to require this information shall continue for the duration of the procurement process and contract performance and after completion of the contract, if any change to the information previously provided may reveal a conflict of interest in relation to the award or management of the contract.
- 19.7 All information provided by the tenderer pursuant to these requirements must be complete, current and accurate as at the date of provision to the Procuring Entity. In submitting the information required pursuant to these requirements, the Tenderer shall warrant that the information submitted is complete, current and accurate as at the date of submission to the Procuring Entity.
- 19.8 If a tenderer fails to submit the information required by these requirements, its tender will be rejected. Similarly, if the Procuring Entity is unable, after taking reasonable steps, to verify to a reasonable degree the information submitted by a tenderer pursuant to these requirements, then the tender will be rejected.
- 19.9 If information submitted by a tenderer pursuant to these requirements, or obtained by the Procuring Entity (whether through its own enquiries, through notification by the public or otherwise), shows any conflict of

interest which could materially and improperly benefit the tenderer in relation to the procurement or contract management process, then:

- i) if the procurement process is still ongoing, the tenderer will be disqualified from the procurement process,
- ii) if the contract has been awarded to that tenderer, the contract award will be set aside,
- iii) the tenderer will be referred to the relevant law enforcement authorities for investigation of whether the tenderer or any other persons have committed any criminal offence.
- 19.10 If a tenderer submits information pursuant to these requirements that is incomplete, inaccurate or out-of-date, or attempts to obstruct the verification process, then the consequences ITT 6.7 will ensue unless the tenderer can show to the reasonable satisfaction of the Procuring Entity that any such act was not material, or was due to genuine error which was not attributable to the intentional act, negligence or recklessness of the tenderer.

#### 20. Period of Validity of Tenders

- 20.1 Tenders shall remain valid for the Tender Validity period specified in the **TDS**. The Tender Validity period starts from the date fixed for the Tender submission deadline (as prescribed by the Procuring Entity in accordance with ITT 24). A Tender valid for a shorter period shall be rejected by the Procuring Entity as non-responsive.
- 20.2 In exceptional circumstances, prior to the expiration of the Tender validity period, the Procuring Entity may request Tenderers to extend the period of validity of their Tenders. The request and the responses shall be made in writing. If a Tender Security is requested in accordance with ITT 21.1, it shall also be extended for thirty (30) days beyond the deadline of the extended validity period. A Tenderer may refuse the request without forfeiting its Tender security. A Tenderer granting the request shall not be required or permitted to modify its Tender, except as provided in ITT 20.3.
- 20.3 If the award is delayed by a period exceeding the number of days to be specified in the **TDS** days beyond the expiry of the initial tender validity period, the Contract price shall be determined as follows:
  - a) in the case of **fixed price** contracts, the Contract price shall be the tender price adjusted by the factor specified in the **TDS**;
  - b) in the case of **adjustable price** contracts, no adjustment shall be made; or in any case, tender evaluation shall be based on the tender price without taking into consideration the applicable correction from those indicated above.

#### 21. Tender Security

- 21.1 The Tenderer shall furnish as part of its Tender, either a Tender-Securing Declaration or a Tender Security as specified in the **TDS**, in original form and, in the case of a Tender Security, in the amount and currency specified in the **TDS**. A Tender-Securing Declaration shall use the form included in Section IV, Tender Forms.
- 21.2 If a Tender Security is specified pursuant to ITT 19.1, the Tender Security shall be a demand guarantee in any of the following forms at the Tenderer's option:
  - a) an unconditional Bank Guarantee issued by reputable commercial bank); or
  - b) an irrevocable letter of credit;
  - c) a Banker's cheque issued by a reputable commercial bank; or
  - d) another security specified in the TDS,
- 21.3 If an unconditional bank guarantee is issued by a bank located outside Kenya, the issuing bank shall have a correspondent bank located in Kenya to make it enforceable. The Tender Security shall be valid for thirty (30) days beyond the original validity period of the Tender, or beyond any period of extension if requested under ITT 20.2.
- 21.4 If a Tender Security or Tender-Securing Declaration is specified pursuant to ITT 19.1, any Tender not accompanied by a substantially responsive Tender Security or Tender-Securing Declaration shall be rejected by the Procuring Entity as non-responsive.
- 21.5 If a Tender Security is specified pursuant to ITT 21.1, the Tender Security of unsuccessful Tenderers shall be returned as promptly as possible upon the successful Tenderer's signing the Contract and furnishing the Performance Security and any other documents required in the **TDS**. The Procuring Entity shall also promptly return the tender security to the tenderers where the procurement proceedings are terminated, all tenders were

determined nonresponsive or a bidder declines to extend tender validity period.

- 21.6 The Tender Security of the successful Tenderer shall be returned as promptly as possible once the successful Tenderer has signed the Contract and furnished the required Performance Security, and any other documents required in the **TDS**.
- 21.7 The Tender Security may be forfeited or the Tender-Securing Declaration executed:
  - e) if a Tenderer withdraws its Tender during the period of Tender validity specified by the Tenderer on the Form of Tender, or any extension thereto provided by the Tenderer; or
  - f) if the successful Tenderer fails to:
    - i) sign the Contract in accordance with ITT 50; or
    - ii) furnish a Performance Security and if required in the **TDS**, and any other documents required in the **TDS**
- 21.8 Where tender securing declaration is executed, the Procuring Entity shall recommend to the PPRA that PPRA debars the Tenderer from participating in public procurement as provided in the law.
- 21.9 The Tender Security or the Tender-Securing Declaration of a JV shall be in the name of the JV that submits the Tender. If the JV has not been legally constituted into a legally enforceable JV at the time of tendering, the Tender Security or the Tender-Securing Declaration shall be in the names of all future members as named in the letter of intent referred to in ITT 4.1 and ITT 11.2.
- 21.10A tenderer shall not issue a tender security to guarantee itself.

# 22. Format and Signing of Tender

- 22.1 The Tenderer shall prepare one original of the documents comprising the Tender as described in ITT 13 and clearly mark it "ORIGINAL." Alternative Tenders, if permitted in accordance with ITT 15, shall be clearly marked "ALTERNATIVE." In addition, the Tenderer shall submit copies of the Tender, in the number specified in the **TDS** and clearly mark them "COPY." In the event of any discrepancy between the original and the copies, the original shall prevail.
- 22.2 Tenderers shall mark as "CONFIDENTIAL" all information in their Tenders which is confidential to their business. This may include proprietary information, trade secrets, or commercial or financially sensitive information.
- 22.3 The original and all copies of the Tender shall be typed or written in indelible ink and shall be signed by a person duly authorized to sign on behalf of the Tenderer. This authorization shall consist of a written confirmation as specified in the **TDS** and shall be attached to the Tender. The name and position held by each person signing the authorization must be typed or printed below the signature. All pages of the Tender where entries or amendments have been made shall be signed or initialed by the person signing the Tender.
- 22.4 In case the Tenderer is a JV, the Tender shall be signed by an authorized representative of the JV on behalf of the JV, and to be legally binding on all the members as evidenced by a power of attorney signed by their legally authorized representatives.
- 22.5 Any inter-lineation, erasures, or overwriting shall be valid only if they are signed or initialed by the person signing the Tender.

# **D.** Submission and Opening of Tenders

- **23.** Sealing and Marking of Tenders
- 23.1 Depending on the sizes or quantities or weight of the tender documents, a tenderer may use an envelope, package or container. The Tenderer shall deliver the Tender in a single sealed envelope, or in a single sealed package, or in a single sealed container bearing the name and Reference number of the Tender, addressed to the Procuring Entity and a warning not to open before the time and date for Tender opening date. Within the single envelope, package or container, the Tenderer shall place the following separate, sealed envelopes:
  - a) in an envelope or package or container marked "ORIGINAL", all documents comprising the Tender, as described in ITT 11; and

- b) in an envelope or package or container marked "COPIES", all required copies of the Tender; and
- c) if alternative Tenders are permitted in accordance with ITT 15, and if relevant:
  - i) in an envelope or package or container marked "ORIGINAL -ALTERNATIVE TENDER", the alternative Tender; and
  - ii) in the envelope or package or container marked "COPIES- ALTERNATIVE TENDER", all required copies of the alternative Tender.

The inner envelopes or packages or containers shall:

- a) bear the name and address of the Procuring Entity.
- b) bear the name and address of the Tenderer; and
- c) bear the name and Reference number of the Tender.
- 23.2 If an envelope or package or container is not sealed and marked as required, the *Procuring Entity* will assume no responsibility for the misplacement or premature opening of the Tender. Tenders that are misplaced or opened prematurely will not be accepted.

#### 24. Deadline for Submission of Tenders

- 24.1 Tenders must be received by the Procuring Entity at the address specified in the **TDS** and no later than the date and time also specified in the **TDS**. When so specified in the **TDS**, Tenderers shall have the option of submitting their Tenders electronically. Tenderers submitting Tenders electronically shall follow the electronic Tender submission procedures specified in the **TDS**.
- 24.2 The Procuring Entity may, at its discretion, extend the deadline for the submission of Tenders by amending the Tender Documents in accordance with ITT 8, in which case all rights and obligations of the Procuring Entity and Tenderers previously subject to the deadline shall thereafter be subject to the deadline as extended.

#### 25. Late Tenders

25.1 The Procuring Entity shall not consider any Tender that arrives after the deadline for submission of tenders, in accordance with ITT 24. Any Tender received by the Procuring Entity after the deadline for submission of Tenders shall be declared late, rejected, and returned unopened to the Tenderer.

#### 26. Withdrawal, Substitution, and Modification of Tenders

- 26.1 A Tenderer may withdraw, substitute, or modify its Tender after it has been submitted by sending a written notice, duly signed by an authorized representative, and shall include a copy of the authorization in accordance with ITT 22.3, (except that withdrawal notices do not require copies). The corresponding substitution or modification of the Tender must accompany the respective written notice. All notices must be:
  - a) prepared and submitted in accordance with ITT 22 and ITT 23 (except that withdrawals notices do not require copies), and in addition, the respective envelopes shall be clearly marked "WITHDRAWAL," "SUBSTITUTION," "MODIFICATION;" and
  - b) received by the Procuring Entity prior to the deadline prescribed for submission of Tenders, in accordance with ITT 24.
- 26.2 Tenders requested to be withdrawn in accordance with ITT 26.1 shall be returned unopened to the Tenderers.
- 26.3 No Tender may be withdrawn, substituted, or modified in the interval between the deadline for submission of Tenders and the expiration of the period of Tender validity specified by the Tenderer on the Form of Tender or any extension thereof.

#### 27. Tender Opening

- 27.1 Except in the cases specified in ITT 23 and ITT 26.2, the Procuring Entity shall publicly open and read out all Tenders received by the deadline, at the date, time and place specified in the **TDS**, in the presence of Tenderers' designated representatives who chooses to attend. Any specific electronic Tender opening procedures required if electronic Tendering is permitted in accordance with ITT 24.1, shall be as specified in the **TDS**.
- 27.2 First, envelopes marked "WITHDRAWAL" shall be opened and read out and the envelopes with the corresponding Tender shall not be opened, but returned to the Tenderer. No Tender withdrawal shall be permitted unless the corresponding withdrawal notice contains a valid authorization to request the withdrawal

and is read out at Tender opening.

- 27.3 Next, envelopes marked "SUBSTITUTION" shall be opened and read out and exchanged with the corresponding Tender being substituted, and the substituted Tender shall not be opened, but returned to the Tenderer. No Tender substitution shall be permitted unless the corresponding substitution notice contains a valid authorization to request the substitution and is read out at Tender opening.
- 27.4 Next, envelopes marked "MODIFICATION" shall be opened and read out with the corresponding Tender. No Tender modification shall be permitted unless the corresponding modification notice contains a valid authorization to request the modification and is read out at Tender opening.
- 27.5 Next, all remaining envelopes shall be opened one at a time, reading out: the name of the Tenderer and whether there is a modification; the total Tender Price, per lot (contract) if applicable, including any discounts and alternative Tenders; the presence or absence of a Tender Security or Tender-Securing Declaration, if required; and any other details as the Procuring Entity may consider appropriate.
- 27.6 Only Tenders, alternative Tenders and discounts that are opened and read out at Tender opening shall be considered further for evaluation. The Form of Tender and pages of the Bills of Quantities are to be initialed by the members of the tender opening committee attending the opening. The number of representatives of the Procuring Entity to sign shall be specified in the **TDS**.
- 27.7 At the Tender Opening, the Procuring Entity shall neither discuss the merits of any Tender nor reject any Tender (except for late Tenders, in accordance with ITT 25.1).

# 27.8 The Procuring Entity shall prepare minutes of the Tender Opening that shall include, as a minimum:

- a) the name of the Tenderer and whether there is a withdrawal, substitution, or modification;
- b) the Tender Price, per lot (contract) if applicable, including any discounts;
- c) any alternative Tenders;
- d) the presence or absence of a Tender Security, if one was required.
- e) number of pages of each tender document submitted.
- 27.9 The Tenderers' representatives who are present shall be requested to sign the minutes. The omission of a Tenderer's signature on the minutes shall not invalidate the contents and effect of the minutes. A copy of the tender opening register shall be distributed to all Tenderers upon request.

#### E. Evaluation and Comparison of Tenders

#### 28. Confidentiality

- 28.1 Information relating to the evaluation of Tenders and recommendation of contract award shall not be disclosed to Tenderers or any other persons not officially concerned with the Tender process until information on Intention to Award the Contract is transmitted to all Tenderers in accordance with ITT 46.
- 28.2 Any effort by a Tenderer to influence the Procuring Entity in the evaluation of the Tenders or Contract award decisions may result in the rejection of its tender.
- 28.3 Notwithstanding ITT 28.2, from the time of tender opening to the time of contract award, if a tenderer wishes to contact the Procuring Entity on any **matter related to the tendering process, it shall do so in writing.**

#### 29. Clarification of Tenders

- 29.1 To assist in the examination, evaluation, and comparison of the tenders, and qualification of the tenderers, the Procuring Entity may, at its discretion, ask any tenderer for a clarification of its tender, given a reasonable time for a response. Any clarification submitted by a tenderer that is not in response to a request by the Procuring Entity shall not be considered. The Procuring Entity's request for clarification and the response shall be in writing. No change, including any voluntary increase or decrease, in the prices or substance of the tender shall be sought, offered, or permitted, except to confirm the correction of arithmetic errors discovered by the Procuring Entity in the evaluation of the tenders, in accordance with ITT 33.
- 29.2 If a tenderer does not provide clarifications of its tender by the date and time set in the Procuring Entity's request for clarification, its Tender may be rejected.

#### 30. Deviations, Reservations, and Omissions

- 30.1 During the evaluation of tenders, the following definitions apply:
  - a) "Deviation" is a departure from the requirements specified in the tender document;
  - b) "Reservation" is the setting of limiting conditions or withholding from complete acceptance of the requirements specified in the tender document; and
  - c) "Omission" is the failure to submit part or all of the information or documentation required in the Tender document.

#### 31. Determination of Responsiveness

- 31.1 The Procuring Entity's determination of a Tender's responsiveness is to be based on the contents of the tender itself, as defined in ITT 13.
- 31.2 A substantially responsive Tender is one that meets the requirements of the Tender document without material deviation, reservation, or omission. A material deviation, reservation, or omission is one that, if accepted, would:
  - a) affect in any substantial way the scope, quality, or performance of the Works specified in the Contract; or
  - b) limit in any substantial way, inconsistent with the tender document, the Procuring Entity's rights or the tenderer's obligations under the proposed contract; or
  - c) if rectified, would unfairly affect the competitive position of other tenderers presenting substantially responsive tenders.
- 31.3 The Procuring Entity shall examine the technical aspects of the tender submitted in accordance with ITT 18, to confirm that all requirements of Section VII, Works' Requirements have been met without any material deviation, reservation or omission.
- 31.4 If a tender is not substantially responsive to the requirements of the tender document, it shall be rejected by the Procuring Entity and may not subsequently be made responsive by correction of the material deviation, reservation, or omission.

#### 32. Non-material Non-conformities

- 32.1 Provided that a tender is substantially responsive, the Procuring Entity may waive any non-conformities in the tender.
- 32.2 Provided that a Tender is substantially responsive, the Procuring Entity may request that the tenderer submit the necessary information or documentation, within a reasonable period, to rectify nonmaterial non-conformities in the tender related to documentation requirements. Requesting information or documentation on such non-conformities shall not be related to any aspect of the price of the tender. Failure of the tenderer to comply with the request may result in the rejection of its tender.
- 32.3 Provided that a tender is substantially responsive, the Procuring Entity shall rectify quantifiable nonmaterial non-conformities related to the Tender Price. To this effect, the Tender Price shall be adjusted, for comparison purposes only, to reflect the price of a missing or non-conforming item or component in the manner specified in the **TDS**.

#### 33. Arithmetical Errors

- 33.1 The tender sum as submitted and read out during the tender opening shall be absolute and final and shall not be the subject of correction, adjustment or amendment in any way by any person or entity.
- 33.2 Provided that the Tender is substantially responsive, the Procuring Entity shall handle errors on the following basis:
  - a) Any error detected if considered a major deviation that affects the substance of the tender, shall lead to disqualification of the tender as non-responsive.
  - b) Any errors in the submitted tender arising from a miscalculation of unit price, quantity, and subtotal and total bid price shall be considered as a major deviation that affects the substance of the tender and shall lead to disqualification of the tender as non-responsive. and
  - c) if there is a discrepancy between words and figures, the amount in words shall prevail

33.3 Tenderers shall be notified of any error detected in their bid during the notification of a ward.

#### 34. Currency provisions

34.1 Tenders will priced be in Kenya Shillings only. Tenderers quoting in currencies other than in Kenya shillings will be determined non-responsive and rejected.

#### 35. Margin of Preference and Reservations

- 35.1 No margin of preference shall be allowed on contracts for small works.
- 35.2 Where it is intended to reserve the contract to specific groups under Small and Medium Enterprises, or enterprise of women, youth and/or persons living with disability, who are appropriately registered as such by the authority to be specified in the **TDS**, a procuring entity shall ensure that the invitation to tender specifically indicates that only businesses/firms belonging to those specified groups are the only ones eligible to tender. Otherwise if no so stated, the invitation will be open to all tenderers.

#### 36. Nominated Subcontractors

- 36.1 Unless otherwise stated in the **TDS**, the Procuring Entity does not intend to execute any specific elements of the Works by subcontractors selected in advance by the Procuring Entity.
- 36.2 Tenderers may propose subcontracting up to the percentage of total value of contracts or the volume of works as specified in the **TDS**. Subcontractors proposed by the Tenderer shall be fully qualified for their parts of the Works.
- 36.3 The subcontractor's qualifications shall not be used by the Tenderer to qualify for the Works unless their specialized parts of the Works were previously designated by the Procuring Entity in the **TDS** as can be met by subcontractors referred to hereafter as 'Specialized Subcontractors', in which case, the qualifications of the Specialized Subcontractors proposed by the Tenderer may be added to the qualifications of the Tenderer.

#### 37. Evaluation of Tenders

- 37.1 The Procuring Entity shall use the criteria and methodologies listed in this ITT and Section III, Evaluation and Qualification Criteria. No other evaluation criteria or methodologies shall be permitted. By applying the criteria and methodologies the Procuring Entity shall determine the Best Evaluated Tender in accordance with ITT 40.
- 37.2 To evaluate a Tender, the Procuring Entity shall consider the following:
  - a) price adjustment due to discounts offered in accordance with ITT 16;
  - b) converting the amount resulting from applying (a) and (b) above, if relevant, to a single currency in accordance with ITT39;
  - c) price adjustment due to quantifiable nonmaterial non-conformities in accordance with ITT 30.3; and
  - d) any additional evaluation factors specified **in the TDS** and Section III, Evaluation and Qualification Criteria.
- 37.3 The estimated effect of the price adjustment provisions of the Conditions of Contract, applied over the period of execution of the Contract, shall not be considered in Tender evaluation.
- 37.4 In the case of multiple contracts or lots, Tenderers shall be allowed to tender for one or more lots and the methodology to determine the lowest evaluated cost of the lot (contract) combinations, including any discounts offered in the **Form of Tender**, is specified in Section III, Evaluation and Qualification Criteria.

#### 38. Comparison of Tenders

38.1 The Procuring Entity shall compare the evaluated costs of all substantially responsive Tenders established in accordance with ITT 38.2 to determine the Tender that has the lowest evaluated cost.

#### 39. Abnormally Low Tenders

39.1 An Abnormally Low Tender is one where the Tender price, in combination with other elements of the Tender, appears so low that it raises material concerns as to the capability of the Tenderer in regards to the Tenderer's ability to perform the Contract for the offered Tender Price or that genuine competition between Tenderers is compromised.

- 39.2 In the event of identification of a potentially Abnormally Low Tender, the Procuring Entity shall seek written clarifications from the Tenderer, including detailed price analyses of its Tender price in relation to the subject matter of the contract, scope, proposed methodology, schedule, allocation of risks and responsibilities and any other requirements of the Tender document.
- 39.3 After evaluation of the price analyses, in the event that the Procuring Entity determines that the Tenderer has failed to demonstrate its capability to perform the Contract for the offered Tender Price, the Procuring Entity shall reject the Tender.

#### 40. Abnormally High Tenders

- 40.1 An abnormally high price is one where the tender price, in combination with other constituent elements of the Tender, appears unreasonably too high to the extent that the Procuring Entity is concerned that it (the Procuring Entity) may not be getting value for money or it may be paying too high a price for the contract compared with market prices or that genuine competition between Tenderers is compromised.
- 40.2 In case of an abnormally high tender price, the Procuring Entity shall make a survey of the market prices, check if the estimated cost of the contract is correct and review the Tender Documents to check if the specifications, scope of work and conditions of contract are contributory to the abnormally high tenders. The Procuring Entity may also seek written clarification from the tenderer on the reason for the high tender price. The Procuring Entity shall proceed as follows:
  - i) If the tender price is abnormally high based on wrong estimated cost of the contract, the Procuring Entity\_may accept or not accept the tender depending on the Procuring Entity's budget considerations.
  - ii) If specifications, scope of work and/or conditions of contract are contributory to the abnormally high tender prices, the Procuring Entity shall reject all tenders and may retender for the contract based on revised estimates, specifications, scope of work and conditions of contract, as the case may be.
- 40.3 If the Procuring Entity determines that the Tender Price is abnormally too high because genuine competition between tenderers is compromised (*often due to collusion, corruption or other manipulations*), the Procuring Entity shall reject all Tenders and shall institute or cause competent Government Agencies to institute an investigation on the cause of the compromise, before retendering.

#### 41. Unbalanced and/or Front-Loaded Tenders

- 41.1 If in the Procuring Entity's opinion, the Tender that is evaluated as the lowest evaluated price is seriously unbalanced and/or front loaded, the Procuring Entity may require the Tenderer to provide written clarifications. Clarifications may include detailed price analyses to demonstrate the consistency of the tender prices with the scope of works, proposed methodology, schedule and any other requirements of the Tender document.
- 41.2 After the evaluation of the information and detailed price analyses presented by the Tenderer, the Procuring Entity may as appropriate:
  - a) accept the Tender; or
  - b) require that the total amount of the Performance Security be increased at the expense of the Tenderer to a level not exceeding a 30% of the Contract Price; or
  - c) agree on a payment mode that eliminates the inherent risk of the Procuring Entity paying too much for undelivered works; or
  - d) reject the Tender,

#### 42. Qualifications of the Tenderer

- 42.1 The Procuring Entity shall determine to its satisfaction whether the eligible Tenderer that is selected as having submitted the lowest evaluated cost and substantially responsive Tender, meets the qualifying criteria specified in Section III, Evaluation and Qualification Criteria.
- 42.2 The determination shall be based upon an examination of the documentary evidence of the Tenderer's qualifications submitted by the Tenderer, pursuant to ITT 19. The determination shall not take into consideration the qualifications of other firms such as the Tenderer's subsidiaries, parent entities, affiliates, subcontractors (other than Specialized Subcontractors if permitted in the Tender document), or any other firm(s) different from the Tenderer.
- 42.3 An affirmative determination shall be a prerequisite for award of the Contract to the Tenderer. A negative

determination shall result in disqualification of the Tender, in which event the Procuring Entity shall proceed to the Tenderer who offers a substantially responsive Tender with the next lowest evaluated price to make a similar determination of that Tenderer's qualifications to perform satisfactorily.

- 42.4 An Abnormally Low Tender is one where the Tender price, in combination with other elements of the Tender, appears so low that it raises material concerns as to the capability of the Tenderer in regards to the Tenderer's ability to perform the Contract for the offered Tender Price.
- 42.5 In the event of identification of a potentially Abnormally Low Tender, the Procuring Entity shall seek written clarifications from the Tenderer, including detailed price analyses of its Tender price in relation to the subject matter of the contract, scope, proposed methodology, schedule, allocation of risks and responsibilities and any other requirements of the Tender document.
- 42.6 After evaluation of the price analyses, if the Procuring Entity determines that the Tenderer has failed to demonstrate its capability to perform the Contract for the offered Tender Price, the Procuring Entity shall reject the Tender.

#### 43. Best Evaluated Tender

- 43.1 Having compared the evaluated prices of Tenders, the Procuring Entity shall determine the Best Evaluated Tender. The Best Evaluated Tender is the Tender of the Tenderer that meets the Qualification Criteria and whose Tender has been determined to be:
  - a) Most responsive to the Tender document; and
  - b) the lowest evaluated price.

#### 44. Procuring Entity's Right to Accept Any Tender, and to Reject Any or All Tenders.

44.1 The Procuring Entity reserves the right to accept or reject any Tender and to annul the Tender process and reject all Tenders at any time prior to Contract Award, without thereby incurring any liability to Tenderers. In case of annulment, all Tenderers shall be notified with reasons and all Tenders submitted and specifically, Tender securities, shall be promptly returned to the Tenderers.

#### F. Award of Contract

#### 45. Award Criteria

45.1 The Procuring Entity shall award the Contract to the successful tenderer whose tender has been determined to be the Lowest Evaluated Tender.

#### 46. Notice of Intention to enter into a Contract

- 46.1 Upon award of the contract and Prior to the expiry of the Tender Validity Period the Procuring Entity shall issue a Notification of Intention to Enter into a Contract / Notification of award to all tenderers which shall contain, at a minimum, the following information:
  - a) the name and address of the Tenderer submitting the successful tender;
  - b) the Contract price of the successful tender;
  - c) a statement of the reason(s) the tender of the unsuccessful tenderer to whom the letter is addressed was unsuccessful, unless the price information in (c) above already reveals the reason;
  - d) the expiry date of the Standstill Period; and
  - e) instructions on how to request a debriefing and/or submit a complaint during the standstill period;

#### 47. Standstill Period

- 47.1 The Contract shall not be signed earlier than the expiry of a Standstill Period of 14 days to allow any dissatisfied tender to launch a complaint. Where only one Tender is submitted, the Standstill Period shall not apply.
- 47.2 Where a Standstill Period applies, it shall commence when the Procuring Entity has transmitted to each Tenderer the Notification of Intention to Enter into a Contract with the successful Tenderer.

#### 48. Debriefing by the Procuring Entity

- 48.1 On receipt of the Procuring Entity's Notification of Intention to Enter into a Contract referred to in ITT 46, an unsuccessful tenderer may make a written request to the Procuring Entity for a debriefing on specific issues or concerns regarding their tender. The Procuring Entity shall provide the debriefing within five days of receipt of the request.
- 48.2 Debriefings of unsuccessful Tenderers may be done in writing or verbally. The Tenderer shall bear its own costs of attending **such a debriefing meeting.**

#### 49. Letter of Award

49.1 Prior to the expiry of the Tender Validity Period and upon expiry of the Standstill Period specified in ITT 42.1, upon addressing a complaint that has been filed within the Standstill Period, the Procuring Entity shall transmit the Letter of Award to the successful Tenderer. The letter of award shall request the successful tenderer to furnish the Performance Security within 21days of the date of the letter.

#### 50. Signing of Contract

- 50.1 Upon the expiry of the fourteen days of the Notification of Intention to enter into contract and upon the parties meeting their respective statutory requirements, the Procuring Entity shall send the successful Tenderer the Contract Agreement.
- 50.2 Within fourteen (14) days of receipt of the Contract Agreement, the successful Tenderer shall sign, date, and return it to the Procuring Entity.
- 50.3 The written contract shall be entered into within the period specified in the notification of award and before expiry of the tender validity period

#### 51. Appointment of Adjudicator

51.1 The Procuring Entity proposes the person named in the **TDS** to be appointed as Adjudicator under the Contract, at the hourly fee specified in the **TDS**, plus reimbursable expenses. If the Tenderer disagrees with this proposal, the Tenderer should so state in his Tender. If, in the Letter of Acceptance, the Procuring Entity does not agree on the appointment of the Adjudicator, the Procuring Entity will request the Appointing Authority designated in the Special Conditions of Contract (SCC) pursuant to Clause 23.1 of the General Conditions of Contract (GCC), to appoint the Adjudicator.

#### 52. Performance Security

- 52.1 Within twenty-one (21) days of the receipt of the Letter of Acceptance from the Procuring Entity, the successful Tenderer shall furnish the Performance Security and, any other documents required in the **TDS**, in accordance with the General Conditions of Contract, subject to ITT 40.2 (b), using the Performance Security and other Forms included in Section X, Contract Forms, or another form acceptable to the Procuring Entity. A foreign institution providing a bank guarantee shall have a correspondent financial institution located in Kenya, unless the Procuring Entity has agreed in writing that a correspondent bank is not required.
- 52.2 Failure of the successful Tenderer to submit the above-mentioned Performance Security and other documents required in the **TDS**, or sign the Contract shall constitute sufficient grounds for the annulment of the award and forfeiture of the Tender Security. In that event the Procuring Entity may award the Contract to the Tenderer offering the next Best Evaluated Tender.
- 52.3 Performance security shall not be required for contracts estimated to cost less than Kenya shillings five million shillings.

#### 53. Publication of Procurement Contract

- 53.1 Within fourteen days after signing the contract, the Procuring Entity shall publish the awarded contract at its notice boards and websites; and on the Website of the Authority. At the minimum, the notice shall contain the following information:
  - a) name and address of the Procuring Entity;
  - b) name and reference number of the contract being awarded, a summary of its scope and the selection

method used;

- c) the name of the successful Tenderer, the final total contract price, the contract duration.
- d) dates of signature, commencement and completion of contract;
- e) names of all Tenderers that submitted Tenders, and their Tender prices as read out at Tender opening.

# 54. Procurement Related Complaints and Administrative Review

- 54.1 The procedures for making Procurement-related Complaints are as specified in the **TDS**.
- 54.2 A request for administrative review shall be made in the form provided under contract forms.

# **Section II - Tender Data Sheet (TDS)**

The following specific data shall complement, supplement, or amend the provisions in the Instructions to Tenderers (ITT). Whenever there is a conflict, the provisions herein shall prevail over those in ITT.

ITT 1.1	A. General The name of the contract is Construction of IJARA WATER SUPPLY PROJECT:- PROPOSED CONSTRUCTION OF MASALANI-GABABA PIPELINE EXTENSION & ANCILLARY WORKS The reference number of the Contract is - NWWDA/T/CW/004/2022-2023 The Information made available on competing firms is as follows: N/A
	The name of the contract is Construction of IJARA WATER SUPPLY PROJECT:-PROPOSED CONSTRUCTION OF MASALANI-GABABA PIPELINE EXTENSION & ANCILLARY WORKS  The reference number of the Contract is - NWWDA/T/CW/004/2022-2023
	PROPOSED CONSTRUCTION OF MASALANI-GABABA PIPELINE EXTENSION & ANCILLARY WORKS  The reference number of the Contract is - NWWDA/T/CW/004/2022-2023
ITT 2.3	EXTENSION & ANCILLARY WORKS  The reference number of the Contract is - NWWDA/T/CW/004/2022-2023
ITT 2.3	The reference number of the Contract is - NWWDA/T/CW/004/2022-2023
ITT 2.3	
ITT 2.3	The Information made available on competing firms is as follows: N/A
ITT 2.3	The Information made available on competing firms is as follows: N/A
ITT 2.4	The firms that provided consulting convices for the contract being tendered for area
111 2.4	The firms that provided consulting services for the contract being tendered for are: N/A
ITT 3.1	Maximum number of members in the Joint Venture (JV) shall be: <i>One</i>
B. Conten	ts of Tender Document
8.1	(A) Pre-Tender conference "shall not" take place
	(B) A pre-tender visit of the site of the works shall take place at Masalani Water
	Supply in Masalani town of Ijara Sub-County, Garissa County on 12 <sup>th</sup>
	January,2023 at 10.00 am
ITT 8.2	The Tenderer will submit any questions in writing, to reach the Procuring Entity not later
111 0.2	than 19 <sup>th</sup> January,2023
ITT 8.4	The Procuring Entity's website where Minutes of the pre-Tender meeting site visit will
	be published is www.nwwda.go.ke
ITT 9.1	For Clarification of Tender purposes, for obtaining further information and for purchasing
	tender documents, the Procuring Entity's address is:
	Northern Water Works Development Agency
	Street Address: Maji House, Kismayu Road
	City: Garissa
	ZIP Code: <b>70100</b>
	Country: <b>KENYA</b> info@nwwda.go.ke
	into wud.go.kc
	The request for clarifications should reach the procuring Entity not later 19 <sup>th</sup>
	January,2023
	ation of Tenders
ITP 13.1	The Tenderer shall submit the following additional documents in its Tender: -
(h)	Preliminary Evaluation  MP 1 Conv. of contificate of Posistration/Incorporation
	rejected)
	MR 4- Must fill the form of tender in the format provided and signed by authorized
	person with power of attorney to commit the bid.
	, , , , , , , , , , , , , , , , , , ,
ITT 15.1	Alternative Tenders shall <b>not be</b> considered.
111101	THE THE PORCE SHALL HOW BE CONSIDERED.
	MR 1- Copy of certificate of Registration/Incorporation MR 2 - Copy of Valid tax compliance Certificate MR 3 - Must fill Bill of quantities in format provided (incomplete BOQs will be rejected) MR 4- Must fill the form of tender in the format provided and signed by authorized

ITT Reference	PARTICULARS OF APPENDIX TO INSTRUCTIONS TO TENDERS
ITT 15.2	N/A
ITT 15.4	N/A
ITT 16.5	The prices quoted by the Tenderer shall be: "fixed"
ITT 20.1	The Tender validity period shall be 90 days.
ITT 20.3 (a)	(a) The delayed to exceeding 180 days.
	(b) The Tender price shall be adjusted by the following percentages of the tender price:
	(i) By <b>0%</b> of the local currency portion of the Contract price adjusted to reflect local inflation during the period of extension, and
	(ii) ByN/A% the foreign currency portion of the Contract price adjusted to reflect the international inflation during the period of extension.
ITT 21.1	A Tender Security "shall be" required.
	If a Tender Security shall be required, the amount and currency of the Tender Security shall be Kenya Shillings 600,000.00 valid 30 days beyond the bid validity period(unconditional bank guarantee)
ITT 21.2 (d)	The other Tender Security shall be N/A
ITT 21.5	N/A
ITT 22.1	In addition to the original of the Tender, the number of copies is: One Original and One  Copy
ITT 22.3	The written confirmation of authorization to sign on behalf of the Tenderer shall consist of:  Power of Attorney
D. Submis	ssion and Opening of Tenders
ITT 24.1	(A) For <u>Tender submission purposes</u> only, the Procuring Entity's address is:
	Northern Water Works Development Agency
	Street Address: Maji House, Kismayu Road
	City: Garissa
	ZIP Code: <b>70100</b>
	Country: KENYA
	Procurement Office, Ground Floor, Room A3
	The deadline for Tender Submission is <b>26</b> <sup>th</sup> <b>January</b> , <b>2023 at 11.00 am</b> .  Tenderer shall not have the option of submitting their Tenders Electronically
ITT 27.1	The Tender opening shall take place at the time and the address for Opening of Tenders provided below:

ITT Reference	PARTICULARS OF APPENDIX TO INSTRUCTIONS TO TENDERS
and that	Northern Water Works Development Agency, Po Box 495-70100 Garissa, Maji House, Kismayu Road Conference room, 1st Floor. On 26th January 2023 at 11:30 am
ITT 27.1	N/A
ITT 27.6	The number of representatives of the Procuring Entity to sign is <b>Three</b> (3).
E. Evalua	tion, and Comparison of Tenders
ITT 32.3	The adjustment shall be based on the "highest" price of the item or component as quoted in other substantially responsive Tenders. If the price of the item or component cannot be derived from the price of other substantially responsive Tenders, the Procuring Entity shall use its best estimate.
ITT 35.2	The invitation to tender is extended to the following groups that qualify for Reservations $N/A$ .
ITT 36.1	At this time, the Procuring Entity " <b>DOES NOT INTEND</b> " to execute certain specific parts of the Works by subcontractors selected in advance.
ITT 36.2	Contractor's may propose subcontracting: Maximum percentage of subcontracting permitted is: 10 % of the total contract amount. Tenderers planning to subcontract more than 10% of total volume of work shall specify, in the Form of Tender, the activity (ies) or parts of the Works to be subcontracted along with complete details of the subcontractors and their qualification and experience.
ITT 36.3	The parts of the Works for which the Procuring Entity permits Tenderers to propose Specialized Subcontractors are designated as follows:  a. Construction of Elevated Steel Water Tanks b. Rehabilitation of existing elevated Steel water Tanks c. Masalani Water Supply Intake Pump house electromechanical works For the above-designated parts of the Works that may require Specialized Subcontractors, the relevant qualifications of the proposed Specialized Subcontractors will be added to the qualifications of the Tenderer for the purpose of evaluation.
ITT 37.2 (d)	Additional requirements apply. These are detailed in the evaluation criteria in Section III, Evaluation and Qualification Criteria.
ITT 51.1	The person named to be appointed as Adjudicator is  Eng. Isaac G. Wanjohi. The hourly fee for this proposed Adjudicator shall be: Ksh 25,000/=
ITT 52.2	Other documents required are N/A
ITT 54.1	The procedures for making a Procurement-related Complaints are detailed in the "Regulations" available from the PPRA Website <a href="www.ppra.go.ke">www.ppra.go.ke</a> or email <a href="complaints@ppra.go.ke">complaints@ppra.go.ke</a> . If a Tenderer wishes to make a Procurement-related Complaint, the Tenderer should submit its complaint following these procedures, in writing (by the quickest means available, that is either by hand delivery or email to: For the attention: Andrew Rage Eysimkele  Title/position: Ag. Chief Executive Officer  Procuring Entity: Northern Water Works Development Agency

ITT Reference	PARTICULARS OF APPENDIX TO INSTRUCTIONS TO TENDERS
	Email address: info@nwwda.go.ke
In summary, a Procurement-related Complaint may challenge any of the follow (i) the terms of the Tender Documents; and	
	(ii) the Procuring Entity's decision to award the contract.

#### SECTION III - EVALUATION AND QUALIFICATION CRITERIA

#### 1. General Provisions

Wherever a Tenderer is required to state a monetary amount, Tenderers should indicate the Kenya Shilling equivalent using the rate of exchange determined as follows:

- a) For construction turnover or financial data required for each year Exchange rate prevailing on the last day of the respective calendar year (in which the amounts for that year is to be converted) was originally established.
- b) Value of single contract Exchange rate prevailing on the date of the contract signature.
- c) Exchange rates shall be taken from the publicly available source identified in the ITT 14.3. Any error in determining the exchange rates in the Tender may be corrected by the Procuring Entity.

This section contains the criteria that the Employer shall use to evaluate tender and qualify tenderers. No other factors, methods or criteria shall be used other than specified in this tender document. The Tenderer shall provide all the information requested in the forms included in Section IV, Tendering Forms. The Procuring Entity should use **the Standard Tender Evaluation Document for Goods and Works** for evaluating Tenders.

#### **Evaluation and contract award Criteria**

The Procuring Entity shall use the criteria and methodologies listed in this Section to evaluate tenders and arrive at the Lowest Evaluated Tender. The tender that (i) meets the qualification criteria, (ii) has been determined to be substantially responsive to the Tender Documents, and (iii) is determined to have the Lowest Evaluated Tender price shall be selected for award of contract.

# 2. Preliminary examination for Determination of Responsiveness

The Procuring Entity will start by examining all tenders to ensure they meet in all respects the eligibility criteria and other requirements in the ITT, and that the tender is complete in all aspects in meeting the requirements of "Part 2 – Procuring Entity's Works Requirements", including checking for tenders with unacceptable errors, abnormally low tenders, abnormally high tenders and tenders that are front loaded. The Standard Tender Evaluation Report Document for Goods and Works for evaluating Tenders provides very clear guide on how to deal with review of these requirements. Tenders that do not pass the Preliminary Examination will be considered irresponsive and will not be considered further.

Prior to technical evaluation the tenderer shall be subjected to mandatory preliminary evaluation using the below listed criteria. The evaluation shall be on Responsive/Non Responsive criteria and a tenderer must pass all stated mandatory preliminary requirements in order to proceed to the next stage of technical

evaluation. Any Non Responsive in any criteria shall result in overall FAIL.

MR	DESCRIPTION	Responsive/Non
		Responsive
1	The Tender is signed and by the person with power of attorney, without material deviation, reservation, or omission.	
2	There is a letter granting power of attorney to sign the contract, if so required.	
3	Tenderer is a legally registered entity.	
4	If Tenderer is a JV, it is properly constituted.	
5	Valid Tax Compliance Certificate	
6	A Tender-Securing Declaration/Tender Security as required.	
7	A Tenderer has not participated in more than one Tender, except for permitted alternative tenders	
8	Tenderer has not been debarred by the PPRA or any other recognized institution.	

9	
	Tenderer is a commercially autonomous Kenyan State-owned Enterprise.
10	Tenderer has no conflicts of interest.
11	Tender has met all scope of requirements and specifications without any material deviation, reservation or omission
12	The tenderer is not insolvent, in receivership, bankrupt or in the process of being wound up.
13	The tender is valid for the required number of days.
14	For Kenyan Tenderers, Tenderer is registered with appropriate authority (NCA 5 Water Works and above).

3. **Tender Evaluation** (ITT 35) **Price evaluation**: in addition to the criteria listed in ITT 35.2 (a) – (c) the following

criteria shall apply:

- i) Alternative Completion Times, if permitted under ITT 13.2, will be evaluated as follows: N/A
- **ii**) **Alternative Technical Solutions** for specified parts of the Works, if permitted under ITT 13.4, will be evaluated as follows: N/A
- iii) Other Criteria; if permitted under ITT 35.2(d): N/A

#### 4. Multiple Contracts

Multiple contracts will be permitted in accordance with ITT 35.4. Tenderers are evaluated on basis of Lots and the lowest evaluated tenderer identified for each Lot. The Procuring Entity will select one Option of the two Options listed below for award of Contracts.

#### **OPTION 1**

- i) If a tenderer wins only one Lot, the tenderer will be awarded a contract for that Lot, provided the tenderer meets the Eligibility and Qualification Criteria for that Lot.
- ii) If a tenderer wins more than one Lot, the tender will be awarded contracts for all won Lots, provided the tenderer meets the aggregate Eligibility and Qualification Criteria for all the Lots. The tenderer will be awarded the combination of Lots for which the tenderer qualifies and the others will be considered for award to second lowest the tenderers.

#### OPTION 2

The Procuring Entity will consider all possible combinations of won Lots [contract(s)] and determine the combinations with the lowest evaluated price. Tenders will then be awarded to the Tenderer or Tenderers in the combinations provided the tenderer meets the aggregate Eligibility and Qualification Criteria for all the won Lots.

#### 5. Alternative Tenders (ITT 13.1)

An alternative if permitted under ITT 13.1, will be evaluated as follows:

The Procuring Entity shall consider Tenders offered for alternatives as specified in Part 2- Works Requirements. Only the technical alternatives, if any, of the Tenderer with the Best Evaluated Tender conforming to the basic technical requirements shall be considered by the Procuring Entity.

#### **6. Margin of Preference** is not applicable

#### 7. Post qualification and Contract ward (ITT 39), more specifically,

- a) In case the tender was subject to post-qualification, the contract shall be awarded to the lowest evaluated tenderer, subject to confirmation of pre-qualification data, if so required.
- b) In case the tender was not subject to post-qualification, the tender that has been determined to be the lowest evaluated tenderer shall be considered for contract award, subject to meeting each of the following conditions.
  - i) The Tenderer shall demonstrate that it has access to, or has available, liquid assets, unencumbered

- real assets, lines of credit, and other financial means (independent of any contractual advance pay ment) sufficient to meet the construction cash flow of Kenya Shillings **40,000,000**
- ii) Minimum average annual construction turnover of Kenya Shillings **60,000,000**, equivalent calculated as total certified payments received for contracts in progress and/or completed within three *years*.
- At least **one** of contract(s) of a similar nature executed within Kenya, or the East African Community or abroad, that have been satisfactorily and substantially completed as a prime contractor, or joint venture member or sub-contractor each of minimum value Kenya shillings\_**65**, **000,000** equivalent.
- iv) Contractor's Representative and Key Personnel, which are specified as, below

No.	Position	Minimum Qualifications	Experience in Similar Works (years)
1.	Contractor's Representative / Site Agent- One (1 Nr)	<ul> <li>Degree in Civil or Water Engineering or equivalent or</li> <li>Higher Diploma in Civil or Water Engineering or equivalent or</li> <li>Ordinary Diploma in Civil or Water Engineering</li> </ul>	5
2.	Surveyor- One (1 Nr)	<ul> <li>Diploma in Survey or equivalent</li> </ul>	5
3.	General Foreman (1No)	<ul> <li>Diploma in Civil or Water Engineering and Registration with NCA</li> </ul>	5
4.	Clerk of Works (1 No)	<ul> <li>Diploma in Civil or Water         Engineering and Registration with NCA or     </li> <li>Construction Technician Course and Registration with NCA</li> </ul>	5
5.	Power Plant Mechanic (1)	<ul> <li>Diploma in Mechanical Engineering (Plant Option) and Registration with NCA</li> </ul>	5
6.	Artisan/Plumber - Two (2 Nr)	<ul> <li>Certificate in plumbing and Registration with NCA</li> </ul>	5
7.	Carpenter	<ul> <li>Certificate in Carpentry &amp; Joinery and Registration with NCA</li> </ul>	5

CVs (including academic and professional certificates of proposed Personnel
The Bidder shall provide further details of proposed items of personnel using the relevant Form

v) Contractors key equipment listed on the table below;-

No.	Equipment Type and Characteristics	Minimum Number required
1	Hydraulic Excavator	Two (2)
2	Back hoe Excavator	One (1)
3	Wheeled Shovel/Loader	One (1)
4	HDPE pipe Butt Fusion Equipment	One (1)
5	7 / 10 / 15-ton Tipper Lorry	Two (2)
6	7 / 10 / 15-ton Lorry	One (1)
7	4WD Pick-Up – 1 Ton	One (1)
8	Concrete Mixers (capacity 0.3m³ to1m³)	One (1)

Documentary evidence through logo books containing tenderers name for owned equipment's/ or logo books containing lessee name for leased equipment's- certified by commissioner of oath The Bidder shall provide further details of proposed items of equipment using the relevant Form

vi) Other conditions depending on their seriousness.

#### a) **History of non-performing contracts**:

Tenderer and each member of JV in case the Tenderer is a JV, shall demonstrate that Non-performance of a contract did not occur because of the default of the Tenderer, or the member

of a JV in the last **three years**. The required information shall be furnished in the appropriate form.

#### b) **Pending Litigation**

Financial position and prospective long-term profitability of the Single Tenderer, and in the case the Tenderer is a JV, of each member of the JV, shall remain sound according to criteria established with respect to Financial Capability under Paragraph (i) above if all pending litigation will be resolved against the Tenderer. Tenderer shall provide information on pending litigations in the appropriate form.

#### c) Litigation History

There shall be no consistent history of court/arbitral award decisions against the Tenderer, in the last **three years**. All parties to the contract shall furnish the information in the appropriate form about any litigation or arbitration resulting from contracts completed or ongoing under its execution over the years specified. A consistent history of awards against the Tenderer or any member of a JV may result in rejection of the tender.

**8. OUALIFICATION FORM SUMMARY** 

1	2	3	4	5
item No.	Qualification Subject	Qualification Requirement	Document To be Completed by Tenderer	NWWDA Qualification Assessment- met or Not Met)
1	Nationality	Nationality in accordance with ITT 3.6	Forms ELI – 1.1 and 1.2, with attachments	
2	Tax Obligations for Kenyan Tenderers	Has produced a current tax clearance certificate or tax exemption certificate issued by the Kenya Revenue Authority in accordance with ITT 3.14.	Form of Tender	
3	Conflict of Interest	No conflicts of interest in accordance with ITT 3.3	Form of Tender	
1	PPRA Eligibility	Not having been declared ineligible by the PPRA as described in ITT 3.8	Form of Tender	
5	State- owned Enterprise	Meets conditions of ITT 3.7	Forms ELI – 1.1 and 1.2, with attachments	
5	Goods, equipment and services to be supplied under the contract	To have their origin in any country that is not determined ineligible under ITT 4.1	Forms ELI – 1.1 and 1.2, with attachments	
7	History of Non- Performing Contracts	Non-performance of a contract did not occur as a result of contractor default since 1 <sup>st</sup> January 2019	Form CON-2	
3	Suspension Based on Execution of Tender/Proposal Securing Declaration by the Procuring Entity	Not under suspension based on-execution of a Tender/Proposal Securing Declaration pursuant to ITT 19.9	Form of Tender	
)	Pending Litigation	Tender's financial position and prospective long-term profitability still sound according to criteria established in 3.1 and assuming that all pending litigation will NOT be resolved against the Tenderer.	Form CON – 2	
10	Litigation History	No consistent history of court/arbitral award decisions against the Tenderer since 1st January 2019	Form CON – 2	
11	Financial Capabilities	(i) The Tenderer shall demonstrate that it has access to, or has available, liquid assets, unencumbered real assets, lines of credit, and other financial means (independent of any contractual advance payment) sufficient to meet the construction cash flow requirements estimated as Kenya Shillings 40,000,000 equivalent for the subject contract(s) net of the Tenderer's other commitments.	Form FIN – 3.1, with attachments	
		(ii) The Tenderers shall also demonstrate, to the satisfaction of the Procuring Entity, that it has adequate sources of finance to meet the cash flow requirements on works currently in progress and for future contract commitments.		

	NWWDA Qualification Assessment- met or Not Met)
laws of the Tenderer's country, other financial statements acceptable to the Procuring Entity, for the last <i>three</i> years- 2019,2020, 2021 shall be submitted and must demonstrate the current soundness of the Tenderer's financial position and indicate its prospective long-term profitability.	
Construction Turnover  Shillings 60,000,000 equivalent calculated as total certified payments received for contracts in progress and/or completed within the last <i>three</i> years, divided by <i>three</i> years	
General Construction Experience Experience  Contractor, JV member, sub-contractor, or management contractor for at least the last <i>three</i> years, starting 1 <sup>st</sup> January 2019  Form EXP – 4.1  Form EXP – 4.1	
Specific Construction & Contract Management Experience  A minimum number of one similar contract specified below that have been satisfactorily and substantially completed as a prime contractor, joint venture member, management contract or sub-contractor between 1st  January 2019 and tender submission deadline i.e one contract, each of minimum value Kenya shillings 65,000,000 equivalent.  The similarity of the contracts shall be based on the following:  1. Supply, laying and joining in trench of HDPE pipes of 63-110mm diameter of approximately 10km  2. Construction of Elevated steel tank 100m³  3. Concrete works of approximately 100m³/year  4. Masonry work of at least 200m² per year  5. Fencing with concrete posts and chain-link  The agency will verify the information, if found untrue, it will lead to disqualification of the bid	

# **QUALIFICATION FORMS**

# 1. FORM EQU: EQUIPMENT

The Tenderer shall provide adequate information to demonstrate clearly that it has the capability to meet the requirements for the key equipment listed in Section III, Evaluation and Qualification Criteria. A separate Form shall be prepared for each item of equipment listed, or for alternative equipment proposed by the Tenderer.

Item of equipme	ent	
Equipment information	Name of manufacturer	Model and power rating
	Capacity	Year of manufacture
Current status	Current location	
	Details of current commitments	
Source	Indicate source of the equipment	
	☐ Owned ☐ Rented ☐ Leased	☐ Specially manufactured

Omit the following information for equipment owned by the Tenderer.

Owner	Name of owner	
	Address of owner	
	Telephone	Contact name and title
	Fax	Telex
Agreements	Details of rental / lease / manufacture agreements specific to the project	

# 2. FORM PER-1

# $Contractor's \, Representative \, and \, Key \, Personnel \, Schedule$

Tenderers should provide the names and details of the suitably qualified Contractor's Representative and Key Personnel to perform the Contract. The data on their experience should be supplied using the Form PER-2 below for each candidate.

#### **Contractor' Representative and Key Personnel**

1.	Title of position: Contractor's Representative		
	Name of candidate:		
	<b>Duration of</b>	[insert the whole period (start and end dates) for which this position will be	
	appointment:	engaged]	
	Time commitment: for	[insert the number of days/week/months/ that has been scheduled for this	
	this position:	position]	
	<b>Expected time schedule</b>	[insert the expected time schedule for this position (e.g. attach high level Gantt	
	for this position:	chart]	
2.	Title of position: [		
	Name of candidate:		
	<b>Duration of</b>	[insert the whole period (start and end dates) for which this position will be	
	appointment:	engaged]	
	Time commitment: for	[insert the number of days/week/months/ that has been scheduled for this	
	this position:	position]	
	<b>Expected time schedule</b>	[insert the expected time schedule for this position (e.g. attach high level Gantt	
	for this position:	chart]	
3.	Title of position: [	]	
	Name of candidate:		
	<b>Duration of</b>	[insert the whole period (start and end dates) for which this position will be	
	appointment:	engaged]	
	Time commitment: for	[insert the number of days/week/months/ that has been scheduled for this	
	this position:	position]	
	<b>Expected time schedule</b>	[insert the expected time schedule for this position (e.g. attach high level Gantt	
	for this position:	chart]	
4.	Title of position: []		
	Name of candidate:		
	<b>Duration of</b>	[insert the whole period (start and end dates) for which this position will be	
	appointment:	engaged]	
	Time commitment: for	[insert the number of days/week/months/ that has been scheduled for this	
	this position:	position]	
	<b>Expected time schedule</b>	[insert the expected time schedule for this position (e.g. attach high level Gantt	
	for this position:	chart]	
5.	Title of position: [insert title]		
	Name of candidate		
	<b>Duration of</b>	[insert the whole period (start and end dates) for which this position will be	
	appointment:	engaged]	
	Time commitment: for	[insert the number of days/week/months/ that has been scheduled for this	
	this position:	position]	
	<b>Expected time schedule</b>	[insert the expected time schedule for this position (e.g. attach high level Gantt	
	for this position:	chart]	

# 3. **FORM PER-2:**

Resume and Declaration - Contractor's Representative and Key Personnel.

Summarize professional experience in reverse chronological order. Indicate particular technical and managerial experience relevant to the project.

Name of Tenderer	
Position [#1]: [title of position from Form PER-1]	

Position [#1]:	[title of position from Form PE.	R-1]	
Personnel information	Name:	Date of birth:	
	Address:	E-mail:	
	Professional qualifications:		
Academic qualifications:			
	Language proficiency: [language	uage and levels of speaking, reading and writing skills]	
Details			
	Address of Procuring Entity:		
	Telephone:	Contact (manager / personnel officer):	
	Fax:		
	Job title:	Years with present Procuring Entity:	

Summarize professional experience in reverse chronological order. Indicate particular technical and managerial experience relevant to the project.

Project	Role	Duration of involvement	Relevant experience
[main project details]	[role and responsibilities on the project]	[time in role]	[describe the experience relevant to this position]

#### **Declaration**

I, the undersigned [insert either "Contractor's Representative" or "Key Personnel" as applicable], certify that to the best of my knowledge and belief, the information contained in this Form PER-2 correctly describes myself, my qualifications and my experience.

I confirm that I am available as certified in the following table and throughout the expected time schedule for this position as provided in the Tender:

Commitment	Details
Commitment to duration of contract:	[insert period (start and end dates) for which this
	Contractor's Representative or Key Personnel is available
	to work on this contract]
Time commitment:	[insert period (start and end dates) for which this
	Contractor's Representative or Key Personnel is available
	to work on this contract]

I understand that any misrepresentation or omission in this Form may:

- a) be taken into consideration during Tender evaluation;
- b) result in my disqualification from participating in the Tender;
- c) result in my dismissal from the contract.

Name of Contractor's Representative or Key Personnel: [insert name]		
Signature:		
Date: (day month year):	Countersignature	
of authorized representative of the Tenderer:		
Signature:	Date: (day month	
vear):		

# 4. TENDERER'S QUALIFICATION WITHOUT PRE-QUALIFICATION

To establish its qualifications to perform the contract in accordance with Section III, Evaluation and Qualification Criteria the Tenderer shall provide the information requested in the corresponding Information Sheets included hereunder.

#### 4.1 FORM ELI -1.1

Tenderer Information Form
Date:
ITT No. and title:
Tenderer's name
In case of Joint Venture (JV), name of each member:
Tenderer's actual or intended country of registration:
[indicate country of Constitution]
Tenderer's actual or intended year of incorporation:
Tenderer's legal address [in country of registration]:
Tenderer's authorized representative information
Name:
Address:
l'elephone/Fax numbers:
E-mail address:
1. Attached are copies of original documents of
☐ Articles of Incorporation (or equivalent documents of constitution or association), and/or
documents of registration of the legal entity named above, in accordance with ITT 3.6
☐ In case of JV, letter of intent to form JV or JV agreement, in accordance with ITT 3.5
☐ In case of state-owned enterprise or institution, in accordance with ITT 3.8, documents
establishing:
Legal and financial autonomy
Operation under commercial law
<ul> <li>Establishing that the Tenderer is not under the supervision of the Procuring Entity</li> </ul>
2. Included are the organizational chart, a list of Board of Directors, and the beneficial ownership.

#### **4.2 FORM ELI -1.2**

# **Tenderer's JV Information Form** (to be completed for each member of Tenderer's JV) Date: ITT No. and title: \_\_\_\_\_ Tenderer's JV name: JV member's name: JV member's country of registration: JV member's year of constitution: JV member's legal address in country of constitution: JV member's authorized representative information Name: Address: Telephone/Fax numbers: E-mail address: \_ 1. Attached are copies of original documents of ☐ Articles of Incorporation (or equivalent documents of constitution or association), and/or registration documents of the legal entity named above, in accordance with ITT 3.6. ☐ In case of a state-owned enterprise or institution, documents establishing legal and financial autonomy, operation in accordance with commercial law, and that they are not under the supervision of the Procuring Entity, in accordance with ITT 3.8. 2. Included are the organizational chart, a list of Board of Directors, and the beneficial ownership.

# 4.3 <u>FORM CON – 2</u>

as indicated below.

# Historical Contract Non-Performance, Pending Litigation and Litigation History

Tendere	r's Name:		
Date:			
JV Men	nber's Name		
ITT No.	and title:		
Non-Pei	rformed Contracts in	accordance with Section III, Evaluation and Qualification C	riteria
		nance did not occur since 1st January [insert year] specified in	
Evaluati	ion and Qualification	Criteria, Sub-Factor 2.1.	·
	_		
	Contract(s) not perfo	ormed since 1st January [insert year] specified in Section III, 1	Evaluation and
Qualific	ation Criteria, require	ement 2.1	
Year		Contract Identification	Total Contract
	portion of		Amount (current
	contract		value, currency,
			exchange rate and
			Kenya Shilling
			equivalent)
[insert	[insert amount	Contract Identification: [indicate complete contract name/	[insert amount]
year]	and percentage]	number, and any other identification]	
		Name of Procuring Entity: [insert full name]	
		Address of Procuring Entity: [insert street/city/country]	
		Reason(s) for nonperformance: [indicate main reason(s)]	
Pending	Litigation, in accorda	nce with Section III, Evaluation and Qualification Criteria	
		in accordance with Section III, Evaluation and Qualification	n Criteria, Sub-
Factor 2	2.3.		
	Pending litigation in a	accordance with Section III, Evaluation and Qualification Crit	eria, Sub-Factor 2.3
as indica	ated below.		
·			

Year of dispute	Amount in dispute (currency)	Contract Identification	Total Contract Amount (currency), Kenya Shilling Equivalent (exchange rate)
		Contract Identification:	
		Name of Procuring Entity:	
		Address of Procuring Entity:	_
		Matter in dispute:	
		Party who initiated the dispute:	
		Status of dispute:	
		Contract Identification:	
Name of Procuring Entity: Address of Procuring Entity:			
		Matter in dispute:	
Party who initiated the dispute:			
		Status of dispute:	
Litigation H	listory in accordance with S	Section III, Evaluation and Qualification Cri	iteria
□ No 2.4.	Litigation History in accor	dance with Section III, Evaluation and Quali	fication Criteria, Sub-Factor
□ Liti	gation History in accordance	e with Section III, Evaluation and Qualificat	ion Criteria, Sub-Factor 2.4

Year of award	Outcome as percentage of Net Worth	Contract Identification	Total Contract Amount (currency), Kenya Shilling Equivalent (exchange rate)
[insert year]	[insert percentage]	Contract Identification: [indicate complete contract name, number, and any other identification]  Name of Procuring Entity: [insert full name]  Address of Procuring Entity: [insert street/city/country]  Matter in dispute: [indicate main issues in dispute]  Party who initiated the dispute: [indicate "Procuring Entity" or "Contractor"]  Reason(s) for Litigation and award decision [indicate main reason(s)]	[insert amount]

#### 4.4 **FORM FIN – 3.1:**

Tenderer's Name:

#### **Financial Situation and Performance**

Date:	
JV Member's Name	
ITT No. and title:	
4.4.1. Financial Data	
Type of Financial information	Historic information for previousyears,
in (currency)	(amount in currency, currency, exchange rate*, USI

D equivalent) Year 2 Year 3 Year 4 Year 5 Year 1 Statement of Financial Position (Information from Balance Sheet) Total Assets (TA) Total Liabilities (TL) Total Equity/Net Worth (NW) Current Assets (CA) Current Liabilities (CL) Working Capital (WC) Information from Income Statement Total Revenue (TR) Profits Before Taxes (PBT) Cash Flow Information Cash Flow from Operating Activities

<sup>\*</sup>Refer to ITT 15 for the exchange rate

#### **4.4.2** Sources of Finance

Specify sources of finance to meet the cash flow requirements on works currently in progress and for future contract commitments.

No.	Source of finance	Amount (Kenya Shilling equivalent)
1		
2		
3		

#### 4.4.3 Financial documents

The Tenderer and its parties shall provide copies of financial statements for three (3) years pursuant to Section III, Evaluation and Qualifications Criteria, Sub-factor 3.1. The financial statements shall:

- (a) reflect the financial situation of the Tenderer or in case of JV member, and not an affiliated entity (such as parent company or group member).
- (b) be independently audited or certified in accordance with local legislation.
- (c) be complete, including all notes to the financial statements.
- (d) correspond to accounting periods already completed and audited.
- Attached are copies of financial statements<sup>1</sup> for the 2018-2019,2019-2020,2020-2021 years required above; and complying with the requirements

\_

<sup>&</sup>lt;sup>1</sup> If the most recent set of financial statements is for a period earlier than 12 months from the date of Tender, the reason for this should be justified.

#### 4.5 **FORM FIN – 3.2:**

#### **Average Annual Construction Turnover**

Tenderer's Name:	
Date:	
JV Member's Name	
ITT No. and title:	

Annual turnover data (construction only)						
Year	Amount Currency	Exchange rate	Kenya Shilling equivalent			
[indicate year]	[insert amount and indicate currency]					
Average						
Annual Construction						
Turnover *						

<sup>\*</sup> See Section III, Evaluation and Qualification Criteria, Sub-Factor 3.2.

# 4.6 **FORM FIN – 3.3**:

#### **Financial Resources**

Specify proposed sources of financing, such as liquid assets, unencumbered real assets, lines of credit, and other financial means, net of current commitments, available to meet the total construction cash flow demands of the subject contract or contracts as specified in Section III, Evaluation and Qualification Criteria

Fina	Financial Resources					
No.	Source of financing	Amount (Kenya Shilling equivalent)				
1						
2						
3						

# 4.7 **FORM FIN – 3.4:**

#### **Current Contract Commitments / Works in Progress**

Tenderers and each member to a JV should provide information on their current commitments on all contracts that have been awarded, or for which a letter of intent or acceptance has been received, or for contracts approaching completion, but for which an unqualified, full completion certificate has yet to be issued.

	Current Co	Average Monthly			
	Name of Contract	Procuring Entity's Contact Address, Tel,	[Current Kenya Shilling /month Equivalent]	Completion Date	Invoicing Over Last Six Months [Kenya Shilling /month)]
1					
2					
3					
4					
5					

# 4.8 **FORM EXP - 4.1**

# **General Construction Experience**

Tenderer: \_

Address:

Amount of contract: \_\_\_\_\_\_ Name of Procuring Entity: \_\_\_

Date:	, NT		
ITT No. ar	nd title:		
Page		_ofpages	
Starting	Ending Year	Contract Identification	Role of Tenderer
Year			
		Contract name:	
		Brief Description of the Works performed by the	
		Tenderer:	
		Amount of contract:	
		Name of Procuring Entity:	
		Address:	
		Contract name:	
		Brief Description of the Works performed by the	
		Tenderer:	
		Amount of contract:	
		Name of Procuring Entity:	
		Address:	
		Contract name:	
		Brief Description of the Works performed by the	

# 4.9 **FORM EXP - 4.2(a)**

#### **Specific Construction and Contract Management Experience**

Tenderer's Name:							
Date:	ate:						
JV Member's Name							
ITT No. and title:							
Similar Contract No.	Information						
Contract Identification							
Award date							
Completion date							
Role in Contract	Prime Contractor □	Member in JV □	Management Contractor □	Sub- contractor			
Total Contract Amount			Kenya Shilling				
If member in a JV or sub-contractor, specify participation in total Contract amount							
Procuring Entity's Name:		-					
Address: Telephone/fax number E-mail:							
E-man.							

# 4.10 FORM EXP - 4.2 (a) (cont.)

## **Specific Construction and Contract Management Experience (cont.)**

Simila	ar Contract No.	Information
Descri	ption of the similarity in accordance	
with S	ub-Factor 4.2(a) of Section III:	
1.	Amount	
2.	Physical size of required works	
items	-	
3.	Complexity	
4.	Methods/Technology	
5.	Construction rate for key activities	
6.	Other Characteristics	

# 4.11 **FORM EXP - 4.2(b)**

# **Construction Experience in Key Activities**

Tenderer's Name:					
Date:					
Tenderer's JV Member Name:					
Sub-contractor's Name <sup>2</sup> (as per ITT 34): ITT No. and title:		_			
11 1 No. and title:	_				
All Sub-contractors for key activities mu	-	e info	ormation in	this form as	per ITT 34 and
Evaluation and Qualification Criteria, S	ub-Factor 4.2.				
1. Key Activity No One: _					
	Information				
Contract Identification		_			
Award date					
Completion date					
Role in Contract		Mem JV □		Management Contractor □	Sub-contractor
Total Contract Amount				Kenya Shillin	g
Quantity (Volume, number or rate of	Total quantity i	in	Percentage	1	Actual
production, as applicable) performed under			participatio	on	Quantity
the contract per year or part of the year	(i)		(ii)		Performed (i) x (ii)
Year 1					
Year 2					
Year 3					
Year 4					
Procuring Entity's Name:					
Address:					
Telephone/fax number E-mail:					

<sup>&</sup>lt;sup>2</sup> If applicable

	Information
Description of the key activities in accordance with Sub-Factor 4.2(b) of Section III:	

2.	Activity	No.	Two
2			

#### 5. <u>FORM OF TENDER – (bidder Letter head must)</u>

#### INSTRUCTIONS TO TENDERERS

- i) The Tenderer must prepare this Form of Tender on stationery with its letterhead clearly showing the Tenderer's complete name and business address.
- ii) All italicized text is to help Tenderer in preparing this form.
- *Tenderer must complete and sign CERTIFICATE OF INDEPENDENT TENDER DETERMINATION and the SELF DECLARATION OF THE TENDERER attached to this Form of Tender.*
- *iv)* The Form of Tender shall include the following Forms duly completed and signed by the Tenderer.
  - Tenderer's Eligibility- Confidential Business Questionnaire
  - Certificate of Independent Tender Determination
  - Self-Declaration of the Tenderer

Date of this Tender submission:	[insert date	(as day, month and	year) c	of Tender submission [
---------------------------------	--------------	--------------------	---------	------------------------

**Request for Tender No.:** [insert identification]

Name and description of Tender [Insert as per ITT]

**Alternative No.:** [insert identification No if this is a Tender for an alternative]

**To:** [insert complete name of Procuring Entity] Dear Sirs,

<i>!</i> .	In accordance with the Conditions of Contract, Specifications, Drawings and Bills of Quantities for the execution of the above named Works, we, the undersigned offer to construct and complete the Works and remedy any defects therein for the sum of Kenya Shillings [[Amount in figures] Kenya Shillings [amount in words]
	The above amount includes foreign currency amount (s) of [state figure or a percentage and currency] [figures]
	The percentage or amount quoted above does not include provisional sums, and only allows not more than two foreign currencies.
2.	We undertake, if our tender is accepted, to commence the Works as soon as is reasonably possible after the receipt of the Project Manager's notice to commence, and to complete the whole of the Works comprised in the Contract within the time stated in the Special Conditions of Contract.
3.	We agree to adhere by this tender until[Insert date], and it shall remain binding upon us and may be accepted at any time before that date.

- 4. Unless and until a formal Agreement is prepared and executed this tender together with your written acceptance thereof, shall constitute a binding Contract between us. We further understand that you are not bound to accept the lowest or any tender you may receive.
- 5. We, the undersigned, further declare that:
  - i) <u>No reservations</u>: We have examined and have no reservations to the tender document, including Addenda issued in accordance with ITT 28:
  - ii) <u>Eligibility:</u> We meet the eligibility requirements and have no conflict of interest in accordance with ITT 3 and 4:
  - iii) <u>Tender-Securing Declaration</u>: We have not been suspended nor declared ineligible by the Procuring Entity based on execution of a Tender-Securing or Proposal-Securing Declaration in the Procuring Entity's Country in accordance with ITT 19.8;
  - *Conformity:* We offer to execute in conformity with the tendering documents and in accordance with the implementation and completion specified in the construction schedule, the following Works: [insert a brief description of the Works];
  - v) Tender Price: The total price of our Tender, excluding any discounts offered in item 1 above is: [Insert one of

vi Option 1, in case of one lot: Total price is: [insert the total price of the Tender in words and figures, indicating the various amounts and the respective currencies]; Or

#### Option 2, in case of multiple lots:

- a) Total price of each lot [insert the total price of each lot in words and figures, indicating the various amounts and the respective currencies]; and
- b) <u>Total price of all lots</u> (sum of all lots) [insert the total price of all lots in words and figures, indicating the various amounts and the respective currencies];
- vii) <u>Discounts:</u> The discounts offered and the methodology for their application are:
- viii) The discounts offered are: [Specify in detail each discount offered.]
- ix) The exact method of calculations to determine the net price after application of discounts is shown below: [Specify in detail the method that shall be used to apply the discounts];
- x) <u>Tender Validity Period</u>: Our Tender shall be valid for the period specified in TDS 18.1 (as amended, if applicable) from the date fixed for the Tender submission deadline specified in TDS 22.1 (as amended, if applicable), and it shall remain binding upon us and may be accepted at any time before the expiration of that period;
- xi) <u>Performance Security:</u> If our Tender is accepted, we commit to obtain a Performance Security in accordance with the Tendering document;
- xii) <u>One Tender Per Tender</u>: We are not submitting any other Tender(s) as an individual Tender, and we are not participating in any other Tender(s) as a Joint Venture member or as a subcontractor, and meet the requirements of ITT 3.4, other than alternative Tenders submitted in accordance with ITT 13.3;
- xiii) <u>Suspension and Debarment</u>: We, along with any of our subcontractors, suppliers, Project Manager, manufacturers, or service providers for any part of the contract, are not subject to, and not controlled by any entity or individual that is subject to, a temporary suspension or a debarment imposed by the Public Procurement Regulatory Authority or any other entity of the Government of Kenya, or any international organization.
- xiv) <u>State-owned enterprise or institution:</u> [select the appropriate option and delete the other] [We are not a state-owned enterprise or institution] / [We are a state-owned enterprise or institution but meet the requirements of ITT 3.8];
- xv) <u>Commissions, gratuities, fees</u>: We have paid, or will pay the following commissions, gratuities, or fees with respect to the tender process or execution of the Contract: [insert complete name of each Recipient, its full address, the reason for which each commission or gratuity was paid and the amount and currency of each such commission or gratuity].

Name of Recipient	Address	Reason	Amount

(If none has been paid or is to be paid, indicate "none.")

- xvi) <u>Binding Contract</u>: We understand that this Tender, together with your written acceptance thereof included in your Letter of Acceptance, shall constitute a binding contract between us, until a formal contract is prepared and executed;
- xvii) Not Bound to Accept: We understand that you are not bound to accept the lowest evaluated cost Tender, the Most Advantageous Tender or any other Tender that you may receive;
- xviii) <u>Fraud and Corruption:</u> We hereby certify that we have taken steps to ensure that no person acting for us or on our behalf engages in any type of Fraud and Corruption;
- xix) <u>Collusive practices</u>: We hereby certify and confirm that the tender is genuine, non-collusive and made with the intention of accepting the contract if awarded. To this effect we have signed the "Certificate of Independent Tender Determination" attached below.

xx)	Dispo	ndertake to adhere by the Code of Ethics for Persons Participating in Public Procurement and Asset osal, copy available from(specify website) during the procurement process and the ation of any resulting contract.
xxi)	We, th	ne Tenderer, have completed fully and signed the following Forms as part of our Tender:
	a)	Tenderer's Eligibility; Confidential Business Questionnaire – to establish we are not in any conflict to interest.
	b)	Certificate of Independent Tender Determination – to declare that we completed the tender without colluding with other tenderers.
	c)	Self-Declaration of the Tenderer – to declare that we will, if awarded a contract, not engage in any form of fraud and corruption.
	d)	Declaration and commitment to the Code of Ethics for Persons Participating in Public Procurement and Asset Disposal
		confirm that we have read and understood the full content and scope of fraud and corruption as "Appendix 1- Fraud and Corruption" attached to the Form of Tender.
Nam	e of th	e Tenderer: *[insert complete name of person signing the Tender]
		e person duly authorized to sign the Tender on behalf of the Tenderer: **[insert complete name aly authorized to sign the Tender]
Title	of the	person signing the Tender: [insert complete title of the person signing the Tender]
Signa	ture o	of the person named above: [insert signature of person whose name and capacity are shown
above	e] Date	e signed [insert date of signing] day of [insert month], [insert year]

#### Notes

Date signed\_\_\_\_\_\_,\_\_\_\_,

<sup>\*</sup> In the case of the Tender submitted by joint venture specify the name of the Joint Venture as Tenderer \*\* Person signing the Tender shall have the power of attorney given by the Tenderer to be attached with the Tender.

#### A. <u>TENDERER'S ELIGIBILITY- CONFIDENTIAL BUSINESS QUESTIONNAIRE</u>

#### **Instruction to Tenderer**

Tender is instructed to complete the particulars required in this Form, *one form for each entity if Tender is a JV*. Tenderer is further reminded that it is an offence to give false information on this Form.

#### (a) Tenderer's details

	ITEM	DESCRIPTION
1	Name of the Procuring Entity	
2	Reference Number of the Tender	
3	Date and Time of Tender Opening	
4	Name of the Tenderer	
5	Full Address and Contact Details of the Tenderer.	<ol> <li>Country</li> <li>City</li> <li>Location</li> <li>Building</li> <li>Floor</li> <li>Postal Address</li> <li>Name and email of contact person.</li> </ol>
6	Current Trade License Registration Number and Expiring date	
7	Name, country and full address (postal and physical addresses, email, and telephone number) of Registering Body/Agency	
8	Description of Nature of Business	
9	Maximum value of business which the Tenderer handles.	
10	State if Tenders Company is listed in stock	
	exchange, give name and full address (postal	
	and physical addresses, email, and telephone	
	number) of	
	state which stock exchange	

#### **General and Specific Details**

b)

 . C 11			

Name in full	Age	Nationality_
	Country of Origin	Citizenship
		· —

c) **Partnership,** provide the following details.

**Sole Proprietor,** provide the following details.

	Names of Partners	Nationality	Citizenship	% Shares owned
1				
2				
3				

d)	Registered Company, provide the following details.		
	i)	Private or public Company	
	ii)	State the nominal and issued capital of the Company	

(Equivalent)

iii) Give details of Directors as follows.

	Names of Director	Nationality	Citizenship	% Shares owned
1				
2				
3				

## (e) DISCLOSURE OF INTEREST- Interest of the Firm in the Procuring Entity.

i)	Are there any person/persons in	. (Name of Procurin	ig Entity) who has/	have an interest
	or relationship in this firm? Yes/No			

If yes, provide details as follows.

	Names of Person	<b>Designation in the Procuring Entity</b>	Interest or Relationship with Tenderer
1			
2			
3			

# ii) Conflict of interest disclosure

	Type of Conflict	Disclosure YES OR NO	If YES provide details of the relationship with Tenderer
1	Tenderer is directly or indirectly controls, is controlled by or		
	is under common control with another tenderer.		
2	Tenderer receives or has received any direct or indirect		
	subsidy from another tenderer.		
3	Tenderer has the same legal representative as another tenderer		
4	Tender has a relationship with another tenderer, directly or		
	through common third parties that puts it in a position to		
	influence the tender of another tenderer, or influence the		
	decisions of the Procuring Entity regarding this tendering process.		
5	Any of the Tenderer's affiliates participated as a consultant in		
	the preparation of the design or technical specifications of the		
	works that are the subject of the tender.		
6	Tenderer would be providing goods, works, non-consulting		
	services or consulting services during implementation of the		
	contract specified in this Tender Document.		
7	Tenderer has a close business or family relationship with a		
	professional staff of the Procuring Entity who are directly or		
	indirectly involved in the preparation of the Tender		
	document or specifications of the Contract, and/or the		
	Tender evaluation process of such contract.		
8	Tenderer has a close business or family relationship with a		
	professional staff of the Procuring Entity who would be		
	involved in the implementation or supervision of the such		
	Contract.		
9	Has the conflict stemming from such relationship stated in		
	item 7 and 8 above been resolved in a manner acceptable to		
	the Procuring Entity throughout the tendering process and		
	execution of the Contract.		

On behalf of the Tenderer, I certify that the information given above is complete, current and accurate as at the submission.	e date of
Full Name	Title or
Designation	<u> </u>

(Date)

Certification

(Signature)

f)

# B. CERTIFICATE OF INDEPENDENTIENDER DETERMINATION

	undersigned, in submitting the accompanying Letter of Tender to theuring Entity] for:	DY 1 1 C. 1 3 1				
respo	onse to the request for tenders made by:	[Name of Tenderer] do hereby				
make	the following statements that I certify to be true and complete in every respec	ct:				
Icert	ify, on behalf of []	Name of Tenderer] that:				
1.	I have read and I understand the contents of this Certificate;					
2.	I understand that the Tender will be disqualified if this Certificate is found respect;	I not to be true and complete in every				
3.	I am the authorized representative of the Tenderer with authority to sign this on behalf of the Tenderer;	s Certificate, and to submit the Tender				
4.	For the purposes of this Certificate and the Tender, I understand that the word "competitor" shall include individual or organization, other than the Tenderer, whether or not affiliated with the Tenderer, who:  a) has been requested to submit a Tender in response to this request for tenders;  b) could potentially submit a tender in response to this request for tenders, based on their qualification abilities or experience;					
5.	<ul> <li>The Tenderer discloses that [check one of the following, as applicable:</li> <li>a) The Tenderer has arrived at the Tender independently from, and wi agreement or arrangement with, any competitor;</li> <li>b) the Tenderer has entered into consultations, communications, agr more competitors regarding this request for tenders, and the document(s), complete details thereof, including the names of the reasons for, such consultations, communications, agreements or arrangement.</li> </ul>	reements or arrangements with one or Tenderer discloses, in the attached ne competitors and the nature of, and				
6.	In particular, without limiting the generality of paragraphs (5)(a) or (5)(b) a communication, agreement or arrangement with any competitor regarding: a) prices; b) methods, factors or formulas used to calculate prices; c) the intention or decision to submit, or not to submit, a tender; or d) the submission of a tender which does not meet the specifications of specifically disclosed pursuant to paragraph (5)(b) above;					
7.	In addition, there has been no consultation, communication, agreement or arrangement with any compet regarding the quality, quantity, specifications or delivery particulars of the works or services to which this required for tenders relates, except as specifically authorized by the procuring authority or as specifically disclopursuant to paragraph (5)(b) above;					
8.	the terms of the Tender have not been, and will not be, knowingly disclosed any competitor, prior to the date and time of the official tender opening whichever comes first, unless otherwise required by law or as specifically above.	g, or of the awarding of the Contract,				
	Name	Title_ Date				

#### C. <u>SELF - DECLARATION FORMS</u>

#### FORM SD1

(Date)

(Signature)

Bidder Official Stamp

# FORM SD2

# SELF DECLARATION THAT THE PERSON/TENDERER WILL NOT ENGAGE IN ANY CORRUPT OR FRAUDULENT PRACTICE

I,	of P. O. Box being a resident of in the Republic of do hereby make a statement as follows: -	
1.	THAT I am the Chief Executive/Managing Director/Principal Officer/Director of	for
2.	THAT the aforesaid Bidder, its servants and/or agents /subcontractors will not engage in any corrupt or frau practice and has not been requested to pay any inducement to any member of the Board, Management, Staff employees and/or agents of (insert name of the Procuring entity) which is the procentity.	and/or
3.	THAT the aforesaid Bidder, its servants and/or agents /subcontractors have not offered any inducement member of the Board, Management, Staff and/or employees and/or agents of	
4.	THAT the aforesaid Bidder will not engage /has not engaged in any corrosive practice with other b participating in the subject tender	idders
5.	THAT what is deponed to herein above is true to the best of my knowledge information and belief.	
	(Title) (Signature) (Date)	
	Bidder's Official Stamp	

# DECLARATION AND COMMITMENT TO THE CODE OF ETHICS

Company/Firm)	
contents of the Public Procurement & Asset Disposal Act, participating in Public Procurement and Asset Disposal and r	2015, Regulations and the Code of Ethics for persons
I do hereby commit to abide by the provisions of the Code of Et Asset Disposal.	hics for persons participating in Public Procurement and
Name of Authorized signatory	Sign
Position.	
Office address.	Гelephone
E-mail	
Name of the Firm/Company	
Date	(Company Seal/ Rubber
Stamp where applicable)	
Witness	
Name	Sign
Date	

#### D. APPENDIX 1- FRAUD AND CORRUPTION

(Appendix 1 shall not be modified)

#### 1. Purpose

2. The Government of Kenya's Anti-Corruption and Economic Crime laws and their sanction's policies and procedures, Public Procurement and Asset Disposal Act (no. 33 of 2015) and its Regulation, and any other Kenya's Acts or Regulations related to Fraud and Corruption, and similar offences, shall apply with respect to Public Procurement Processes and Contracts that are governed by the laws of Kenya.

#### 3. Requirements

The Government of Kenya requires that all parties including Procuring Entities, Tenderers, (applicants/proposers), Consultants, Contractors and Suppliers; any Sub-contractors, Sub-consultants, Service providers or Suppliers; any Agents (whether declared or not); and any of their Personnel, involved and engaged in procurement under Kenya's Laws and Regulation, observe the highest standard of ethics during the procurement process, selection and contract execution of all contracts, and refrain from Fraud and Corruption and fully comply with Kenya's laws and Regulations as per paragraphs 1.1 above.

Kenya's public procurement and asset disposal act (no. 33 of 2015) under Section 66 describes rules to be followed and actions to be taken in dealing with Corrupt, Coercive, Obstructive, Collusive or Fraudulent practices, and Conflicts of Interest in procurement including consequences for offences committed. A few of the provisions noted below highlight Kenya's policy of no tolerance for such practices and behavior: -

- 1) a person to whom this Act applies shall not be involved in any corrupt, coercive, obstructive, collusive or fraudulent practice; or conflicts of interest in any procurement or asset disposal proceeding;
- 2) A person referred to under subsection (1) who contravenes the provisions of that sub-section commits an offence;
- 3) Without limiting the generality of the subsection (1) and (2), the person shall be:
  - a) disqualified from entering into a contract for a procurement or asset disposal proceeding; or
  - b) if a contract has already been entered into with the person, the contract shall be voidable;
- 4) The voiding of a contract by the procuring entity under subsection (7) does not limit any legal remedy the procuring entity may have;
- 5) An employee or agent of the procuring entity or a member of the Board or committee of the procuring entity who has a conflict of interest with respect to a procurement:
  - a) shall not take part in the procurement proceedings;
  - b) shall not, after a procurement contract has been entered into, take part in any decision relating to the procurement or contract; and
- c) shall not be a subcontractor for the bidder to whom was awarded contract, or a member of the group of bidders to whom the contract was awarded, but the subcontractor appointed shall meet all the requirements of this Act.
- 6) An employee, agent or member described in subsection (1) who refrains from doing anything prohibited under that subsection, but for that subsection, would have been within his or her duties shall disclose the conflict of interest to the procuring entity;
- 7) If a person contravenes subsection (1) with respect to a conflict of interest described in subsection (5)(a) and the contract is awarded to the person or his relative or to another person in whom one of them had a direct or indirect pecuniary interest, the contract shall be terminated and all costs incurred by the public entity shall be made good by the awarding officer. Etc.

In compliance with Kenya's laws, regulations and policies mentioned above, the Procuring Entity:

- a) Defines broadly, for the purposes of the above provisions, the terms set forth below as follows:
  - i) "corrupt practice" is the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence improperly the actions of another party;
  - ii) "fraudulent practice" is any act or omission, including misrepresentation, that knowingly or recklessly misleads, or attempts to mislead, a party to obtain financial or other benefit or to avoid an obligation;

- iii) "collusive practice" is an arrangement between two or more parties designed to achieve an improper purpose, including to influence improperly the actions of another party;
- iv) "coercive practice" is impairing or harming, or threatening to impair or harm, directly or indirectly, any party or the property of the party to influence improperly the actions of a party;
- v) "obstructive practice" is:
  - deliberately destroying, falsifying, altering, or concealing of evidence material to the
    investigation or making false statements to investigators in order to materially impede
    investigation by Public Procurement Regulatory Authority (PPRA) or any other appropriate
    authority appointed by Government of Kenya into allegations of a corrupt, fraudulent, coercive,
    or collusive practice; and/or threatening, harassing, or intimidating any party to prevent it from
    disclosing its knowledge of matters relevant to the investigation or from pursuing the
    investigation; or
  - acts intended to materially impede the exercise of the PPRA's or the appointed authority's inspection and audit rights provided for under paragraph 2.3 e. below.
- b) Defines more specifically, in accordance with the above procurement Act provisions set forth for fraudulent and collusive practices as follows:
  - "fraudulent practice" includes a misrepresentation of fact in order to influence a procurement or disposal process or the exercise of a contract to the detriment of the procuring entity or the tenderer or the contractor, and includes collusive practices amongst tenderers prior to or after tender submission designed to establish tender prices at artificial non-competitive levels and to deprive the procuring entity of the benefits of free and open competition.
- c) Rejects a proposal for award¹ of a contract if PPRA determines that the firm or individual recommended for award, any of its personnel, or its agents, or its sub-consultants, sub-contractors, service providers, suppliers and/ or their employees, has, directly or indirectly, engaged in corrupt, fraudulent, collusive, coercive, or obstructive practices in competing for the contract in question;
- d) Pursuant to the Kenya's above stated Acts and Regulations, may sanction or recommend to appropriate authority (ies) for sanctioning and debarment of a firm or individual, as applicable under the Acts and Regulations;
- e) Requires that a clause be included in Tender documents and Request for Proposal documents requiring (i) Tenderers (applicants/proposers), Consultants, Contractors, and Suppliers, and their Sub-contractors, Sub-consultants, Service providers, Suppliers, Agents personnel, permit the PPRA or any other appropriate authority appointed by Government of Kenya to inspect<sup>2</sup> all accounts, records and other documents relating to the procurement process, selection and/or contract execution, and to have them audited by auditors appointed by the PPRA or any other appropriate authority appointed by Government of Kenya; and
- f) Pursuant to Section 62 of the above Act, requires Applicants/Tenderers to submit along with their Applications/Tenders/Proposals a "Self-Declaration Form" as included in the procurement document declaring that they and all parties involved in the procurement process and contract execution have not engaged/will not engage in any corrupt or fraudulent practices.

,

<sup>&</sup>lt;sup>1</sup> For the avoidance of doubt, a party's ineligibility to be awarded a contract shall include, without limitation, (i) applying for pre-qualification, expressing interest in a consultancy, and tendering, either directly or as a nominated sub-contractor, nominated consultant, nominated manufacturer or supplier, or nominated service provider, in respect of such contract, and (ii) entering into an addendum or amendment introducing a material modification to any existing contract.

<sup>&</sup>lt;sup>2</sup> Inspections in this context usually are investigative (i.e., forensic) in nature. They involve fact-finding activities undertaken by the Investigating Authority or persons appointed by the Procuring Entity to address specific matters related to investigations/audits, such as evaluating the veracity of an allegation of possible Fraud and Corruption, through the appropriate mechanisms. Such activity includes but is not limited to: accessing and examining a firm's or individual's financial records and information, and making copies thereof as relevant; accessing and examining any other documents, data and information (whether in hard copy or electronic format) deemed relevant for the investigation/audit, and making copies thereof as relevant; interviewing staff and other relevant individuals; performing physical inspections and site visits; and obtaining third party verification of information.

# FORM OF TENDER SECURITY-[Option 1–Demand Bank Guarantee] Beneficiary: **Request for Tenders No:** Date: TENDER GUARANTEE No.: Guarantor: We have been informed that \_\_\_\_\_\_(here inafter called "the Applicant") has submitted or will submit to the Beneficiary its Tender (here in after called" the Tender") for the execution of under Request for Tenders No.\_\_\_\_("The ITT"). Furthermore, we understand that, according to the Beneficiary's conditions, Tenders must be supported by a Tender guarantee. At the request of the Applicant, we, as Guarantor, hereby irrevocably undertake to pay the Beneficiary any sum or sums not exceeding in total an amount of \_\_\_\_\_(\_\_\_\_) upon receipt by us of the Beneficiary's complying demand, supported by the Beneficiary's statement, whether in the demand itself or a separate signed document accompanying or identifying the demand, stating that either the Applicant: (a) has withdrawn its Tender during the period of Tender validity set forth in the Applicant's Letter of Tender ("the Tender Validity Period"), or any extension thereto provided by the Applicant; or b) having been notified of the acceptance of its Tender by the Beneficiary during the Tender Validity Period or any extension there to provided by the Applicant, (i) has failed to execute the contract agreement, or (ii) has failed to furnish the Performance. This guarantee will expire: (a) if the Applicant is the successful Tenderer, upon our receipt of copies of the contract agreement signed by the Applicant and the Performance Security and, or (b) if the Applicant is not the successful Tenderer, upon the earlier of (i) our receipt of a copy of the Beneficiary's notification to the Applicant

Consequently, any demand for payment under this guarantee must be received by us at the office indicated above

of the results of the Tendering process; or (ii) thirty days after the end of the Tender Validity Period.

[signature(s)]

onor before that date.

Note: All italicized text is for use in preparing this form and shall be deleted from the final product.

# FORMAT OF TENDER SECURITY [Option 2–Insurance Guarantee]

TEN	DER GUARANTEE No.:	
1.	[Date of submission of tend	(hereinafter called "the tenderer") has submitted its tender date der] for the
2.	having our registered office at  Works Development Agency (here (Currency and guarantee amount) f	sents that WE
	Sealed with the Common Seal of the	e said Guarantor thisday of 2022
3.	NOW, THEREFORE, THE CON	DITION OF THIS OBLIGATION is such that if the Applicant:
		uring the period of Tender validity set forth in the Principal's Letter of ty Period"), or any extension thereto provided by the Principal; or
	Validity Period or any exteagreement; or (ii) has failed	e acceptance of its Tender by the Procuring Entity during the Tendension thereto provided by the Principal; (i) failed to execute the Contract to furnish the Performance Security, in accordance with the Instruction Procuring Entity's Tendering document.
	receipt of the Procuring Entity's its demand, provided that in its	immediately pay to the Procuring Entity up to the above amount upon first written demand, without the Procuring Entity having to substantiat demand the Procuring Entity shall state that the demand arises from the events, specifying which event(s) has occurred.
4.	the contract agreement signed by is not the successful Tenderer, up	the Applicant is the successful Tenderer, upon our receipt of copies of the Applicant and the Performance Security and, or (b) if the Applicant on the earlier of (i) our receipt of a copy of the Beneficiary's notification of the Tendering process; or (ii)twenty-eight days after the end of the
5.	Consequently, any demand for pa above on or before that date.	yment under this guarantee must be received by us at the office indicate
	 [Date ]	[Signature of the Guarantor]
	[Witness]	

Note: All italicized text is for use in preparing this form and shall be deleted from the final product.

# TENDER-SECURING DECLARATION FORM

-	Bidde							
			_		lay, month and ye number of tender		=	
							he undersigned, declare that:	
1.	I/We	e understand th	at, accore	ding to you	r conditions, bids	s must be su	pported by a Tender-Securing Declaration.	
2.	Purc our o valid the I	chaser for the pobligation(s) udity specified to Purchaser duri	eriod of t nder the l by us in t ng the pe	ime of [ins oid conditi he Tenderi riod of bid	ert number of mo ons, because we- ing Data Sheet; of I validity, (i) fail	nths or year -(a) have we or (b) having or refuse to	g eligible for tendering in any contract witers] starting on [insert date], if we are in bread withdrawn our tender during the period of the group been notified of the acceptance of our Broad execute the Contract, if required, or (ii) frontstructions to tenders.	ch of ender id by
3.		earlier of:	a copy of	f your notif	ication of the nan	_	e if we are not the successful Tenderer(s), ccessful Tenderer; or	upon
4.	I/We understand that if I am/we are/in a Joint Venture, the Tender Securing Declaration must be in the name of the Joint Venture that submits the bid, and the Joint Venture has not been legally constituted at the time of bidding the Tender Securing Declaration shall be in the names of all future partners as named in the letter of intent.							
	Sign	ed:		• • • • • • • • • • • • • • • • • • • •			Capacity / title (dir	ector
	or	partner	or	sole	proprietor,	etc.)	N	ame:
							Duly authorized to sign the	e bid
	for a	nd on behalf of	f: <i>[insert</i>	complete n	name of Tenderer	1		

# **Appendix to Tender**

# **Schedule of Currency requirements**

Name of currency	Amounts payable
Local currency:	
Foreign currency #1:	
Foreign currency #2:	
Foreign currency #3:	
Provisional sums expressed in local currency	[To be entered by the Procuring Entity]

# PART II - WORK REQUIREMENTS

# SECTION V – DRAWINGS (AS IN VOLUME III: TECHNICAL DRAWINGS ATTACHED)

#### SECTION VI - SPECIFICATIONS

#### **GENERAL**

101	Tender Drawings, Bills of Quantities and Specifications5
102	Setting out of the works5
103	Contractor's Working Area/Boundaries of Works6
104	Flagging, Lighting, Watching and Traffic Control6
105	Restrictions on Use of Roads6
106	Offices for Engineer's Representative7
107	Contractor's Offices, Yard, Stores, etc
108	Accommodation for Workmen
109	First Aid Outfits, Medical Treatment and Transport
110	Water and Electricity Supplies
111	Precautions against contamination of the works8
112	Level Datum8
113	Levelsand Dimensions
114	Survey Equipment and Labour8
115	Order of Construction of Works8
115	
	Quality of Materials and Workmanship
117	Submission of Samples
118	Responsibility for Ordering Materials and Manufactured
110	Articles and Samples for Testing9
119	Testing of Materials9
120	Rejected Materials
121	Cutting out existing work
122	Existing services
123	Temporary Removal of Existing services
124	Permanent Diversion of Existing services
125	Permanent Support for Existing Services, etc
126	Attendance upon other contractor11
127	Supports to excavations
128	Ownership of Excavated and other material12
129	Care of Boundary Hedges, Walls, Fences and Trees12
130	Work through private property and serving notices
131	Compensation for loss of crops etc. in private property
132	Provision of facilities for Engineer's inspection
133	Inspections by Engineers During period of Maintenance13
134	Clearing up site
135	The lands under the control of the contractor
136	Fencing the works
137	Correspondence and records to be in English Language
138	Materials ordered and paid for by the Employer
139	Testing of Water-Retaining Structures
140	Clearing and Sterilizing Water-retaining structure
140 141	
	Water etc. for testing water-retaining structure
142	Contractor to use special plant if required
143	Use of parts of the works on their completion
144	Duty staff
145	Regulations and site Discipline
146	Removal of Employees
147	Record of names and Permanent Address of Employer18
148	Fire precautions
149	Tests on completion.
150	Connection of Existing main
151	Responsibility for damage
152	Safety precautions to be observed
153	Opening and reinstatement of surfaces

#### **GENERAL**

#### 101. TENDER DRAWINGS, BILLS OF QUANTITIES AND SPECIFICATION

- 101.1 The Tender Drawings are as listed in Section VI of Volume III and these may be supplemented from time to time by the Engineer during the period of the contract.
- 101.2 The Specifications, Bills of Quantities, and the Tender Drawings are intended to describe and provide for a complete and finished project. They are intended to be co-operative, e.g. all items of work called for by any shall be as binding as if called for by all. The Contractor is to understand that the work herein described shall be complete in every detail, notwithstanding the fact that every item necessarily involved is not particularly mentioned or shown. The Contractor will be held to provide all labour and materials necessary for the completion of the works described and shall not avail himself of any errors or omissions which are manifestly unintentional.
- 101.3 Before commencing any work, the Contractor shall check all drawings, Bills of Quantities and Specifications and report to the Engineer any errors or inconsistencies and shall verify all dimensions given on the drawings
- 101.4 The Specifications are divided into trades and divisions for the distinct purpose of facilitating the work. However, the Contractor will become responsible for furnishing all labour and materials necessary to provide the complete project as contemplated by the drawings and specifications. Any item mentioned under any heading of the Specifications must be supplied even though it is not called for again under the heading for the respective work.
- 101.5 At the award of contract the contractor shall sign one set of drawings and specifications and such signed set of contract documents shall be deposited with the Engineer as an additional evidence of the Contractor's understanding of the work required.

#### 102 SETTING OUT OF THE WORKS

- 102.1 The Engineer's Representative will if necessary provide the Contractor with basic information supplementary to that shown on the Drawings such as the position of centre-lines and base-lines etc. Such supplementary information may be provided on drawings sketches in writing or indicated on the site.
- 102.2 The contractor shall prepare detailed setting out drawings and data sheets as necessary and submit them to the Engineer's Representative in triplicate for approval. Any modification to the setting out drawings or data sheets required by the Engineer's Representative shall be made by the Contractor and re-submitted for final approval. Approval by the Engineer's Representative shall be signified by the return to the Contractor of one copy duly signed by the former or an authorized member of his staff.
- 102.3 Should it be necessary during setting out or during construction for agreed setting out details to be amended to contractor shall amend the drawings or data sheets or make new ones for approval as required by the Engineer's Representative.
- 102.4 Copies of setting out drawings and data sheets shall be preserved for use by the Contractor in preparing final records and drawings in accordance with the requirements set out elsewhere.
- 102.5 The Contractor shall be before commencing work establish steel datum pegs at all sites which shall be securely concreted in and shall agree with the Engineer the level and co-ordinates of each peg.

#### 103 CONTRACTOR'S WORKING AREA/BOUNDARIES OF WORKS.

- 103.1 The contractor shall make his own arrangements for and pay all costs incurred in the use of such areas of land as he may require for storage and working space for the purpose of the contract.
- 103.2 The employer will provide the land and rights of way for works specified in the contract.
- 103.3 The contractor shall not enter upon or occupy with men tools equipment and materials any land other than land or rights of way provided by the Employer without the written consent of the owner of such

additional land or rights of way as he may require in accordance with conditions of contract.

#### 104 FLAGGING LIGHTING WATCHING AND TRAFFIC CONTROL

104.1 The Contractor shall be responsible for watching and lighting the works and for the flagging and control of traffic and he shall comply with the requirements of the Employer and police and the competent Authority in these matters.

#### 105 REGISTRATIONS ON USE OF ROADS.

- 105.1 The Contractor shall not run tracked vehicles or tracked plant on any existing works of the Employer or on any public or private road being a metallic or sealed road or on any public or private road being a metallic or sealed road or on any other public or private road without the written approval of the Engineer and the responsible Authority or Owner and subject to such conditions as each may require.
- 105.2 The Contractor shall observe all weight restrictions which apply automatically to the majority of minor roads and tracks in Kenya when such road and tracks are wet and with all other reasonable restrictions which may from time to time be imposed by the Engineer and the responsible Authority or Owner.
- 105.3 Contractor shall not be entitled to additional payment for any additional cost he may incur on account of adverse weather and road conditions, restrictions on the use of the roads delays detours or any other thing which may increase the average haulage distance or journey time or otherwise adversely affect his operations.

#### 106. OFFICE FOR ENGINEER'S REPRESENTATIVE

The contractor shall provide and maintain at a place to be agreed with the Engineer's Representative a furnished office accommodation for the use of the Engineer's Representative for the entire duration of the contract. (A bill item has been included for the procurement)

#### 107 CONTRACTOR'S OFFICES, YARDS, STORES, ETC.

- 107.1 The contractor shall provide and maintain at a place to be agreed with the Engineer's Representative an office for the use of his Agent and to which written instructions by the Engineer's Representative can be delivered. Any instructions delivered to such office shall be deemed to have been delivered to the Contractor. This office will be erected before any construction work commences and will be open and attended at all hours when work is in progress.
- 107.2 The Contractor shall make his own arrangements for all yards stores etc. and for all services in connection therewith for the efficient execution of the Contract.
- 107.3 The location of all offices and stores shall be agreed before hand with the Engineer and shall be such as to avoid obstruction and nuisance to the public and interference with the proper operation of the existing services.

#### 108 ACCOMMODATION FOR WORKMEN

108.1 The contractor shall provide at each site sufficient closets or latrines to the satisfaction of the Government Medical Officer. They shall be properly screened and maintained in a clean and sanitary state at all times.

#### 109 FIRST AID OUTFITS MEDICAL TREATMENT AND TRANSPORT

109.1 During the progress of the works the Contractor shall provide and maintain to the satisfaction of the Medical Officer of Health in easily accessible positions on the Site adequate First Aid Outfits to the approval of the Medical Officer of Health and of the Engineer, such outfits to be in charge of an experienced dresser who shall be on duty at the Site during working hours.

#### 110 WATER AND ELECTRICITY SUPPLIES

110.1 The Contractor shall make his own arrangements for water and electricity supplies and shall pay all constructional costs, fees and expenses incurred and for all the water and electricity used.

#### 111. PRECAUTIONS AGAINST CONTAMINATION OF THE WORKS

- 111.1 The Contractor shall ensure that all his personnel working on the site are medically suitable to be in contract with a public water supply and his personnel shall undergo any necessary medical test at the Contractor's expense to show that they are free from infectious diseases and are not carriers of any such diseases.
- 111.2 The Contractor shall at all times take every possible precaution against contamination of the works and existing Water Mains. The Contractor shall give strict instructions to all persons employed by him to use the sanitary accommodation provided. Clause 16 of the Conditions of Contract will be rigidly enforced in any case where these instructions are disobeyed.
- 111.3 Throughout the Contract the Site and all permanent and temporary works shall be kept in a clean tidy and sanitary condition.

#### 112 LEVEL DATUM

112.1 All levels are referred to survey of Kenya datum and the Contractor shall obtain in writing from the Engineer's Representative the location and value of the permanent bench marks to be used.

#### 113. LEVELS AND DIMENSIONS

113.1 The reduced levels shown on the Drawings are believed but not guaranteed to be correct. In the event of any discrepancies between the Drawings and Specification, the Specification shall have precedence over the Drawings. In the event of any discrepancies between Drawings the Contractor shall notify the Engineer in writing who will issue corrections, forthwith.

#### 114. SURVEY EQUIPMENT AND LABOUR

- 114.1 The Contractor shall maintain the Engineer's Representative survey instruments and other equipment necessary for inspection/checking of Works for the entire duration of the contract ( A bill item has been included for the procurement )
- 114.2 The Contractor shall provide all labour and materials as may be required by the Engineer's Representative for survey work in connection with the works.

#### 115. ORDER OF CONSTRUCTION OF WORKS

- 115.1 Construction of the Works shall be carried out as directed by the Engineer.
- 115.2 Following detailed discussions with the Engineer, and before he begins the work, the Contractor shall submit to the Engineer a programme which shall be reviewed and brought up to date at frequent intervals as the work proceeds. The programme shall be adhered to and only varied by permission of the Engineer.

#### 116. QUALITY OF MATERIALS AND WORKMANSHIP

- 116.1 All materials and workmanship shall be to the approval of the Engineer. In the reading of this Specification the words "to the approval of the Engineer" shall be deemed to be included in the description of all materials or articles incorporated in the Works and in the descriptions of the operation for the due execution of the works.
- 116.2 Specifications of the British Standards Institution current at the date of tender shall apply for all materials and workmanship unless otherwise directed by the Engineer.
- 116.3 The words "British Standards Specifications" are hereinafter abbreviated to B.S.

#### 117. SUBMISSION OF SAMPLES

117.1 Before incorporating in the finished work any material or articles which he supplies under the terms of the Contract the Contractor shall submit to the Engineer's Representative for his approval a sample of each respective material or article and such samples shall be delivered to and be kept at his office for reference. All the respective kinds of material and articles used in and upon the Works shall be at least equal

in quality to the approved samples. Each and every sample shall be a fair average of the bulk material or of the article which it represents. The Engineers Representative may decide the method by which each sample to be taken from the bulk shall be obtained.

# 118. RESPONSIBILITY FOR ORDERING MATERIALS AND MANUFACTURED ARTICLES AND SAMPLES FOR TESTING.

118.1 The responsibility for so ordering and delivering materials and manufactured articles and samples that they may be tested sufficiently far in advance of the work as not to delay it shall rest upon the Contractor and he shall not be entitled to any time credit for delays occasioned by his neglect to order sufficiently well in advance or to payment of any costs he may incur as the result thereof.

#### 119 TESTING OF MATERIALS

- 119.1 Tests and inspections will be carried out by the Engineer or by an Inspector to be appointed by him. In such circumstances where the Engineer does not require witnessed tests to be carried out, the Contractor shall furnish test certificates.
- 119.2 The contractor shall provide facilities for the Engineer or his Agent to inspect examine and test all materials and workmanship. If the materials are manufactured on premises other than those of the Contractor, he shall obtain from the manufacturer similar facilities.
- 119.3 The Contractor shall give two weeks notice to the Engineer of the place or places at which the materials are to be manufactured and as to when testing will be in progress and shall ascertain before manufacture commences whether the Engineer wishes to attend or send his Agent for the purposes of witnessing manufacture, inspecting, examining, or testing.

#### 120 REJECTED MATERIALS

120.1 Should any materials or manufactured articles be brought on to the Site of the Works which are in the judgment of the Engineer unsound or of inferior quality or in any way unsuited for the work in which it is proposed to employ them, such materials or manufactured articles shall not be used upon the Works but shall forthwith be removed from the Site of the Works all at the Contractor's expense and in each case as the Engineer and/or Engineer's Representative shall decide and direct.

#### 121 CUTTING OUT EXISTING WORK

- 121.1 Where existing work is to be cut, the Contractor shall ensure that the cutting out is done in such manner as not to cause permanent damage to the surrounding structure. Before commencing to cut out any work, the Contractor shall submit to the Engineer the method he proposes to use and no such work will be permitted until the Engineer's written approval has been obtained.
- 121.2 Notwithstanding the giving of the Engineer's approval, the Contractor shall be liable for making good at his own expense any damage arising from such work of cutting out.

#### 122 EXISTING SERVICES

- 122.1 The Contractor shall take every precaution to ensure that all existing services pipes cables drainage and irrigation ditches and the like are located supported and safeguarded from damage even though they may not be in the line of excavation but near to it. Any damage caused to any such services pipes culverts cables drainage and irrigation ditches and the like attributable to the Contractor's operations or to his negligence shall be made good by or for the Contractor at his own expense or the satisfaction of the Engineer and of the owner or responsible Authority.
- 122.2 In the event of the owner or responsible Authority electing to repair such damage the Contractor shall pay the cost of his or their so doing the work. Should the Contractor fail to pay the cost of the said work within a reasonable period of the account being presented the Employer reserves the right to settle the account and deduct the sum paid by him from moneys due or which may become due to the Contractor.

#### 123 TEMPORARY REMOVAL OF EXISTING SERVICES

123.1 If it should become necessary for the proper execution of the work temporarily to remove or divert any existing pipe sewer field-drain cable drainage or irrigation ditch or other service the Contractor shall

# obtain permission from the competent

Authority or Owner and shall carry out the work at his own expense in a manner and at times to be approved by such Authority or owner and shall subsequently reinstate the work to the satisfaction of such Authority or Owner. In the event of the Owner of responsible Authority electing to arrange for the temporary removal of an existing service the Contractor shall pay the cost of his or their doing the work. Should the Contractor fail to pay the cost of the said work within a reasonable period of the account being presented the Employer reserves the right to settle the account and deduct the sum paid by him from moneys due or which may become due to the Contractor.

123.2 The Contractor's attention is particularly drawn to the requirement to maintain drainage and irrigation ditches in order to avoid any interruption of flow of water therein to the satisfaction of the Engineer Owner or competent Authority and the Contractor shall be deemed to have included in his rates and prices for all temporary works so required.

#### 124 PERMANENT DIVERSION OF EXISTING SERVICES

- 124.1 If in the opinion of the Engineer and/or of the competent Authority or owner it should become necessary permanently to remove or re-align any existing pipe sewer field-drain cable ditch or other service the Contractor shall obtain permission where necessary from the competent Authority or Owner and shall carry out and complete the work to the satisfaction of the Engineer and such Authority or Owner. Payment for such additional work will be made in accordance with the tendered rates and/or the schedule for day work contained in the Bill of Quantities as the Engineer will determine provided always that the necessity for such permanent diversion has not arisen due to the fault of the contractor.
- 124.2 In the event of the Owner or responsible Authority electing to arrange for the permanent diversion of an existing service due to the fault of the contractor doing the work. Should the Contractor fail to pay the cost of the said work within a reasonable period of the account being presented the Employer reserves the right to settle the account and deduct the sum paid by him from monies due or which may become due to the Contractor.

# 125 PERMANENT SUPPORT FOR EXISTING SERVICES, ETC.

125.1 If in the opinion of the Engineer and/or the competent Authority or owner it should become necessary to provide permanent support for any existing pipe sewer cable structure or other thing disturbed exposed or injured during or after the execution of the works the Contractor shall carry out promptly such additional works as the Engineer may require to provide such permanent support. Payment for such additional work will be made in accordance with the tendered rates and/or the schedule for Day work contained in the Bill of Quantities as the Engineer will determine provided always that the necessity for such permanent support has not arisen due to the fault of the Contractor.

# 126 ATTENDANCE UPON OTHER CONTRACTORS

126.1 When an item is included in the Bill of Quantities for attendance, such attendance shall in addition to the requirements of the conditions of contract include all reasonable and customary conveniences apparatus plant and labour in attendance.

#### 127 SUPPORT TO EXCAVATIONS

127.1 Payment for timber and other supports left in excavations will be made only for those supports ordered to be left in for any purpose by the Engineer. Supports so left in will be paid for at the rates entered in the Bill of Quantities.

# 128 OWNERSHIP OF EXCAVATED AND OTHER MATERIAL

128.1 All material of any kind whatsoever including growing matter removed or cut down as part of the works shall remain the property of the Employer or the owner of the land through under or over which the works are carried out. The disposal of such material belonging to the Employer shall be at the discretion of the Engineer who will instruct the Contractor in all matters of its use and/or removal from the site.

# 129 CARE OF BOUNDARY HEDGES, WALLS, FENCES AND TREES

129.1 The Contractor shall not cut through or remove any section of any boundary, hedge, wall, or fence

without the prior approval of the Engineer's Representative who will determine the limits of such cutting or removal.

- 129.2 Approval for the cutting or removal of boundary hedges walls and fences will normally be limited to those crossing the route of mains and pipelines and the contractor shall so conduct his operations as to minimize the extent of such cutting through or removal.
- 129.3 In the case of boundary hedges walls and fences being part of enclosed paddocks or grazing areas the Contractor shall provide erect maintain and remove on completion of all work adequate temporary fencing or shall by other means ensure that animals and other livestock cannot stray from the previously enclosed paddocks or grazing areas.
- 129.4 The Contractor shall repair and reinstate in a manner similar to the original or by other approved means any hedging wall or fence which he may have cut through or remove with or without the approval of the Engineer's Representative or damaged during his operations and all such repairs and reinstatement shall be the contractor's sole liability and shall be carried out to the satisfaction of the Engineer and the responsible Authority or owner.
- 129.5 The Contractor shall not cut down grub up or remove any tree without the prior permission of the Engineer.

#### 130 WORK THROUGH PRIVATE PROPERTY AND SERVING OF NOTICES

130.1 Where the work is to be executed in private land the Employer will be responsible for negotiating and obtaining rights of way and the serving of all notices as may be required upon the Owners and/or Occupiers of the land and it shall be the obligation of the Contractor to keep the Employer and the Engineer fully informed concerning the rate of contract progress and of his intention to enter and begin work within any way leave as required by Clause 201 and 202 of this Specification.

# 131 COMPENSATION FOR LOSS OF CROPS ETC. IN PRIVATE PROPERTY

131.1 The attention of the Contractor is drawn to Clause 11 of the conditions of contract and with reference to sub-clause 11(1) of the clause the description "loss of or damage to property" shall mean crops including trees, shrubs and hedges within the boundaries of the lands and rights of way defined in this Specification except such individual trees shrubs and hedges which the Engineer may require to be preserved in accordance with Claus 292 of this Specification.

#### 132 PROVISION OF FACILITIES FOR ENGINEER'S INSPECTIONS

132.1 The Contractor shall provide the necessary equipment access and labour to enable the Engineer and/or the Engineer's Representative to conveniently carry out such inspections as they may deem necessary at all times during the currency of the contract.

### 133 INSPECTIONS BY ENGINEER DURING PERIOD OF MAINTENANCE

133.1 The Engineer will give the Contractor due notice of his intention to carry out any inspections during the period of Maintenance and the Contractor shall thereupon arrange for a responsible Representative to be present at the times and dates named by the Engineer. This Representative shall render all necessary assistance and take not of all matters and things to which his attention is directed by the Engineer.

# 134 CLEARING UP SITE

- 134.1 During the progress of the works the contractor shall at reasonable intervals or when required by the Engineer's Representative gather and remove rubbish and surplus materials from the site.
- 134.2 On completion of the works the site of all permanent and temporary works in connection with the contract shall be carefully cleared up and everything shall be handed over to the Employer in a neat and clean condition.
- 134.3 All rubbish roots undergrowth and the like cleared from the works must be burnt or removed completely from the site and disposed of by other means to the satisfaction of the Engineer and the Contractor

shall make his own arrangements for all such disposal.

134.4 All surplus materials and manufactured articles supplied by the contractor shall if not accepted or purchased by the Employer be removed from the site and disposed of by the contractor.

#### 135 THE LANDS UNDER THE CONTROL OF THE CONTRACTOR

135.1 The Contractor shall attend to all operations carried out on the lands under his control and utilize them only for the purpose of construction of the works and to the lands responsible for any damage to the lands responsible for any damage to the lands and to the lands adjacent. Before starting any work the Contractor shall ascertain the boundaries of the lands coming under his control.

# 136 FENCING THE WORKS

- 136.1 The Contractor shall fence the works in a manner sufficient for the protection of the public and of livestock and property to whomsoever it may belong during the progress of the works and shall satisfy the Employer and the Engineer or his Representative in this respect.
- 136.2 Temporary fencing shall prevent the straying of livestock and reasonable access to lands and premises must be provided.
- 136.3 The Contractor shall erect and maintain guard-rails around all trenches and other open excavations in a manner sufficient to provide safety for pedestrians and vehicles at all time.
- 136.4 Temporary bridges shall be provided across trenches to maintain reasonable access for pedestrians and vehicles to land and property on either side of the trench.

#### 137 CORRESPONDENCE AND RECORDS TO BE IN THE ENGLISH LANGUAGE

- 137.1 All correspondence between the contractor and the Engineer or the Engineer's staff shall be in the English language.
- 137.2 All books, time sheet records, notes, drawings, documents shall be in the English Language, or, if the original documents are in another language, a certified translation in English shall be submitted to the Engineer's Representative.

# 138 MATERIALS ORDERED AND PAID FOR BY THE EMPLOYER

- 138.1 The Employer will deliver to the Contractor at the specified places the materials detailed (but not by way of limitation) in the Appendix to the Bill of Quantities and any other materials of which the Engineer may from time to time give particulars to the contractor. Payment for all such materials delivered to those places and store areas has been or will be made by the Employer to the several manufacturers forwarding agents and shipping companies and the Contractor will not be allowed commission on any such payments.
- 138.2 The Contractor shall take delivery of all materials without delay upon receipt of instructions from the Engineer's Representative giving details of the materials and the places at which delivery is to be taken.
- 138.3 The Employer will make every endeavor promptly to supply any materials which he may undertake to supply in accordance with the Conditions but he will accept no responsibility for loss delay or inconvenience suffered by the Contractor should such materials not be available and/or delay occur in the supply of such materials and plant.
- 138.4 The Contractor shall examine the materials before taking delivery and shall report any damage defect or deficiency to the Engineer's Representative immediately.

Any damage defect or deficiency so reported or which arises after the contractor has taken delivery and could not reasonably have been detected by normal methods of inspection shall be repaired or made good at the expense of the Employer provided always the Engineer is satisfied that such damage defect or deficiency has not been caused by negligence on the part of the contractor.

138.5 Subject to the above provisions whilst taking delivery of and after taking delivery of all materials by the Employer and Contractor shall be solely responsible for any loss, damage, defect or deficiency however arising in connection therewith and he shall forthwith make good such loss, damage, defect or deficiency at

his own expense.

- 138.6 After taking delivery of the materials the Contractor shall transport them without delay to his own store on the site of the works or elsewhere. The contractor will be held solely responsible for any claim against the Employer and any delay brought about by the Contractor's failure to take delivery immediately he is instructed to do so and the settlement of any such claims shall be at the Contractor's sole expense.
- 138.7 In pricing the items in the Bill of Quantities for "Take delivery" the Contractor shall include (but not by way of limitation) for the following services and supplies:-
- (a) Accept, unpack, physically inspect, and test as may be necessary, re-pack as required report discrepancies and breakages, cart to storage compound and/or stores building and conduct all insurances claims.
- (b) Store the materials and plant and maintain a Stores Ledger recording in full detail both the receipt and disposal of all items.
- (c) Guard and insure all such material and plant against all loss or damage.
- 138.8 Where materials are supplied by the Employer the quantity incorporated in the Works will be checked against the quantity supplied. The Contractor shall at his own expense return all surplus material to the Employer's store and make good any deficiencies. In checking pipes an allowance of not more than one per cent of the measured quantity used will be made to cover cutting to waste except in special circumstances which shall be decided by the Engineer.

#### 139 TESTING OF WATER-RETAINING STRUCTURES

- 139.1 All water-retaining structures shall be tested for water tightness on completion in the following manner. The structure shall be filled with clean water in stages and held at each water level for such time as the Engineer may require. Should any dampness or leakage occur at any stage the water shall be drawn off and the defects remedied to the satisfaction of the Engineer. The procedure shall be continued and finally the structure shall be allowed to remain full for seven days. Should any damages or leakages or other defects occur they shall be made good to the satisfaction of the Engineer and the structure re-tested until the water tightness is approved by the Engineer.
- 139.2 The Contractor shall provide a hook gauge to measure variations in water level during the tests.
- 139.3 The testing shall be carried out before excavations are backfilled and embankments placed.

# 140. CLEANSING AND STERILIZING WATER-RETAINING STRUCTURE

- 140.1 The inside of all potable water-retaining structure and all interior pipe work and fittings shall be thoroughly cleaned and washed after the water tightness test has been approved by the Engineer to remove all contamination and the water from these operations shall be removed by squeegees and drained away.
- 140.2 The structure shall then be filled to overflow level with clean water clean water containing 20 parts per million of chlorine and left for a period of at least 24 hours. The chlorinated water shall then be drained away and the structure refilled with clean water from which samples shall be taken for analysis to the instruction of the Engineer. If any of the results of the analyses are unsatisfactory when compared with those of the control sample of the supply water the sterilizing process shall be repeated until the results of the test are satisfactory.
- 140.3 The costs of the initial sampling analysis and preparing reports on the bacteriological quality of the water shall be borne by the Employer but should the initial reports be unsatisfactory the costs of any subsequent sampling analyses preparing reports shall be borne by the Contractor.

#### 141 WATER ETC. FOR TESTING WATER-RETAINING STRUCTURES

- 141.1 The Contractor shall make available all water required for the testing of water-retaining structures. The Employer may allow the Contractor to draw water for testing from the existing water supply at the price pertaining at the time.
- 141.2 The Contractor shall be solely responsible for the provision of all labour materials and other things necessary for testing water-retaining structures.

141.3 The Contractor shall be responsible for making all arrangements necessary for obtaining all water required for testing water-retaining structures.

# 142 CONTRACTOR TO USE SPECIAL PLANT IF REQUIRED

142.1 The Contractor shall if the Engineer so requires supply and use such special plant and tools in executing the work as the Engineer may direct.

#### 143 USE OF PARTS OF THE WORKS ON THEIR COMPLETION

143.1 Should the Employer so desire he shall have full power to use and put into active operation any or all sections or parts of the works directly they are finished. Such action shall not however relieve the Contractor of his obligations with regard to maintenance.

#### 144 DUTY STAFF

144.1 At least one responsible senior representative shall be on the site and immediately available at all times during normal working hours. To such representative shall be delegated full authority to confer with the Engineer's Representative or his staff and to take all steps and to issue all those instructions which may be required in an emergency to ensure the safety of all personnel of the works and of all the Employer's and other property on the Site and in the immediate vicinity thereof. The Engineer's Representative may from time to time at his discretion after taking into consideration all the prevailing conditions allow some relaxation of this clause but such relaxation shall be made only with his written permission and subject to any special conditions which he may then require.

# 145 REGULATIONS AND SITE DISCIPLINE

145.1 The Contractor shall obey all police health and municipal regulations all other regulation which may from time to time require his observance and he shall instruct his agents servants and other employees to obey such regulations. The Contractor shall be responsible for keeping discipline on the Site and shall permanently remove from site within 24 hours from receipt of written instructions by the Engineer to that affect any servant laborer or other employee who neglects to observe the regulations or who refuses to carry out instructions given to him by the Contractor on the representation of any responsible representative of the Employer.

# 146 REMOVAL OF EMPLOYEES

146.1 The contractor shall permanently remove from site any person guilty of attempted dishonesty to the Employer or of disobedience of the regulations aforesaid or of bad behavior of who causes or attempts to cause trouble and unrest among the labour force.

# 147 RECORD OF NAMES AND PERMANENT ADDRESSES OF EMPLOYEES

147.1 The Contractor shall keep a full record giving the names and permanent addresses of all his employees and holds this record for the inspection of the Engineer.

#### 148 FIRE PRECAUTIONS

148.1 The Contractor shall provide at the Site adequate audible means of giving the alarm in the event of an outbreak of fire and shall make arrangements which may be necessary for the sounding of such an alarm. The Contractor shall take all precautions against fire and he shall provide fire fighting appliances labour, pangas, beaters, axes etcetera as may be necessary for the isolation and extinguishing of fires with the utmost expediency.

# 149 TESTS ON COMPLETION

140.1 On commissioning of the works the contractor shall have on site personnel to ensure that all the plant is working satisfactorily. The personnel shall be on site for a minimum period of 7 days or for such time as is required to determine that the equipment is operating to the satisfaction of the Engineer.

### 150 CONNECTION INTO EXISTING MAIN

150.1 Connection into existing mains will be carried out at times acceptable to the Employer such that any inconvenience to the public is kept to a minimum. This may require night or Sunday working and the contractor must allow for this in his rates. The contractor shall notify the Engineer at least seven days before the day on which the particular connection is proposed. The Engineer will make any necessary arrangement for the limited shut down of the mains, provided that times proposed are acceptable.

#### 151 RESPONSIBILITY FOR DAMAGE

- 151.1 The Contractor shall be fully responsible for any damage which may be done by himself or his employees to site buildings, works services such as electricity, water, gas, pipelines, or apparatus. Such damage must be made good to the entire satisfaction of the Engineer within a reasonable period of time specified in writing by the Engineer.
- 151.2 The Contractor shall be fully responsible for and take every reasonable precaution to protect any section of the contract works against loss or damage from any cause.

# 152 SAFETY PRECAUTIONS TO BE OBSERVED

- 152.1 The Contractor shall be responsible for the safety of his own staff and his sub-contractors staff whilst employed on the site.
- 152.2 The Contractor shall see that only safe working practices are used, and that only proper and safe equipment such as step ladders, ladders, scaffolding, ropes, and lifting equipment are in use on the site. The Contractor shall ensure that his staff are suitably instructed to use only safe working methods and safe appliances during the receipt, unloading, handling into store and transmission to site, erection and installation, testing and commissioning, the equipment, materials and installation forming the requirements of this contract.
- 152.3 The Engineer will require cessation of any working practice which in the Engineer's opinion is not safe and the removal of any equipment which has not been certified as safe by an appropriate authority.

#### 153 OPENING AND REINSTATEMENT OF SURFACES

- 153.1 The Contractor shall ascertain and observe the current regulations of the Highway Authority and the requirements of any other body public or private person in, on, under, over or through whose land the works are to be carried out for the opening and reinstatement of surfaces and it will be deemed that he has ascertained all charges and requirements connected therewith and has made full allowance in his prices therefore.
- 153.2 All surfaces of roads fields open spaces paths courtyards gardens verges and other places whether public or private which are affected by the operations of the contractor are to be reinstated by him both temporarily and permanently unless in the case of surfaces in the control of the Highway Authority or a public body such Authority or body shall elect to do the permanent reinstatement themselves when the Contractor shall do the Temporary reinstatement only.

### **SECTION 2**

#### G. EARTHWORKS

201	Conditions of Site	21
202	Site Clearance	21
203	Ground Levels.	22
204	Trial Hole	22
205	Excavation Generally	22
206	Excavation in Excess	23
207	Mechanical Excavation	23
208	Restoration of Borrow Areas Spoil Tips and Quarries	24
209	Headings	
210	Excavation for Foundations, Thrust and Anchor Blocks	24
211	Excavation in Rock	25
212	Keeping Rock Faces Dry	25
213	Cleaning Rock Surfaces	
214	Explosives	

215	Excavated Materials suitable for re-use	
216	Refilling of excavations	26
217	Hard Filling	27
218	Refilling of Pipe Trenches	
219	Making good subsidence after re-filling	27
220	Removal of Timber from Excavations	28
221	Reinstatement of Surfaces	28
222	Forming Banks and Filled Areas	28
223	Planting	29
224	Disposal of Surplus Excavated Material	
225	Free Draining Fill	
226	Graded Gravel for Drains	
227	Rock Pitching	31
228	Formation of Footpaths	
229	Concrete Paving Slab Lining to Ponds	
230	Reinstatement of Trench Surfaces in Roads	

#### 201 CONDITION OF SITE

- 201.1 Before carrying out any work on any site the site shall be inspected in conjunction with the Engineer's Representative to establish its general condition which shall be agreed and recorded in writing.
- 201.2 Details recorded shall include the location of all boundary and survey beacons the condition of buildings surfaces terracing (if any) ditches watercourses roads tracks fences and other information relating to the site and elsewhere which may be affected by the Contractor's operations.
- 201.3 In the case of way leaves for mains and pipelines the boundaries of the way leaves will be defined by the Employer and the contractor shall provide erect and maintain in position from commencement to final completion of all work and all reinstatement in every section substantial timber stakes or similar approved markers not less than 1.5m high indicating the position of every beacon at 100m or such other intervals as the Engineer's Representative may require. Payment for this work will be made at the tendered rate.
- 201.4 In the event of any boundary or survey beacon being disturbed or displaced as a result of the Contractor's operations the Contractor shall forthwith at his own expense replace the beacon and shall employ the services of an approved licensed survey for this purpose.

# 202 SITE CLEARANCE

- 202.1 Before beginning excavation or other work on any site the areas to be occupied by the permanent works shall be cleared of all trees stumps bushes and other vegetation and all roots shall be grubbed out. The felling and disposal of trees other than coffee trees exceeding 1000mm. girth at a height of 1.0m above ground level shall be measured separately and paid for in accordance with the tendered rates.
- 202.2 All debris shall be burnt or removed and disposed of by other means to the satisfaction of the Engineer.
- 202.3 The limits of the areas to be cleared shall be as indicated on the drawings or as will be defined by the Engineer.
- 202.4 In the case of way leaves for cables, mains, pipelines and the like the area to be cleared shall extend over the full width of the way leaves but the Contractor shall preserve as far as practicable all grass and other vegetation outside the limits of trenches and permanent works within the way leaves and shall not unnecessarily destroy crops, coffee trees and the like the removal of which is not essential to his operations.
- 202.5 The Engineer may require that individual trees shrubs and hedges are to be preserved and the Contractor shall take all necessary precautions to prevent their damage. In the case of trees etc. which the Engineer requires to be preserved the cutting or grubbing out and disposal of roots encountered within the net dimensions of any excavation or the minimum required width of any trench shall be paid for in accordance with the Schedule for day work contained in he Bill of quantities.
- 202.6 Before beginning clearance within any way leaves the Contractor shall give seven days written notice of his intention to the Engineer who will determine the extent and limits of such clearance having regard to the Contractor's requirements the rate of Contract progress the reasonable wishes of owners and occupiers

weather conditions and other factors which in the opinion of the Engineer may affect or be affected by the Contractor's proposals.

202.7 The Contractor shall take particular care at all times to prevent erosion on every site and elsewhere on land which may be affected by his operations and the Engineer may impose such reasonable limitations and restrictions upon the method of clearance and upon the timing and season of the year when clearance is carried out as the circumstances seem to him to warrant.

#### 203 GROUND LEVELS

203.1 Following the completion of site clearance and before the commencement of any earthworks the sites shall be surveyed in conjunction with the Engineer's Representative to establish existing ground levels and these agreed ground levels shall form the basis for the calculation of quantities of any subsequent excavation and filling.

#### 204 TRIAL HOLES

204.1 The contractor shall excavate refill and restore in advance of his programme all such trial holes as he may require for the location of water and other mains cables rock etc. The cost of these trial holes shall be included in his excavation rates.

#### 205 EXCAVATION GENERALLY

- 205.1 Excavation shall be made in open cutting unless tunneling or heading is specified or approved by the Engineer and shall be taken out as nearly as possible to exact dimensions and levels so that the minimum of infilling will afterwards be necessary.
- 205.2 It shall be the Contractor's responsibility at all times to ensure the stability and safety of excavations and the Contractor shall take all measures necessary to ensure that no collapse or subsidence occurs.
- 205.3 The sides of all excavations shall be kept true and shall where necessary be adequately supported by means of timber, steel or other type struts wailings poling boards sheeting bracing and the like. All supports shall be of sound design and construction and shall be sufficiently watertight to permit excavation concreting and other work to be completed satisfactorily.
- 205.4 Excavations shall be kept free from water and it shall be the Contractor's responsibility to construct and maintain temporary diversions and drainage works and to carry out pumping and to take all measures necessary to comply with this requirement.
- 205.5 In the event of soft or otherwise unsuitable ground being encountered at formation level in any excavation the Contractor shall forthwith inform the Engineer's Representative and shall excavate to such extra depth and refill with compacted granular or other approved fill or Class '10' concrete as the Engineer may require. Payment for such additional excavation and additional refilling will be made at the tendered rates provided always that the formation has not become soft or otherwise unsuitable due to the fault of the Contractor. The requirements of this paragraph shall apply also to the side face of any excavation with which concrete or other work will be in contact except that in the case of a side face the Engineer may alternatively require that the net dimensions of the concrete or work shall be increased.

## 206 EXCAVATION IN EXCESS

206.1 If any part of any excavation is in error excavated deeper and/or wider than is required the extra depth and/or width shall be filled with Class 10 concrete or compacted granular or other approved fill to the original formation level and/or dimensions at the Contractor's expense as the Engineer may require.

#### 207 MECHANICAL EXCAVATION

- 207.1 A mechanical excavator shall be employed by the Contractor only if the subsoil is suitable and will allow the timbering of the trenches or other excavations to be kept sufficiently close up to ensure that no slips falls or disturbance of the ground take place or there are no pipes cables mains or other services or property which may be disturbed or damaged by its use.
- 207.2 When mechanical excavations are used a sufficient depth of materials shall be left over the bottom of the excavations to ensure that the ground at formation level is not damaged or disturbed in any way. The

excavation shall then be completed to formation level by hand.

# 208 RESTORATION OF BORROW AREAS SPOIL TIPS AND QUARRIES

208.1 Any quarries or other borrow areas developed by the Contractor for the soil purpose of the works shall be finished to safe and fair slopes to the approval of the Engineer. Where directed by the Engineer areas shall be re-soiled with at least 100 mm of topsoil and grassed. The cost of such work shall be included in the Contractor's prices.

# 209 HEADINGS

- 209.1 The excavations for all pipelines pumping mains and works mains are to be made in open-cutting unless the permission of the Engineer for the ground to be tunneled is given in writing or a heading is shown on the Drawings. If the Contractor applies to the Engineer for permission to use headings and if this is given there shall be no additional cost whatsoever to the Employer.
- 209.2 Where a heading is specified or shown on the drawings or permitted to be used it shall be constructed to the approval of the Engineer and to dimensions which will permit a proper inspection to be made. The heading shall be properly and securely timbered. The pipe shall be laid on a minimum thickness of 150mm of Class '15' concrete.

After the pipe has been laid, jointed and tested the heading shall be filled in short lengths not exceeding 1 metre with Class '15' or '10' displacer concrete as directed. Great care shall be taken to ensure that the heading is completely filled with concrete and hard filling shall be rammed into the concrete at the crown of the heading. Special precautions shall be taken to prevent a slump in the concrete and to ensure that no slips or falls of the heading or in the ground above or in the shafts can take place. The Contractor shall allow for leaving in all timbering. The Contractor shall be responsible for the proper restoration of any road surfaces, pipes, cables or other things or property that may be damaged.

# 210 EXCAVATION FOR FOUNDATIONS THRUST AND ANCHOR BLOCKS

- 210.1 Excavations for foundations and for thrust and another blocks shall be to such depths as the Engineer may direct and no concrete or other material shall be placed until the formation has been examined and approved. Due notice shall be given to the Engineer's Representative to enable him to examine the formation well in advance.
- 210.2 The Engineer may direct that a layer of excavation of not less than 75mm thickness shall be left undisturbed and subsequently taken out by hand immediately before concrete or other material is placed. Similarly where concrete or other material is to be placed in contact with the side face of an excavation the Engineer may direct that the final 75mm thickness of the excavation to that face shall be left undisturbed and subsequently taken out neatly to profile by hand.
- 210.3 Areas of excavation which are to receive a layer of site concrete as a screed under the structural concrete shall be covered with the screed immediately the excavation has been completed.
- 210.4 If in the opinion of the Engineer due to the fault of the Contractor the ground becomes weathered prior to the placing of concrete or other material the Contractor shall excavate the weathered soil and replace it with Class '10' concrete to the original formation level at his own expense.

# 211 EXCAVATION IN ROCK

211.1 Rock will be defined as follows for the purposes of payment:-

Solid ledge or bed rock which cannot be removed without systematic drilling and blasting or barring and wedging, conglomerate deposits which are firmly cemented that they possess the characteristics of solid rock and which cannot be removed without systematic drilling and blasting or barring and wedging; boulders exceeding 0.3 cubic meters in volume.

- 211.2 No excavation in materials which can be excavated by the use of pick and shovel will be considered or paid for as rock excavation
- 211.3 The breaking of concrete or road surface or road base will not be considered or paid for as rock excavation.

211.4 The Engineer's decision as to the necessity or otherwise of rock excavating methods or appliances shall be final.

# 212 KEEPING ROCK FACES DRY

212.1 The contractor shall keep free of running water pools the surfaces of rock upon or against which concrete is to be deposited and no concrete shall be placed until surfaces of the rock are properly drained. Special precautions are to be taken to prevent running water from washing out cement or concrete while it is setting or in any other way from injuring the Works. Drains and pipes shall be provided in or behind concrete as may be necessary for the temporary conveyance of water and shall afterwards be grouted up and such laying and grouting shall be at the Contractor's cost.

#### 213 CLEANING ROCK SURFACES

213.1 The faces and surfaces of all rock against which concrete is to be places shall after being excavated to the required limits be properly cleaned and left free from all dust loose pieces of rock mud dirt and other loose material and they shall be perfectly clean when the concrete is deposited.

#### 214 EXPLOSIVES

- 214.1 Should the Contractor wish to transport or use explosives on or in connection with the Works he shall comply with the Explosives Laws of Kenya. The Contractor shall provide a special proper store for explosives in accordance with local regulations and shall provide experienced men for handling explosives to the satisfaction of the Engineer and the Authorities concerned.
- 214.2 Blasting shall only be carried out on these sections of the Works for which permission in writing shall have been given by the Engineer's Representative and shall be restricted to such hours and conditions as he may prescribe. Such permission shall not be withheld nor such hours and conditions imposed unreasonably.
- 214.3 The greatest care shall be taken in the use of explosives the charges being so placed and of such amount as in no way to weaken existing structures or the foundations or ground adjacent to the existing and proposed works. The Contractor shall take all necessary precautions to prevent loss injury or accident to persons or property and shall be entirely liable for any accident or damage that may result from the use of explosive.

### 215 EXCAVATED MATERIALS SUITABLE FOR RE-USE

- 215.1 In so far as they may be suitable and comply with the specification materials arising from excavations may be used in the works.
- 215.2 The Contractor in excavating shall ensure that all materials suitable for re-use are kept separate and set aside and protected as necessary to prevent loss or deterioration.
- 215.3 The materials forming the surface and foundations of roads tracks and footways shall when excavated and if required for further use be carefully separated all hard materials being kept free from soil or other excavated materials.
- 215.4 Paving slabs bricks and similar surfaces shall be carefully removed and stacked. Prior to the commencement of excavation the number of badly broken and unusable paving slabs bricks etc. on the line or the excavation shall be agreed with the Engineer's Representative and only the cost of replacing these shall be paid as an extra to the Contractor.
- 215.5 In verges and other grass surfaces the grass and top soil shall be stripped and separately stacked.
- 215.6 In particular the Contractor in excavating shall ensure that all granular or other approved material suitable for filling around and over pipes shall be kept separate and re-used for this purpose and the Contractor shall not be entitled to payment for screening or transport as provided for in Clause 218 of this specification if this requirement is not compiled with

216.1 All refilling of excavations and trenches shall be thoroughly compacted in layers not exceeding 150mm. compacted thickness and by means which will not damage the works.

#### 217 HARD FILLING

217.1 Hard filling shall consist of approved clean mixed ballast, broken stone, and/or concrete. All the materials shall be broken so as to pass through 75 mm. internal diameter rings and be evenly graded between that size and 3 mm. mesh size thereby enabling them when thoroughly compacted to form a hard solid mass. Filling shall be free from all earth clay vegetable or other organic matter shall contain no broken plaster lime mortar or other rubbish. It shall be laid in 300mm. layers each layer being properly spread and thoroughly compacted with rollers and/or rammers.

### 218 REFILLING OF PIPE TRENCHES

- 218.1 Filling around and for 300mmm over the top of the pipe shall be completed by hand using approved hand rammers and suitable material obtained from excavations. Materials for such refilling shall be free from stones greater than 25mm, and to the approval of the Engineer.
- 218.2 If the quantity of suitable material is insufficient the Contractor shall either screen the excavated soil to exclude stones and other materials likely to damage the pipes or transport suitable material from other excavations or borrow pits as the Engineer may require. The cost of such work shall be paid for at tendered rates provided always that the Contractor has complied with the requirements of Clause 215 of this specification
- 218.3 Filling around and for 300 mm over the top of pipes shall be carried out with the utmost care special attention being paid to joint holes so as to obtain the greatest possible compactness and solidity.
- 218.4 The remainder of the trench may be filled in with selected approved filling by hand or alternatively mechanical equipment if approved by the Engineer. Hand rammers and mechanical equipment shall be to the approval of the Engineer.

# 219 MAKING GOOD SUBSIDENCES AFTER REFILLING

219.1 All refilling whether over foundations or in pipe trenches shall be thoroughly compacted by ramming and any subsidence due to consolidation shall be made up by the Contractor at his own expense with extra compacted material. Should subsidence occur after any temporary or permanent surface reinstatement has been completed the surface reinstatement shall first be removed the hollows made up and then the surface reinstatement re-laid.

## 220 REMOVAL OF TIMBER FROM EXCAVATIONS

- 220.1 Timbering shall be removed from the excavations before or during the process of refilling except in so far as this removal of timber would be likely to cause damage to adjacent property structures or structure foundations in which event the Contractor shall leave in the excavations which event the Contractor shall leave in the excavations such timber as he considers necessary to prevent damage the proper repair or which the Contractor shall be solely responsible for in the event of any such damage occurring.
- 220.2 Except as provided for below no extra payment will be made for timber left in excavations and the Contractor will be deemed to have allowed for this contingency in pricing his Tender. The Engineer will however certify for payment in respect of such timber does not arise from any negligence of the Contractor.

# 221 REINSTATEMENT OF SURFACES

- 221.1 All surfaces whether public or private who are affected by the works shall be reinstated temporarily by the Contractor in the first instance and in due course when the ground has consolidated fully he shall reinstate the surfaces permanently.
- 221.2 The temporary reinstatement and maintenance and permanent reinstatement and maintenance of all surfaces of roads streets paths fields, verges gardens and any other surfaces which have been affected by the operations of the Contractor shall be his sole liability and shall be carried out to the satisfaction of the Engineer and of the responsible authority.

- 221.3 Temporary reinstatement shall be carried out immediately the trenches are refilled.
- 221.4 Permanent reinstatement shall not be carried out until the ground has consolidated completely and the Contractor shall apply to the Engineer for permission to carry out this work in the event of further settlement occurring after the completion of the permanent reinstatement and during the currency of the Contract the Contractor shall forthwith make good the reinstatement to the approval of the Engineer or responsible authority.
- 221.5 For the purposes of temporary and permanent reinstatement roads tracks and footpaths the surface width of trenches shall be increased by 150mm on each side of the trench for a depth of 75mm to provide a solid abutment for the surfacing material.
- 221.6 Materials forming the surface and foundations of roads, tracks and footways (Clause 215) may if they are approved by the Engineer be used by the Contractor in the temporary reinstatement of surfaces. The contractor shall provide additional materials necessary for the reinstatement.
- 221.7 In verges and other grass surfaces and after the refilling has been thoroughly consolidated the topsoil shall be re-laid rolled planted with grass as may be necessary watered and attended until the grass has become well established. Should the grass fail it shall be replanted as required until a satisfactory growth is obtained.
- 221.8 Trenches in fields and gardens shall be reinstated to the condition in which the field or garden was before excavation was commenced. The final surface of the trench shall be flush with the surrounding ground.
- 221.9 The Contractor shall take all necessary precautions to ensure that no toxic materials which may cause damage to vegetation or livestock or pollute streams or watercourses are used in any temporary or permanent reinstatement and shall indemnify the Employer against any claims arising out of the use of such materials.
- 221.10 If at any time any trench becomes dangerous the Engineer shall be at liberty to call on the Contractor to restore it to the proper condition at 3 hours' notice.
- 221.11 If the work of reinstatement as carried out by the Contractor is not to the satisfaction of the Engineer and/or the responsible authority and should the Contractor not remedy the defect forthwith any remedial work considered necessary may be undertaken by the Employer and/or the responsible authority at the Contractor's expense.

# 222 FORMING BANKS AND FILLED AREAS

- 222.1 The Engineer shall mark Banks and filled areas.
- 222.2 Before any filling is started the ground on which embankments are to be sited shall be stripped of all grass and topsoil and all roots vegetable matter and other unsuitable substance removed.
- 222.3 The filling to be used in the embankments and filled areas shall be selected material approved by the Engineer's Representative from that arising surplus form excavation, the material being placed according to its nature as shall be directed, that is, coarse hard material may be placed at the bottom with the fine material and/or soil placed at the top or at the surface.
- 222.4 The filling shall be placed in layers not exceeding 150mm thick each layer being thoroughly compacted by an approved vibratory roller to the satisfaction of the Engineer. Each layer of fill shall be compacted to an average of 95% of Proctor Maximum Dry Density.
- Where water has to be added to achieve the optimum moisture content it shall be applied in an even manner. The rate of application shall be such that no transverse or longitudinal flow occurs. The previously compacted surface shall be prevented from drying out by watering prior to placing of next layer.
- 222.6 Where directed by the Engineer that rock shall be used as filling to Embankments, the rock shall be placed in the bottom of the embankment or as directed by the Engineer's Representative. The largest portions of the rock shall be placed in layers the maximum depth of which shall be 0.5m, the interstices filled with the finer material and the whole layer compacted by an approved method.

More fine material shall be added and the layer again compacted until the voids are completely filled.

222.7 All earth moving, placing of fill material, watering, borrowing, and compacting shall be carried out as separate operations to give a clear and controlled method of working.

#### 223 SOILING

222.8 Where required surfaces shall be soiled with fine sifted soil or silt not less than 100 mm compacted thickness which shall be raked and brought to a fine filth. The Contractor shall supply approved material for this purpose.

#### 224 PLANTING

- 224.1 Surface required to be grassed except verges and other grass surfaces for which the Contractor is responsible in accordance with Clause 221 shall be planted with approved local grass at a spacing of 200m x 200 mm. The grassed areas shall be replanted if the first or subsequent operation is unfruitful or if for any reason the grass is destroyed. Grassed areas shall be watered and attended until the grass has become well established.
- 224.2 The soiling and planting of the grass in sloped shall be carried out immediately the slope is formed and the grass shall be kept weeded and cut until the work is accepted at the time of the Certificate of Completion

#### 225 DISPOSAL OF SURPLUS EXCAVATED MATERIAL

- 225.1 All surplus excavated material shall be disposed of to tips to the approval of the Engineer.
- 225.2 The cost of disposing of surplus excavated material included any specified soiling and grassing shall be allowed for in the rates for excavation.

#### 226 FREE DRAINAGE FILL

226.1 Free draining fill for use as backing to walls shall consist of sound hard stone or broken rock or concrete derived from demolition of structures. The particles shall be roughly cubic form and shall be between 75 mm and 25 mm in size. All smaller particles dust rubbish and organic matter shall be excluded.

### 227 GRADED GRAVEL FOR DRAINS

227.1 Graded gravel surround to drains shall be clean washed stone or crushed hard rock graded between 20 mm and 5 mm or as specified in the BoQs.

### 228 ROCK PITCHING

228.1 Rock pitching shall consist of a free draining mixture of broken hard stone obtained from quarries approved by the Engineer which shall have a maximum size of 3000 mm and which shall not contain more that 5% by weight of material which will pass a 10mm B.S. sieve. Between these limits the material shall be reasonably well graded so as to form a free draining blanket without large voids.

# 229 FORMATION OF FOOTPATHS

229.1 The ground footpaths shall be trimmed to formation level and 50 mm thick precast concrete slabs shall be bedded on 50mm thick layer of fine sand.

#### 230 REINSTATEMENT OF TRENCH SURFACES IN ROADS

- 230.1 Materials for both temporary and permanent reinstatement of trenches in road verges, tracks and unmade roads shall be excavated material selected to form a surface similar to the adjoining surface. The surface shall be well compacted.
- 230.2 Temporary reinstatement of trenches in surfaced roads shall comprise a layer of compacted hardcore, of minimum thickness 150 mm, topped with a 75 mm layer of surface material taken from the original surface material taken from the original surface together with any additional material to form a satisfactory running surface. The surface shall be well rolled and sealed with a coat of approved cold applied bituminous emulsion, applied with an approved sprayer at the rate of about 2 litres/m2. The emulsion shall be blinded immediately with quarry dust or sand approved by the Engineer's Representative and then rolled with an 8 ton roller.

- 230.3 The quality and grade of bitumen shall be suitable for the climatic conditions of the area and shall otherwise conform to BS 434.
- 230.4 Permanent reinstatement of surfaced roads shall be carried out to the approval of the competent Authority but shall in no way be inferior to that specified elsewhere in the Specification for base of wearing courses to road works. In all cases, the top layer of the temporary reinstatement shall be removed to expose the compacted hardcore which shall be topped up and re-rolled as necessary.

# **SECTION 3**

# **CONCRETE**

# **INDEX**

301	GENERAL36	
302	CONCRETE	
302.1	Requirements	38
302.2	Strength	
302.3	Mixes	
302.4	Quality Control	42
302.5	Production	
302.6	Cement	44
302.7	Aggregates	45
302.8	Water	
302.9	Admixtures	
303	REINFORCEMENT47	
303.1	Steel	47
303.2	Storage	48
303.3	Bending and Fixing	
303.4	Couplers for Reinforcement	
304	SHUTTERING50	
304.1	Requirements	50
304.2	Sawn	
304.3	Wrought	52

304.4	Special Wrought52
304.5	Tolerances
304.6	Striking and Removal53
304.0	Striking and Removal
305	CONCRETING54
305.1	Requirements54
305.2	Transporting54
305.3	Placing and Compaction55
305.4	Cold Weather58
305.5	Hot Weather
305.6	Wet Weather
	II.1. Conition on 1 Finish and (0)
305.7	Holes, Cavities and Fixings
305.8	Protection and Curing
305.9	Joints64
	Finishes
305.11	Surface Finishes
305.12	Making good69
	Removal and Replacement69
306	TESTING69
306.1	Sampling and Testing69
306.2	Loading Tests70
307	SPECIAL CONCRETE71
307.1	No-Fines71
307.1	Air-Entrained71
307.2	Benching
307.4	Ready Mix
307.5	Granolithic
307.6	Pneumatically Applied Mortar (Gunite)72
307.7	Pumped Concrete74
308	PRECAST CONCRETE74
308.1	Requirements74
308.2	Weir Blocks and Sills
308.3	Coping Blocks and Weir Blade Holders75
308.4	Kerbs
308.5	Pavin Slabs
308.6	Other Blocks
308.7	Wall Units76
308.8	Other Items76
309	SITE BOOKS AND STANDARDS76
309.1	Instructions to be recorded
309.1	
309.2	Site Diary
309.3	Copies of Standards and Codes
310 W	ATER RETAINING STRUCTURES-SPECIAL
	AUSES
	,
310.1	Making good77
310.2	Construction Joints in Water Retaining Structures77
310.3	Water tightness of Structures
3A.1	TESTING OF WATER-RETAINING STRUCTURES78
$J\Pi$ . I	ILDITIO OF WAILK-KETAINING STRUCTURES/0

0112	STRUCTUE	RES	78
TABLI	ES		79
3.8	Samplir	g, Testing and Acceptance Standards	80
301	GENERAL		
301.1 current		of materials and of workmanship shall not be in	ferior to the recommendations of the
(a)	The Structural	use of Reinforced ) whichever all dings and CP110 – The ) applicable of Concrete. ) to the Or British Standard Code of Practice BS 5337 The Structural Use of Concrete for Retaining Aqueous Liquids and Appropriate British Standards or Approved Kenya Bureau of Standards or Ministry of Works Standards, if any. Or Other equivalent and approved international standards.	) particular ) structures )

CLEANSING AND STERILIZING WATER-RETAINING

The requirements outlined in the above documents must be read with those of this Section of the Specification and where any conflict exists between the recommendations of the above and of this Specification, the requirements of this Specification shall prevail.

- 301.2 As and when required by the Engineer the Contractor shall prepare and submit, before commencing the work, a time-chart (additional to the general programme) detailing the various operations for concrete work.
- 301.3 No material shall be used in the Works until prior approval for its use has been given by the Engineer; neither shall any change in the nature, quality, kind, type, source of supply or manufacture be made without the Engineer's permission.
- 301.4 Names of manufacturers and test certificates for materials not supplied by the Employer shall be supplied as soon as possible to the Engineer.
- 301.5 The cost of providing samples and the cost of carrying out tests required by 306.1 (except as otherwise provided in the Conditions of Contract) together with the cost of supplying equipment for sampling and site testing indicated in columns 3 and 4 of Table 3.7 of this section of the Specification shall be borne by the Contractor (see also Clause 306.1)
- 301.6 During the progress of the Works, consignment notes for materials not supplied by the Employer shall be supplied to the Engineer giving details of each consignment.
- 301.7 The use of the word "approved" in this Specification refers to the approval of the Engineer.
- 301.8 Cross references between certain Clauses of this Specification have been shown in brackets following particular item.

#### **302 CONCRETE**

3A2

# 302.1 Requirements

302.1.1 The mix proportions shall be selected to ensure that the workability of the fresh concrete is suitable for the conditions of handling and placing, having regard to the structural element being constructed, the

disposition of reinforcement, the climatic conditions prevailing and the limitations set by Table 3.1 of this Clause for the particular class of concrete specified.

302.1.2 Notwithstanding the strength requirements of this Specification, in order to ensure adequate durability of the finished concrete, while at the same time limiting its shrinkage characteristics, the limits shown in Table 3.1 shall not be exceeded.

302.1.3 In all cases of mix proportioning, the added water shall be included with due allowance for the moisture contained in the aggregates and shall be the minimum consistent with the workability requirements. Where difficulty is experienced in maintaining the correct workability for the water-cement ratio outlined in Table 3.1 the use of a water reducing additive may be permitted subject to Clause 302.9

302.1.4 Where aggregates do not conform to the moisture requirements of Clause 21.2 of BS 5337 but are permitted for use, in the case of liquid retaining structures the water content indicated in Table 3.1 shall be reduced by 2.5 litres per 50 kg of cement.

Minimum Cement Content Kg/m3 finished Concrete (Cl.49 BS 5337) OPC Sulphate Resisting cement Aggregate W/C Aggregate W/C 40 mm 20 mm 40 mm 20 mm Liquid Retaining Surface Structures A 320 360 0.50 As for Ordinary Portland Cement (OPC) Liquid Retaining Substructures Building Foundations В 260 290 0.55 Protected Building Structures\* C 220

Exposure

Type of Structures

250 0.60

# Type of Structure

Exposure to Sulphate Condition Minimum Cement Content Kg/m3 finished concrete

#### OPC

**Sulphate Resisting Cement** 

Total 50% 3 Parts per 100 000 in ground water Aggregate W/C Aggregate

W/C

40 mm 20 mm 40 mm 20 mm

#### Substructures

And

**Foundations** < 0.2 240 0.55 < 30 280 0.2 - 0.530-120 290 240 280 330 0.5 0.55 0.5 - 2.0250-500 290 330 0.5 1.0-2.0 250-500 330 370 0.45 >2.0>500 Ditto with

Protective coating

# 302.2 Strength

302.2.1 The basis for assessing the strength of concrete shall be related to the characteristic strength, defined as the strength of the concrete at 28 days, as determined by the standard method of testing (Clause 306.1) below which not more than 5% of the test results shall fall.

302.2.2 The relationship between the class of the concrete and the characteristic strength shall accord with Table 3.2

TABLE 3.2 : Concrete Strength Requirements

Location Coarse Aggregate
Class and Characteristic Strength N/mm2

Size (mm) 28 Days

Target Strength

7 days

**Blinding Concrete** 

Blinding Concrete Sulphate Condition

Substructures thickness less than 400m

Substructures walls and slabs more than 400m

Superstructures normal concrete

or

67. Fine Concrete

**Precast Concrete** 

<sup>\*</sup>Not exposed to liquid or moist or corrosive conditions

Prestressed Concrete:

Post-tensioned tendons

Structural concrete in water towers – all components 20 or 40

302.3 Mixes

302.3.1 If, in the opinion of the Engineer, the Prescribed Mix method of proportioning will not produce concrete to satisfy the requirements of this Specification, the mix shall be designed.

# (a) Designed Mixes

Proportions shall be determined in accordance with the "Design of Normal Concrete Mixes" published by the British Department of the Environment and obtainable from:-

The Government Bookshop, P.O. Box 569, London, ENGLAND SE1 9NH

or other approved methods, for the requirements set out in Clause 302.1 and 302.2

For the purpose of determining the design mean strength of the concrete a margin shall be added to the characteristic strength (indicate in Table 3.2) for the particular class of concrete. This design margin shall be assessed on the degree of control reasonably to be expected in the manufacture of the degree of control reasonably to be expected in the manufacture of the concrete and shall not be less than 7.5 N/mm2 nor less than 1.64 times the standard deviation. Until such time as the standard deviation has been assessed the margin shall not be less than 15 N/mm2 .

Details of the designed mixes shall be forwarded immediately to the Engineer for his approval.

#### (b) Prescribed Mixes

Proportions for the several classes of concrete shall conform to the requirements of Table 50 of CP 110.

# (c) Nominal Mixes

Nominal mix proportioning is applicable only to non-structural concrete Class 10 and Class 15 and in special cases when permitted by the Engineer for the other classes of concrete. Proportions shall conform to the requirements of Table 3.2.1

# (d) Chloride Content

The total chloride content of the concrete mix shall comply with the requirements of CP 110 Cl. 6.3.8 (as amended November 1980)

# TABLE 3.2.1: Nominal Mix Proportions

Class of Concrete
30 or 30(s)
25 or 25(s)
20 or 20(s)
15 or 15(s)
10 or 10(s)
1 : 1 : 2
1 : 1.5 : 3
1 : 2 : 4
1 : 3 : 6
1 : 4 : 8

# 302.4 QUALITY CONTROL

- 302.4.1 The principal basis of control shall be by comparison of the results of the compression cube tests at 28 days, except for small quantities of concrete whose strength can be otherwise derived and which is permitted for use by the Engineer. 40 sample cubes shall be made initially in eight samples each day for five days of concreting and thereafter one sample in 25 mixes or not less than one for each day's concreting.
- 302.4.2 Where materials are of an unfamiliar grading or type, compression tests shall be carried out at 7 days and adjustments made in advance of the main control methods outlined above.
- 302.4.3 Cube test results will be examined individually in 10 consecutive sets of four and the standard deviation and mean strength of each set calculated. The concrete mix proportions will only be acceptable if all of the following requirements are complied with:-
- (i) not more than two results in 40 are less than the characteristic crushing strength
- (ii) no value of the average of any set of four results is less than the characteristic strength plus one-half of the design margin (Clause 302.3)
- (iii) when 40 results have been obtained and the mean strength and standard deviation are calculated, the mean strength minus 1.64 times the standard deviation shall be greater than the characteristic strength.
- 302.4.4 Where the results do not confirm to the requirements the following action shall be taken:-
- (a) Adjustments to the mix shall be made to obtain the strength required.
- (b) In the case where any result is less than 80% of the characteristic strength in accordance with Clause 305.1. For those prescribed mixes required to be tested, requirements (i) and (ii) only will be applicable.

# 302.5 Production

- 302.5.1 Aggregates and cement shall be proportioned by weigh-batching, and water shall be proportioned by volume. Subject to the prior approval of the Engineer volume-batching of aggregates may be used for small sections of work, but volume batching of cement will in no case be accepted. The Contractor may, however, so proportion the mix that each batch shall use a whole bag or bags of cement, the weight of which is known precisely. Where permission has been given for volume batching of aggregates, all gauge boxes shall be accurate and due allowance shall be made for bulking of the aggregates in assessing the correct volume to be used. (Clause 602 of CP 114).
- 302.5.2 The aggregates and the cement shall be thoroughly mixed in a clean mechanical mixer for a period of time agreed with the Engineer and the water added on the basis of the approved design.
- 302.5.3 The amount of water added shall conform to the requirement of Clause 302.1
- 302.5.4 Batch mixing machines shall comply with the requirements of BS 1305. They shall be provided in such numbers and of such capacity as to ensure a continuous supply of freshly mixed concrete at all times during construction.
- 302.5.5 Continuous mixing machines shall be used only with the written permission of the Engineer.
- 302.6 Cement
- 302.6.1 Ordinary and Rapid-hardening Portland cement shall comply with BS 12.
- 302.6.2 Sulphate resisting cement shall comply with BS 4027
- 302.6.3 High Alumina, super sulphated, pozzolanic, low heat, blast-furnace or other cements shall only be used as directed by the Engineer. They shall not be considered within the scope of this Specification but shall be subject to the requirements of a supplementary specification when required to be used.
- 302.6.4 No extra payment will be made to the Contractor if on his own initiative he used Rapid-hardening Portland cement.

- 302.6.5 Cement shall be fresh when delivered to Site and the consignments shall be used in the order of their delivery. The Contractor shall mark the date of delivery on each consignment and each consignment shall be stored separately and in such manner as to be easily accessible and identified.
- 302.6.6 No cement in bags or other containers shall be used unless these and the manufacturer's seals are intact at the time of mixing.
- 302.6.7 If the cement is delivered in bags it shall be stored in a waterproof shed or building at a temperature of not less than 80C and the bags shall be placed on dry boards above the floor to prevent deterioration or contamination from any cause.
- 302.6.8 Bulk cement may be used provided it is stored in an approved container.
- 302.6.9 The Contractor shall not use cement which has hardened into lumps, but subject to removal of the lumps by screening, the Engineer may allow such cement to be used in non-structural concrete mixes.
- 302.6.10 Cement of different types shall be kept separate in storage and shall not be mixed together in the production of concrete.
- 302.7 Aggregates
- 302.7.1 Fine and coarse aggregates shall be as defined by and be of the quality and nature required by BS 882 and BS 1201 whichever is applicable. In addition they shall be chemically inert to alkali reaction.
- 302.7.2 Aggregates shall conform to the requirements of the "Accepted Standards" of Table 3.8.
- 302.7.3 Aggregates of rounded shape or otherwise capable of producing a concrete of good workability with the minimum addition of water shall be preferred.
- 302.7.4 The Contractor shall ensure that the nature and gradings of aggregates remain reasonably consistent, and shall, if necessary, stockpile and include different gradings to ensure that the overall grading remains constant for each section of the works.
- 302.7.5 Dust or flour resulting from crushing the aggregate shall not be allowed to contaminate the stockpiles. When, in the opinion of the Engineer such contamination has taken place it shall be removed by an approved means or otherwise the aggregate shall be rejected.
- 302.7.6 For mass concrete, in order to improve the consistency of the mix, dust or flour resulting from crushing the aggregate, may, subject to test, be included in controlled quantities to supplement the fine aggregate.
- 302.7.7 The aggregates of various sizes shall be kept separate and away from all possible contamination and shall be stored on a hard-standing area or in bins, provided with proper drainage at the base of the stockpiles.
- 302.7.8 Except where aggregates have been otherwise specified on the Drawings the grading of aggregates shall be as follows:

# Coarse Aggregate:

- (a) 10mm max. size, graded, for all "fine" concrete
- (b) 20mm max. size, graded for all reinforced concrete in beams and for walls and slabs not greater than 400mm thick.
- (c) 40mm max. size, graded, for all reinforced concrete walls and slabs in excess of 400mm thick.

# Fine Aggregate:

- (a) Where aggregates conforming to zones 2 or 3 of BS 882 are available they shall be used.
- (b) For prescribed mixes, zones 1,2, or 3 aggregates only shall be used.
- 302.7.9 Sea-dredged Aggregates

Where sound land deposits are readily available locally they shall be used in preference to seadredged aggregates. Where however this situation does not exist, the following requirements for the use of sea-dredged aggregates shall apply in addition to those of Clause 302.7 foregoing.

#### TABLE 3.3: Shell Content

The shell content shall not exceed the following values:-

Nominal Size of Aggregate mm

% by weight of dry aggregate of shell as calcium carbonate

	Normal Reinforced Concrete Work				Liquid Retaining Structures	Main Concrete Work
75	Nil	Nil	Nil			
40	5	2	5			
20	10	5	10			
10	15	15	15			
Fine Aggregate 40 30		30	40			

Hollow shell shall not exceed one half of the total shell content by weight of 20mm and 40mm sizes.

#### TABLE 3.4 : Sodium Chloride Content

The sodium chloride content shall not exceed the following values:-

% Sodium Chloride content by weight

Of Dry Aggregate

Of Cement

Normal Reinforced Concrete Work Liquid Retaining Structure Normal Reinforced Concrete Work Liquid Retaining Structure

Coarse Aggregate

0.05

0.03

0.50

0.32

Fine Aggregate

0.15

0.10

Calcium chloride or calcium chloride-containing cements shall not be used with sea-dredged aggregates (C1.302.9)

Cements other than ordinary or rapid-hardening Portland complying with BS 12 and sulphate-resisting complying with BS 4027 shall not be used with sea dredged aggregates.

Where the use of sea dredged aggregates is shown materially to affect the rate of setting of the concrete, the Engineer may require the Contractor to include an approved admixture in the mix at no extra cost (C1.302/9)/

302.8 Water

- 302.8.1 The Contractor shall supply all water, make all arrangements, and pay all charges in respect of such supply. Where water can be obtained from a public water supply it shall be used.
- 302.8.2 Where water cannot be obtained from the public supply it shall be tested in accordance with BS 3148 and if necessary shall be treated to assure compliance therewith.
- 302.8.3 Water for washing and curing shall be such that it will impair neither the strength of the finished concrete nor its appearance.

#### 302.9 Concrete Admixtures

- 302.9.1 Before approval for the use of a proprietary admixture is given the Contractor will be required to satisfy the Engineer as to its suitability for the work and its compatibility with the cement it is intended to complement.
- 302.9.2 Preference will be given to the use of admixtures which can be administered in fixed calibrated amounts through a mechanical dispenser or cachet, and which are added directly to the mixing water.
- 302.9.3 Where approval is given for the use of more than one type of admixture for the same concrete mix they shall be dispensed separately.
- 302.9.4 In all cases the Contractor shall ensure that careful control s exercised in maintaining correct proportions as laid down by the formulators. Where incorrect proportioning has been carried out, or where the admixture can be shown to have adversely affected the finished concrete, the work shall be treated in accordance with C1.305.13.
- (a) Water-reducing admixtures The Contractor shall include an approved water-reducing admixture (plasticiser) where, in the opinion of the Engineer, the workability of the mix is otherwise inadequate to achieve an acceptable compaction and/or surface finish, or where excessive bleeding of the concrete is in evidence.
- (b) Air-entraining admixtures Refer to Clause 307.2
- (c) Set-retarding admixtures Where large quantities of concrete are to be placed at any one time or where concreting is undertaken under hot conditions, the Contractor may include an approved set-retarding admixture to reduce the heat of hydration and to enable work to be properly finished before premature setting has taken place.

Where sea-dredged aggregates are used the Engineer may require an approved set-retarding admixture to be included in the mix (C1.302.7.9)

- (d) Set-accelerating admixtures The Contractor shall not use set-accelerating admixtures in in-situ concrete construction except for cold weather concreting (C1.305.4) or where expressly permitted by the Engineer for a specified purpose.
- (e) Calcium chloride admixtures or ingredients included in propriety type cements shall not be used in reinforced concrete or pre-stressed concrete work.

#### 303 REINFORCEMENT

303.1 Steel

#### 303.1.1 Reinforcement shall be:

- (a) Plain round mild steel or High Yield steel bars confirming to BS 4449.
- (b) Cold worked steel bars conforming to BS 4461 or
- (c) Fabric reinforcement made of cold drawn high tensile bars conforming to BS 4483.
- 303.1.2 The Contractor shall obtain from his supplies certificates of the mechanical and physical properties of the reinforcement and shall submit them to the Engineer for approval, except where reinforcement has been supplied by the Employer. The frequency of sampling and the method of quality control shall be in accordance with Table 4 and Clause 20 respectively of these British Standards. All high yield and cold worked bars (except in welded fabric reinforcement) shall be deformed bars complying with classification Type 2 for bond strength in accordance with Classification Type 2 for bond strength in accordance with BS 4449 and BS 4461. Where galvanised reinforcement is specified, galvanizing shall comply with the requirements of BS 729, Part 1.

#### 303.2 Storage

Reinforcement shall be stored on Site under cover and supported clear of the ground and in such manner as to make identification easy. Supports shall be such that distorting of the steel is avoided and contamination and corrosion prevented.

- 303.3 Bending and Fixing of Reinforcement
- 303.3.1 The Contractor shall provide on site facilities for cutting and bending reinforcement whether he is ordering his reinforcement bent or not and shall ensure that a token amount of straight bar is available on Site for bending as and when directed by the Engineer.
- 303.3.2 Reinforcement shall be wire brushed and cleaned at the Contractor's expense, before and/or after it is placed in position, if required by the Engineer.
- 303.3.3 The bars shall be cold bent in strict accordance with the drawings and the Contractor shall be responsible for the accuracy of the bending. Bending dimensions shall be worked to the tolerances indicated in BS 4466 and CP 110 Table 20. Bars in which any errors in bending are beyond the limits of the foregoing tolerances shall be replaced at the Contractor's cost by correctly bent new bars, or, may be straightened and rebent cold subject to the Engineer's prior approval. Any discrepancy or inaccuracy found in the drawings shall be notified to the Engineer immediately.
- 303.3.3 After assembling, reinforcement shall be securely bundled and labelled with weather-proof tags or shall be marked with other approved signs by which it can readily be identified.
- 303.3.4 After bending, reinforcement shall be securely bundled and labelled with weather-proof tags or shall be marked with other approved signs by which it can readily be identified.
- 303.3.5 Before assembling or fixing the reinforcement the dimensions to which it has been bent shall be checked by the Contractor against the drawings
- 303.3.6 The reinforcement shall be fixed in strict accordance with the Drawings as regards cover, spacing and position, and suitable precautions shall be taken by the Contractor to prevent the displacement of reinforcement during the placing and compaction of concrete.
- 303.3.7 Where required to support and retain the reinforcement in its correct position the Contractor shall provide templates stools or other supports at his own cost. He shall allow for cutting to correct length all corner lacer bars included in the bar schedules as standard lengths.
- 303.3.8 Precast concrete support blocks for reinforcement shall be manufactured from Class 30 "fine" concrete to ensure the correct cover thickness. They shall be well cured before use and carefully stored on Site to avoid contamination. Plastic and metal supports, chairs, etc. may be used subject to the Engineer's prior approval.
- 303.3.9 In the case of mild steel, a lap of not less than 40 diameters of the smaller bar shall be provided at the junction of two bars for which the lap is not specifically detailed on the drawings and, in the case of High Yield steel, a lap of not less than 50 diameters.
- All intersections of bars in walls and slabs and all connections between binders or links and main bars in columns or beams shall be tied with soft iron wire ties or with fixing clips which shall not be allowed to make contact with the shuttering or to project materially into the specified cover.
- 303.3.11 Unless permitted by the Engineer, welding of bar reinforcement at intersections or for he joining of bars is prohibited. Where permission is granted, welding shall be carried out in accordance with the recommendations of the Institute of Welding for the welding of reinforcing bars for reinforced concrete construction.
- When fixed reinforcement is to be left exposed for a delayed period of time, it shall be thoroughly cleaned and painted with neat cement grout.
- Where galvanised reinforcement is used any damage suffered by galvanising shall be made good by the application of an approved galvanising formulation, before concrete placing is commenced.

# 303.4 Couplers for Reinforcement

Couplers for reinforcement shall be either Standard Swaged Splices or Type II Alpha Couplers manufactured by CCL Systems Limited, Cabco House, Ewell Road, Surbiton, Surrey, KT9 7AH, UK., or similar approved. Where bars of different diameters are to be joined a CCL Reducer Sleeve or similar shall be used.

Couplers shall be suitable for the type and size of reinforcing bars and shall be capable of developing 15% of the characteristic strength of the smaller of the compression. Couplers shall be installed in accordance with the manufacturer' recommendations. Square twisted reinforcing bars shall not be used with couplers.

#### 304 SHUTTERING

- 304.1 Requirements
- 304.1.1 The term "shuttering" shall be taken to include centering, formwork, strutting, bracing and the like.
- 304.1.2 When called upon to do so by the Engineer's Representative the Contractor shall submit his shuttering proposals for checking and approval by the Engineer in advance of the concreting.
- 304.1.3 Shuttering shall be of such accuracy, strength and rigidity as to carry the weight and pressure from the concrete to be placed on or against it, together with all constructional, wind or other loads likely to be imparted to it, without producing deformation of the finished concrete in excess of the tolerances outlined in Clause 304.5 and Table 3.5.
- 304.1.4 All shuttering shall be sufficiently tight, without plugging, to prevent loss of grout during the vibration of the concrete. When required by the Engineer joints between shutter facing boards shall be sealed with foam rubber, sealing strips or other approved material.
- 304.1.5 Faces of shuttering shall be clean, Faces of shuttering shall be clean, free from projecting nails, adhering grout and other imperfections or defects which would prevent the specified surface finish from being attained. They shall be treated with approved mould oil before positioning. Great care shall be exercised to prevent reinforcement or steelwork from being contaminated by the oil during erection of the shuttering.
- 304.1.6 Shuttering, which as a result of prolonged use of general deterioration does not, in the opinion of the Engineer, conform to the particular requirements set out in this clause, shall not be used.
- 304.1.7 Through-bolts or ties will not be permitted in liquid-retaining structures. The Contractor shall use only such bolts or ties as are capable of being removed in whole or in part so that no part remaining embedded in the concrete shall be nearer the surface of the concrete than the specified thickness of cover to the reinforcement.
- 304.1.8 Beam soffits shall be erected with an upward camber of 5mm for each 3 metres of span.
- 304.1.9 Top shuttering shall be counterweighted or otherwise anchored against flotation.
- 304.1.10 Boxes for forming holes shall be constructed so as to be easily removable without damaging the concrete during removal. They shall be properly vented to permit the escape of entrapped air, and shall be capable of being sealed, subsequently to prevent the loss of grout. The use of polystyrene blocks for the forming of holes, sinking, etc. will not be allowed except by express permission of the Engineer.
- Openings for inspection of the inside of beam, wall, column, and similar shuttering and for cleaning-out purposes shall be formed so that they can conveniently be closed before the placing of concrete.

  All props shall be supported on adequate sole plates and shall not bear directly on or against concrete. They shall be capable of being released gently and without shock from the supported shuttering. No appliance for supporting the shuttering shall be built into the permanent structure without the Engineer's prior approval. Props for upper level support shall be placed directly over those at lower levels, and the lowermost props shall bear upon work sufficiently mature to carry the load.
- 304.1.13 Shuttering shall be such as to allow for its removal without damaging the concrete, and in the case of suspended floors, for the removal of the beam sides and slab soffits without disturbing the beam sides and slab soffits without disturbing the beam bottom boards and their props.
- Before concreting, the areas which are intended to receive the concrete shall be cleaned by jetting with compressed air, and all water and extraneous material removed.
- Where timber is used for shuttering it shall be properly cured, free from warp, straight, clean, and free from loose knots.

- Where metal forms are used for shuttering they shall be of the type strengthened by intermediate ribs or cross bracing.
- 304.1.17 Moving shuttering may be used where in the opinion of the Engineer it is appropriate.

# 304.2 Sawn Shuttering

Rough finish shuttering shall produce an ordinary standard of finish consistent with normal good practice for use where the face of the finished concrete will not be exposed. The face in contact with the concrete shall consist of sawn timber boards, sheet metal or other approved material.

# 304.3 Wrought Shuttering

Wrought shuttering for use on internal exposed faces and water retaining faces shall produce a high standard of finish consistent with the best practice. The face in contact with the concrete shall consist of wrought and thickened boards tongued and grooved of not less than 30mm finished thickness, framed plywood or metal panels or other approved material. Joints between boards and/or panels shall be arranged in a uniform pattern

# 304.4 Special Wrought Shuttering

Special wrought shuttering shall provide the highest standard of finish where the face of the finished concrete is to form a particular feature. The face in contact with the concrete shall consist of large smooth sheets, unless otherwise specified, arranged in an approved uniform pattern, with joints coinciding with possible architectural features, sills, window heads, or changes in direction or surface. Accurate alignment of all joints shall be maintained. Wrought boarding and standard steel panels shall not be used unless specially faced.

#### 304.5 Tolerances

Unless otherwise indicated on the Drawings, the tolerances of the finished concrete with respect to the dimensions shown on the drawings shall not exceed the limits set out in Table 3.5.

Table 3.5: Tolerances of Dimensions for Finished Concrete

Items Tolerance (mm)		
Overall dimensions and levels		
Column Sizes ) Beam Sizes )		
Wall Sizes )		
Vertical lines out of plumb	+ 5	
5mm + 5mm in every 15m ht.		

Except that in the case of Rough Finish Shuttering the dimensions of the finished concrete shall be not less than those shown on the Drawings.

# 304.6 Striking and Removal of Shuttering

304.6.1 The recommendations set out in Table 3.6 are given as a minimum requirement for striking shuttering:-

#### TABLE 3.6: Striking of Shuttering

Item Ordinary Portland Cement

Normal Weather 160C
Days Rapid-Hardening Cement

Normal Weather 160C Days

Beam Sides, Walls, Columns
Slabs (props left under)
Beam soffits (Props left under)
Removal of props to slabs
Removal of props to beams
1
4
7
8
16 1
3
5
5
8

304.6.2 The above striking times are for normal conditions and before deciding on the actual time for each case, the Contractor shall consider and extend the period as tabled if:-

- (a) the span of the structural member under consideration exceeds 6 metres for beams and 3 metres for slabs. An additional period of one day for each 500mm of additional span shall then be allowed;
- (b) the dead load of the structural member under consideration forms a large proportion of the total design load;
- (c) constructional loads coming on to the structural member under consideration are being placed soon after the concreting operations and these loads form a large proportion of the total design load;
- (d) the setting of the concrete has been retarded for any reasons;
- (e) the temperature falls below 80C. An additional period of half day shall be added for each day on which the temperature falls below

80C. For temperatures falling below 30C the additional period to be added shall be one day for each day on which the temperature falls below 30C;

- (f) any combination of the above points and other considerations which would call for such a precaution to be taken.
- 304.6.3 Information regarding paragraph (b) above will be supplied by the Engineer; any other design information relevant to be above shall be obtained by the Contractor from the Engineer.

## 305 CONCRETING

#### 305.1 Requirements

The finished concrete shall be dense, durable, impervious to the ingress of water, free from cracks and honeycombing, and resistant to wear and mild chemical attack. Special concretes will be the subject of their own particular sections of Clause 307.

- 305.2 Transporting of Concrete
- 305.2.1 Concrete shall be transported to the place of final deposit by approved means.
- 305.2.2 Barrows, spades and other equipment used in the process of transporting concrete shall be thoroughly cleaned before each day's work or after a long interruption and they shall be free from hardened concrete.
- 305.2.3 Concrete shall be transported as soon as possible after mixing, by methods which will prevent the segregation, loss or contamination of the ingredients.
- 305.2.4 Proper bridging arrangements for traffic over reinforcement shall be provided so that the reinforcement is not distorted, damaged or displaced.
- 305.2.5 Where approval is obtained for concrete to be conveyed by chutes, these shall have a slope (not exceeding 1 vertical to 2 horizontal) such as to ensure a continuous flow of concrete. Additional water shall

not be introduced to assist the flow. If deposition is to be intermittent the chute shall be arranged to discharge into a storage hopper. In no case will a clear fall of more than 1m be permitted at the discharge end of the chute.

305.2.6 Where approval is obtained for pumping the concrete, the pump manufacturer's recommendations shall be followed. The pumps used shall be adequate capacity and power to ensure delivery of a continuous supply. The Contractor shall provide adequate alternative arrangements for transporting the concrete in case of a breakdown of the pumping equipment. (see also Clause 307.7).

305.2.7 Wherever transport of concrete is interrupted for any length of time (periods over half an hour shall be treated as such) the chutes, pumps, pipes and any

Other means of distribution shall be thoroughly flushed out and cleaned. These shall also be flushed out immediately prior to resumption of concreting and shall be kept free from hardened concrete. All wash water used shall be discharged outside the shuttering and clear of any freshly placed concrete.

# 305.3 Placing and Compaction of Concrete

305.3.1 No concrete shall be placed until the Contractor has obtained approval to do so from the Engineer's Representative. When the Contractor intends to place concrete he shall inform the Engineer's Representative in sufficient time to enable him to inspect the reinforcement, shuttering, and surface on which the concrete is to be placed and the Contractor shall provide all facilities for such inspection.

305.3.2 Concrete shall be placed within 30 minutes of mixing, to uniform level, in layers not exceeding 500mm deep in such manner as to avoid segregation, and each layer shall be compacted by means of approved vibrators to form a dense material free from honeycombing and other blemishes. Compaction by hand may be used only with the prior approval of the Engineer.

305.3.3 Vibration time, the effective radius, and other vibration characteristics shall be in accordance with the vibrator manufacturer's recommendations.

305.3.4 If internal vibrators are used, they shall be withdrawn immediately water or a thin film of mortar begins to appear on the surface of the concrete. Withdrawal shall be carried out slowly to avoid cavitation. 305.3.5 Where two distinct batches of concrete, placed at different periods of time and forming part of the same concreting operation are required to be formed monolithically with each other, the more mature concrete shall be penetrated by the vibrator to a sufficient depth to effect plastic movement between the two batches. Where the concrete does not respond to the action of the vibrator, it shall be deemed to have set, and no further disturbance will be permitted. Unless otherwise instructed by the Engineer the condition shall be treated as for a "stoppage of work" and the marrying up of the two concretes shall be effected only when both concretes have properly set.

305.3.6 If shuttering vibrators are used, the shuttering shall be strong enough to withstand the forces of vibration.

305.3.7 Temporary or permanent stoppages of work shall be made only against stop ends (Clause 305.9).

305.3.8 Unless otherwise specified, before placing new concrete against concrete which has already hardened, the face of the older concrete shall be prepared by the removal of any laitance and loose aggregate, and shall be cleaned by a jet of compressed air.

305.3.9 When displacers are permitted to be used they shall be so placed that no displacer is within 300mm of any finished face or within 500mm of any other displacer. On completion of any lift, displacers shall be so arranged that they project for half their height above the surface.

# 305.3.10 Concreting in Deep Lifts

# 305.3.10.1 Limitations

Any height exceeding 2.5m from which concrete is poured into shuttering to form sections of wall will be considered within the terms of this Clause.

Deep lift construction will not be permitted where the reinforcing bars are to be placed closer than 100mm to one another in any direction or, where the clear width at the point of admitting the concrete between one layer of reinforcement and another (or in the case of singly reinforced walls between reinforcement and shutter) is less than 200mm.

The method shall only be used where trial sections revealed that, in the Engineer's opinion it can be

satisfactorily employed, in which case the requirements of this Specification shall apply except where they are in conflict with the requirements of this particular clause, when the latter shall prevail

# 305.3.10.2 Concrete

In order to prevent segregation of aggregates, concrete mixes shall be designed for increased cohesion, or, where suitable, on a gap-graded basis. The use of approved admixtures may be made to achieve this end (302.9).

At the same time, the mix shall be such as to limit the amount of bleeding in the concrete, and where in the opinion of the Engineer the quantity of free water rising to the surface is excessive, the mix shall be corrected before further concreting is undertaken.

In order to offset any increase in the water-cement ratio at the upper levels, the Engineer may require the concrete mix to be modified for the upper depositions.

A slump of 80mm shall not be exceeded.

#### 305.3.10.3 Reinforcement

In order that reinforcement is not distorted or displaced during construction as a result of it being used for gaining access in or out of the shuttering, all intersections of vertical and horizontal steel shall be properly fastened.

All obstructions caused by spacer blocks or chairs shall be eliminated so as to permit an unobstructed passage for the concrete to the bottom of the shuttering. The Contractor may use sliding timber spacers instead of fixed concrete or plastic spacer blocks to position the reinforcement.

# 305.3.10.4 Shuttering

In view of the high pressures to be expected from this form of construction extra attention shall be paid to the strength and stability of the shuttering, to the prevention of loss of grout, and to the prevention of displacement of adjacent panels.

The use of through-bolts and other accessories which might interfere with the free passage of concrete between and around the reinforcement shall be reduced to a minimum of the use of properly designed shuttering.

# 305.3.10.5 Concreting

Particular attention shall be paid to the concreting of the initial sections at the bottom of the shuttering to prevent segregation caused by rebound from the hard surface of the kicker, base and/or lower sections. The initial depositions shall therefore be made by using trunking methods, or by placing the concrete through openings formed in the sides of the shuttering. Such openings shall not be higher from the hard surface than 2.5m.

In order to reduce differential settlement, and consequently, cracking between two sections of concrete placed at different intervals of time, concreting between one section and another shall be carried out on a gap-construction basis (Clause 305.9). The gap shall subsequently be concreted in distinct lifts each not exceeding 2.5m in height. For the same reason, for concreting two adjacent sections placed at the same time but of different heights (e.g. where boxing out is included), the difference is height shall not exceed 15% of the height of the deeper section.

Concreting from the upper level of the shuttering shall be carried out in such manner as to ensure that concrete is admitted centrally between the faces of the shuttering.

For this purpose the Contractor shall make use of trunking or shall use funnel-shaped hoppers extending for a distance of not less than 1.5m into the shuttering. A sufficient number of such hoppers shall be provided, and/or they shall be capable of movement along the length of the shuttering, to enable the concrete to be placed in contiguous heaps at the base of the pour. Such heaps shall not exceed 460mm in height.

Where excessive bleeding is in evidence, the excess water shall be removed before placing further concrete (see sub-clause 305.3.10.2 of this clause).

#### 305.3.10.6 Compaction

Compactions shall be carried out where possible by manual operation of poker vibrators within the shuttering. Where this is not possible poker vibrators shall be suspended in sufficient numbers to ensure uniform compaction along the length of wall receiving the concrete, without the need for their withdrawal and reinsertion. The means of suspension shall be such that the vibrators may be progressively and systematically lifted as the concreting proceeds to ensure that every section of placed concrete is married into adjacent and underlying sections.

The use of vibrators to reposition deposited concrete is prohibited. Surface vibrators attached to the shuttering may be used only to supplement the main means of compaction.

- 305.4 Cold Weather Concreting (Using cement to BS 12)
- 305.4.1 No concrete shall be placed while the air temperature is below 50C without the permission of the Engineer.
- 305.4.2 In the event of the Engineer giving permission for concreting to be carried out when the air temperature is below 50C the following conditions shall apply:-
- (a) Concreting shall be at the sole risk of the Contractor and shall be carried out during the day only;
- (b) No structural concrete shall be placed on frozen ground;
- (c) No structural concrete shall be placed on frozen ground;
- (d) Concrete shall have a temperature of between 160C and 240 C on leaving the mixer and it shall be placed in position and compacted before its temperature has dropped to 50C. To effect this, pre-heating of the mixer, heating of mixing water to a temperature not exceeding 600C, and heating of aggregates to not exceeding 500C is permitted, but on no account shall cement be heated or admitted to the mixer until the aggregates and the water have been thoroughly mixed;
- (e) If the Engineer gives approval for the use of calcium chloride to accelerate the hardening, not more than 2% by weight of flake calcium chloride (calcium chloride to cement) shall be added. Where proprietary accelerators are used their proportions shall be adjusted to satisfy this requirement. In all cases the calcium chloride shall be dissolved in the mixing water before adding to the mix. Calcium chloride and proprietary accelerators shall not be used with other than Ordinary or Rapid Hardening Portland Cement, nor where seadredged aggregates are permitted to be used (Clause 302.7.9);
- (f) The placed concrete shall not be allowed to fall below 30C until it has thoroughly hardened. The provision of heaters, adequate covering the insulation shall be made as may be required to ensure this. Care shall be taken to prevent over-heating or carbonation of the concrete;
- (g) The period over which the precautions set out in (f) above shall apply (referred to as pre-hardening period) shall not be less than 3 days unless otherwise permitted by the Engineer. Concrete temperatures shall be taken three times each day, morning, noon and evening, each at two separate positions expected to give the least favorable results;
- (h) Concrete once placed shall not be subjected to curing techniques involving the application of water to the surface;

The use of steel shuttering, unless insulated, will not be permitted.

- 305.5 Hot Weather concreting (for temperatures above 20 Degrees Centigrade)
- 305.5.1 Concreting shall not be permitted if its temperature at placing is in excess of 300C. In order to maintain the temperature of the concrete below this value the following precautions shall be taken wholly or in part as instructed by the Engineer:-
- (i) All aggregate stockpiles, water lines and tanks as well as the mixer shall be protected from the direct rays of the sum:
- (ii) Coarse aggregate shall be cooled by constant watering where possible;
- (iii) Mixing water shall be cooled by the addition of ice to the storage tanks where necessary;
- (iv) Rapid-hardening cement shall not be used;
- (v) Where the above precautions are inadequate concreting shall be carried out during the cooler parts of the day or during the night as may be directed by the Engineer.
- 305.5.2 When the air temperature is above 200C loss of mixing water by evaporation shall be considered in arriving at the amount of water to be added to the mix (Clause 302.1). In order to maintain the water/cement

ratio within permissible limits an approved water-reducing agent shall be included in the mix (Clause 302.9). The maximum water/cement ratios indicated in Clause 302.1 may be increased with the Engineer's permission by 0.05) or 2.5 litres/50 kg of cement) during mixing, but on no account shall water be added to concrete directly or indirectly once it has left the mixer.

305.5.3 In order to reduce premature drying of the concrete during transporting and placing, all chutes, shuttering and reinforcement shall be cooled by watering when possible, or shall otherwise be protected from the direct rays of the sun. Any water so used shall be removed by jetting with compressed air before placing the concrete in close contact.

305.5.4 As soon as possible after concreting, the shuttering shall be stripped (Clause 304.6) and the surface of the concrete shall be treated in accordance with Clause 305.8.

Where drying winds are encountered, wind shields shall be positioned as directed by the Engineer to protect exposed surfaces of the curing concrete.

# 305.6 Wet Weather Concreting

- 305.6.1 Concreting during periods of constant rain shall not be permitted unless aggregate stockpiles, mixers and transporting equipment, and the areas to be concreted are adequately covered.
- 305.6.2 During showery weather, the Contractor shall ensure the work can be concluded at short notice by the provision of stop ends. On no account shall work be terminated before each section, between one stop end and another, is complete. Adequate covering shall be provided to protect newly placed concrete from the rain.
- 305.7 Holes, Cavities and Fixing
- 305.7.1 The Contractor shall be responsible for the co-ordination of all requirements of his sub-contractors as regards provision of holes, chases, cavities and fixings and shall, if required by the Engineer, prepare drawings giving details of his and his sub-contractors' requirements and shall send copies of such drawings to the Engineer prior to construction.
- 305.7.2 Holes, etc. shall be accurately marked and boxed-out for before concreting operations commence and, without the Engineer's prior approval, no such holes, etc. shall be formed after the concrete has set.
- 305.7.3 Where bars, if placed to specified spacing would foul holes of sizes less than 250mm x 250mm the full length of the bar shall be moved to one side and in the case of holes exceeding 250mm x 250mm the bars shall be cut on site and lapped with additional equivalent bars, or as otherwise indicated on the Drawing.
- 305.7.4 Wherever possible, the Contractor shall build in all pipe work, ironwork, etc. which passes through walls and floors, and the pipe work, ironwork, etc. shall first be thoroughly cleaned and freed from any deleterious matter, and every care shall be taken to ensure that it is thoroughly encased in concrete.
- 305.7.5 Bolts, hooks, and other fixings shall be embedded in concrete, or holes shall be drilled and fitted with threaded expanding anchors to receive the bolts. The Contractor shall ensure that bolts, hooks, etc. are accurately positioned. Holding down bolts for machinery shall be set to template.
- 305.7.6 Where brick or stonework is to form a facing to the concrete or where the end of a brick or stone wall butts against a concrete face, galvanized metal ties of approved manufacture to BS 1243 shall be incorporated.
- 305.7.7 The distance between ties shall be gauged with due regard for the bonding of the walls, and at intervals required by the Engineer.
- 305.8 Protection and Curing of Concrete
- 305.8.1 Newly placed concrete shall be protected by approved means from rain, drying winds, sun, and contact with substances which can adversely affect it.
- 305.8.2 No traffic or constructional loads shall be permitted on newly placed concrete until it has hardened sufficiently to take such traffic or load, and only then with the approval of the Engineer (305.13).
- 305.8.3 Exposed faces of concrete shall be kept moist after placing for not less than 3 days if Ordinary Portland and 2 days if Rapid Hardening cement is used. Membrane curing by approved materials may be

used when permitted by the Engineer.

305.8.4 Any concrete surfaces, arises and treads of stairways which might be damaged during the construction of the Works shall be adequately protected.

The method of curing shall prevent loss of moisture from the concrete. Immediately after compaction and for 7 days thereafter concrete shall be protected against harmful effects of weather, including rain, rapid temperature changes and from drying out.

The curing time shall be the number of days given in the following table unless the average temperature of the concrete during the required number of days falls below 100C in which case the period curing shall be extended until the maturity of the concrete reaches the value given in the table.

Curing shall be carried out using either of the following basic methods. The method adopted for any particular situation shall be agreed with the Engineer.

# TABLE 3.7: Normal Curing Periods

Minimum period of protection for different types of cement

# Conditions under which concrete is maturing

Number of days (When the average temperature of the concrete exceeds 100C during the whole of the period)

Equivalent maturity (deg.C Hors) (calculated as the age of the concrete in hours multiplied by the number of degrees Centigrade by which the average temperature of the concrete exceeds – 100C)

```
Type IV
Type I or Type V
Type III
Type IV
Type I or Type V
Type III
       Hot weather or
                                    drying winds
7
4
2
3500
2000
1000
       Conditions not covered by 1.
2.
4
2
1
2000
1000
500
          - Low Heat Portland Cement
Type IV
          - Ordinary Portland Cement
Type I
Type III
             Rapid-hardening Portland Cement
Type V
              Sulphate-resisting Portland Cement
```

Where the thickness of concrete placed exceeds 1.5m, the Contractor shall submit for the Engineer's approval proposals to ensure that, during the curing period:-

(a) the rate of rise of temperature in the concrete does not exceed 150C per hour for the first 3 hours;

- (b) thereafter the rate of rise and fall of temperature in the concrete does not exceed 350C per hour;
- (c) the maximum difference temperature in the concrete does not exceed 700C; and
- (d) the maximum difference in temperature between the core and the surface of the concrete does not exceed 200C.

The proposals shall include consideration of:-

- (a) concrete mix design;
- (b) temperature of mix at time of placing;
- (c) Method of curing.

Where required by the Engineer, the Contractor shall carry out temperature measurements in the concrete. The method and procedure of temperature measurement shall be agreed with the Engineer.

305.9 Joints

#### 305.9.1 Construction Joints

The position of construction joints, when not shown on the Drawings or otherwise required by this Specification, shall be decided on site having regard to the plant and labour made available by the Contractor for the manufacture, placing and compaction of the concrete as well as its curing, the climatic conditions prevailing at the time of concreting, the nature and size of the shuttering, and the conditions of operation of the work. The contractor shall submit his proposals to the Engineer for his approval before commencing work.

Construction joint surfaces shall be treated by the "wash-off" method explained below, except in the case of Cold Weather Concreting (Clause

305.4) or where it cannot be practically effected, in which case it shall be treated in accordance with Clause 305.3 as for the placing of new concrete to hardened concrete.

When expanded metal lathing is used for the formation of construction joints a rebate will not be required to be formed. The expanded metal lathing shall be left in the work and shall not extend closer to the finished surface of the concrete than 25mm. It shall be securely fixed to the reinforcement.

The following particular requirements shall also be observed: -

# (i) Slabs supported on the ground

In order to ensure control in the placing of concrete the Contractor shall provide control boards to form panels not larger than 15m2 in area. These shall be lifted as the concreting proceeds except where they are of expanded metal in which case they may be left in position as part of the permanent works, provided that they shall not extend closer to the finished surface of the concrete than 25mm. In the event of a breakdown in the supply of concrete the Contractor shall ensure that an alternative supply of concrete is made available (to finish the work against the control boards acting as stop ends). The joint so formed shall then be treated as a construction joint. Where ready-mixed concrete is permitted (Clause 307.4) the control boards shall be positioned so as to enclose a volume of concrete equal to that delivered by each truck.

Construction joints and control joints shall be formed normal to the surface of the retained concrete.

# (ii) Suspended Beams and Slabs

The reference to control boards in the foregoing para. (I) shall apply, but generally, unless otherwise shown on the Drawings or permitted by the Engineer, construction joints shall be positioned at approximately midspan in both beams and slabs.

T-beams shall be formed to their full depth integrally with the adjacent slab and without horizontal joints.

(iii) Walls

Horizontal construction joints in walls shall be formed along straight lines coinciding with the full height of the shuttering. The height of the shuttering thus controlling the height of the pour shall be determined with reference to the availability of concrete, the size, and amount of reinforcement and the means of compaction available.

Unless otherwise indicated on the Drawings or otherwise permitted by the Engineer for the construction of circular tanks, concreting shall be carried out continuously for the full circumference without vertical joints. Where permission is granted for the use of vertical joints the Engineer may order, at no extra cost to the Employer, the inclusion of an approved type of water stop.

In the case of rectangular tanks, vertical joints shall not be positioned closer to any corner than one metre. They shall be formed with properly rebated stop ends or, where conditions permit, by the use of expanded metal lathing.

Un-reinforced manholes shall be constructed without vertical joints.

# 305.9.1.1 The "Wash-off Method" of preparing Construction Joints

As soon as possible after concreting, and while the surface is still green, the surface of the concrete forming the joint shall be freed of loose aggregate and sprayed with a fine spray of water to prevent the formation of laitance. Subsequently all excess water shall be removed by a jet of compressed air and the surface left clean to receive further concrete.

Where expanded metal lathing is used for construction joints, this method of surface preparation shall be used in every case.

#### 305.9.2 Movement Joints

These shall include contraction and expansion joints and shall be as indicated on the Drawings.

Contraction joints will be either full contraction joints or partial contraction joints. Where partial contraction joints are specified a period of at least five days shall elapse between the concreting of the section on each side of the joint.

Where the Drawings indicate a contraction gap to be formed in any panel (this gap will not exceed one meter), concreting on either side of the gap shall be carried out so as to form partial contraction joints at each side of the gap.

Prior to the concreting of the gap section, the joint surfaces shall be cleaned but otherwise left untreated. The concreting of the gap section shall not be carried out until a period of at least five days has elapsed after completion of the adjacent sections.

Alternate panel construction (other than contraction gap construction outlined above) will be permitted only with the approval of the Engineer, or in those cases where either the reinforcement is not continuous through the joint or where the panels are separated by expansion or contraction joints.

Unless otherwise specified or permitted by the Engineer all water stop shall consist of rubber. Jointing of water stop shall be by vulcanizing, except where PVC is specified or permitted in which case joints shall be by fusing or welding. Materials shall be obtained from an approved manufacturer whose recommendations as to jointing shall be fully complied with.

# 305.9.3 Water stop and Jointing Materials

- 305.9.3.1 Water stop and jointing materials shall be obtained from an approved manufacturer.
- All water stop and jointing materials which are not required for immediate use shall be stored at all times in a cool damp place.
- Water stop shall be manufactured of rubber or PVC (polyvinylchloride) as stated in the Bill of Quantities and shall be made strictly in accordance with the manufacturer's instructions and all intersections and junctions shall be obtained prefabricated from the approved manufacturer.
- Joint filler shall be manufactured of natural bonded cork or other approved material. Joint filler shall be cut and trimmed accurately to suit the joint profile and shall be maintained accurately in position by means of an approved adhesive.
- 305.9.3.5 Joint sealing compounds shall be approved rubber/bituminous compounds suitable for

sealing joints in horizontal and vertical/sloping concrete surfaces as appropriate. Sealing compounds shall be applied strictly in accordance with the manufacturer's instructions and shall completely fill the joint recess. Surface primers shall be from same manufacturer as the sealants themselves.

Water stop shall be located and maintained accurately in position and details of the proposed method of fixing shall be submitted to the Engineer for approval. On no account shall waters to be secured by nails or by any other means involving puncture of or damage to the water stop material unless purpose made nailing flanges are incorporated in the design of the water stop.

# 305.10 Finishes to concrete - General

- All exposed faces of concrete unless otherwise specified shall be hard, smooth and free from honeycombing, air and water holes and other blemishes.
- All projecting imperfections shall be rubbed down with carborundum stone or by other approved means and grit and dust there from shall be thoroughly washed off with clean water.

#### 305.11 Surface Finishes

- (a) Wood float finishes shall be formed by smooth floating the accurately leveled and screeded surface. Care shall be taken to ensure that the concrete is worked no more than is necessary to produce a uniform surface free from screed marks.
- (b) Steel trowel finishes shall be formed while the concrete is still wet by means of a steel trowel applied to an accurately leveled and screeded surface (see also Clause 307.3)
- (c) Granolithic finishes shall conform to the recommendations laid down in "Specification for Granolithic floor toppings laid in in-situ concrete", as published by the cement and Concrete Association with special reference to monolithic construction.
- (d) Screeded finishes shall be formed by leveling and screeding the concrete to produce a uniform, plain or ridged surface as specified.
- (e) Bush-hammered or patter-worked finishes.

When exposed aggregate is to be the surface texture, the Contractor shall ensure that a uniform distribution of the course aggregate takes place at the face. The shuttering shall be removed as soon as possible from the face to be treated; the surface shall be thoroughly wetted and wire brushed, and bush-hammered or patternworked as and when instructed. Surface retarders shall be used only when permitted by the Engineer. Bush-hammering or patter-working shall not be relied upon to obscure any defects in the concreting face which arise from shuttering imperfections.

#### 305.12 Making Good

Honeycombed or damaged surfaces of concrete, which in the opinion of the Engineer, are not such as to warrant the cutting out and replacement of the concrete, shall be made good as soon as possible after removal of the shuttering as follows:-

1:1.5 Portland Cement and sand mixture shall be worked into the pores over the whole surface with a fine carborundum float in such a manner that no more material is left on the concrete face than is necessary completely to fill the pores so that a uniformly smooth and dense surface of uniform colour is finally presented.

# Removal and Replacement of Unsatisfactory Concrete

The Contractor shall on the Engineer's instructions to do so cut out and replace any concrete in any part of the structure if in the Engineer's opinion:-

- (a) the concrete does not conform to the Specification, or
- (b) deleterious materials or materials which are likely to produce harmful effects have been included in the concrete, or

- (c) the honeycombed or damaged surfaces are too extensive, or
- (d) the finished concrete sizes are not in accordance with the Drawings within permissible tolerances, or
- (e) the setting-out is incorrect, or
- (f) the steel cover has not been maintained, or
- (g) the protection, including curing, of the concrete during the construction was inadequate, resulting in damage, or
- (h) the work of making good or other remedial measures the Engineer may indicate are not carried out to his satisfaction, or
- (i) Undue deformation of or damage to the works has taken place due to inadequate shuttering, or to premature traffic or to excessive loading, or (j) any combination of the above points has taken place resulting in unsatisfactory work.

#### 306 TESTING

- 306.1 Sampling and Testing (see also Clauses 301.0 and 302.4)
- 306.1.1 The contractor shall provide on the Site equipment, staff and labour for carrying out the sampling and testing outlined in columns 3 and 4 of Table 3.8, and he shall carry out any or all of these tests at such times and with such frequency as may be requested by the Engineer.
- 306.1.2 All equipment shall be calibrated and checked from time to time as the Engineer may require.
- 306.1.3 The Contractor shall provide samples required by the Engineer. Those samples to be tested in a laboratory as required by Column 5 of Table 3.8 shall be carefully forwarded by the Contractor to an approved laboratory. Results of laboratory and site tests shall be kept on site and copies of all test reports shall be forwarded in duplicate to the Engineer's Representative.
- 306.1.4 Frequency of tests and the number of samples required will be governed by the results of the previous tests, the quality of the materials revealed during the tests, and the uniformity of the quality (see Clause 302.4). Should it become evident that the quality of concrete is deteriorating the Engineer may require additional samples to be taken and test cubes to be made and tested to determine the cause.

# 306.2 Loading Tests

- 306.2.1 The Engineer may direct that a loading test be made on the works or any part thereof if he deems such test to be necessary for one or more of the following reasons:-
- (a) failure of "Site Cubes" to attain the strength requirements of Clause 302.4;
- (b) premature removal of shuttering;
- (c) overloading of structure during construction;
- (d) improper compaction and/or curing of concrete;
- (e) any other circumstances attributable to alleged negligence on the part of the Contractor, which in the opinion of the Engineer, may result in a structure being of less than the required strength;
- 306.2.2 If the loading test be ordered to be made solely or in part for reasons (a) to (d) the test shall be made at the Contractor's own cost.
- 306.2.3 If the loading test be ordered to be made for reason (e), the Contractor shall be reimbursed for the cost of the test if the result is satisfactory.
- 306.2.4 Loading test shall be carried out in accordance with Clause 9.5 or 9.6 of CP 110 as appropriate.

306.2.5 If the results of the test are not satisfactory, the Engineer will direct that the part of the work concerned by taken down or removed and reconstructed to comply with the Specification, or that such other remedial measures as he may think fit be taken to make the work acceptable and the Contractor shall carry out such work at his own cost.

306.2.6 The Engineer may also instruct the Contractor before a loading test takes place to take out cylindrical core specimens from the structures concerned and have them tested. The cutting equipment and the method of doing the work shall be to the Engineer's approval. The specimens shall be dealt with in accordance with BS 1881. Prior to testing, the specimens shall be available for examination by the Engineer. If the cores are ordered to be taken solely or in part of reasons (a) and (d) above, the work involved and the testing shall be made at the Contractor's own cost. If the cores are to be taken for reasons (b), (c) and (e) above, the Contractor will be reimbursed the cost if the loading test described in the previous paragraphs proves satisfactory.

# Copies of Standards and Codes

The Contractor shall provide and keep permanently on the Site copies of the following British Standard Codes of Practice and Road Notes:-

SS 812		
BS	882	
BS	1478	
BS	1881	
\CP	110	
BS	5337	
Road Note 4		

The Contractor shall in addition provide and keep permanently on the site copies of such other Standards codes Notes and Specifications as may be approved by the Engineer in accordance with Clause 7 of the Notice of Tenderers.

# 310 WATER RETAINING STRUCTURES - SPECIAL CLAUSES

Note: In the event of any difference between the "Special Clauses" and the previous Specification under Section 3 then the provision of these "Special Clauses" shall have precedence.

# 310.1 Making Good

The cement mortar used in filling recesses in the concrete formed by bobbins in connection with shuttering shall contain an approved expanding admixture.

- 310.2 Construction joints in Water Retaining Structures.
- 310.2.1 In water retaining structures PVC water stops not less than 130mm wide manufactured by an approved manufacturer shall be built into all construction joints in floors all vertical construction joints in walls which are exposed externally and construction joints in roofs of potable water retaining structures. Construction joints shall be formed at positions agreed by the Engineer.
- 310.2.2 The cost of forming construction joints shall be included for by the Contractor in his general concrete rates

# 310.3 Water tightness of Structures

The contractor shall be solely responsible for the water tightness of structures and any remedial measures necessary.

#### SECTION 3A - TESTING AND STERILIZING CONCRETE WATER-RETAINING STRUCTURES

# 3A.1 TESTING OF WATER-RETAINING STRUCTURES

3A.1.1 all water-retaining structures shall be tested for water-tightness on completion in the following manner. The structure shall be filled with clean water in stages of one metre and held at each water level for such time as the Engineer may require. Should any dampness or leakage occur at any stage, the water shall

be drawn off the defects remedied to the satisfaction of the Engineer.

The procedure shall be continued and finally the structure shall be allowed to remain full for three days during which the total permissible loss of water, after allowing for evaporation, shall not exceed 1/1000 of the capacity of the structure. Notwithstanding the satisfactory completion of the seven day test, should any dampness or leakage or other defects occur they shall be made good to the satisfaction of the Engineer and the structure re-tested until water-tightness is approved by the Engineer.

- 3A..1.2 The Contractor shall provide a hook gauge to measure variations in the water level during the tests.
- 3A.1.3 The testing shall be carried out before the excavations are backfilled and embankments placed.
- 3A.1.4 In the case of potable water reservoirs and tanks the roof shall be tested for water-tightness by flooding (in small areas at a time if necessary) to a minimum depth of 25 mm. The water shall be left standing for not less than 24 hours and the underside of the roof shall be made good by the Contractor and the tests continued until the water-tightness of the roof is approved by the Engineer. Where it is not practicable to contain a depth of 25mm of water over the roof, the roof shall be thoroughly wetted by continuous hosing for a period of six hours.
- 3A.1.5 The Contractor shall be solely responsible for the watertightness of structures and any remedial measures necessary.
- 3A.1.6 The water used for testing shall be provided at his own expense by the Contractor and shall be free from impurities and of such quality which will not pollute or impair the water-retaining structure.
- 3A.1.7 The Contractor shall give the Engineer's Representative at least 14 days notice as to the source of water intended for use for testing purposes.
- 3A.1.8 The Contractor shall be solely responsible for making all arrangements for obtaining water and provision of all equipment and labour and other things necessary for testing water retaining structures.

# 3A.2 CLEANSING AND STERILIZING WATER-RETAINING STRUCTURES

- 3A.2.1 The inside of all potable water-retaining structures and all interior pipe work and fittings shall be thoroughly cleaned and washed after the water-tightness test has been approved by the Engineer to remove all contamination and the water from these operations shall be removed by squeegees and drained away.
- 3A.2.2 The internal surfaces of the structure shall then be thoroughly washed with cleaned water containing 20 parts per million of chlorine. The chlorinated water shall then be drained away and the structure filled with potable water from which, after 24 hours, samples shall be taken for analysis to the instruction of the Engineer. If any of the results of the analyses are unsatisfactory when compared with those of the control sample of the supply water the sterilizing process shall be repeated until the results of the test are satisfactory.
- 3A.2.3. The costs of the initial sampling analysis and preparing reports on the bacteriological quality of the water shall be borne by the Employer but should initial reports be unsatisfactory the costs of any subsequent sampling analyses and preparing reports shall be borne by the Contractor.

# TIME 3.8 SAMPLING, TESTING AND ACCEPTANCE STANDARDS

Test Site Sampling Testing Accepted Standards Remarks
On Site In Laboratory

1 2 3 4 5 6 7

CEMENT Ordinary Portland Rapid Hardening Sulphate Resisting

BS 4550

BS 12

BS 12

Materials

BS 4027 Manufacturers Test Certificate

AGGREGATES Description and Classification BS 812 Section 2 BS 882

or 1201 Whichever is applicable

Particle size BS B12 Sec.1 BS 812 Sec.5 - BS 882 or 1201

Particle Shape BS 812

Sec. 1 Visual BS 812 Sec.3

Sp. Gravity BS 812 Sec.1 - BS 812 Sec.5 Mix design

Density BS 812 Sec.1 -BS 812 Sec.3 Requirements Voids BS 812 Sec.1 BS 812 Sec.4 Absorbtion BS 812 Sec.1 -BS 812 Sec.4 US 5337 CI.21.2 See Freeze-**Organic Impurities** BS 812 Sec.5 CP 114 Bulking of Fine Aggregate CI 602 Nominal Mix Proportionary Moisture Content BS 812 Sec.5 For adjustment if added water for concrete making **Mechanical Properties** BS 882 or 1201 Ten per cent fines value BS 812 Sec.6 TABLE 3.8 SAMPLING, TESTING AND ACCEPTANCE STANDARD (Cont'd) Materials Test Site Sampling Testing Accepted Standards Remarks On site In Laboratory Water Suitability BS 3148 BS 3148 BS 3148 Not required for potable water Compacting Factor Slump BS 1881 Pt.2 Concrete BS 1881 Pt.1 BS 1881 Pt.2 This spec. Table1 C1.302 Workability Tests Table 2 this Spec. Crushing BS 1880 Pt.4 Cube Test Flexural CP 114 CI.208c As required BS 1881 Pt.4 CP 114 Water Absorption BS 1881 Pt.5 BS 340 Para 19(b) Precast Concrete CI.308 Freeze-throw CI.601 BS 1881 Pt.3 Durability test for aggregate not complying with moisture absorption requirements of BS 5337 CI.71.2 Electrolytic Affloroscence As required for salt containing aggregate or saline water Corea BS 1881 Pt.4 BS 1881 Pt.4 BS 1881 para 114 with ref. To concrete at strength this specification See Clause 306.2 **ADMIXTURES** Compatibility with cement As required by Laboratory Tests to be carried out by independent Laboratory as required. SECTION 4: **PIPEWORK** 401. Valves Pipes Fittings and other materials......83 Handling and Distribution of Pipes......83 402. 403. Stockpiling and Storage of Pipes and Fittings......84 404. Proprietary joints and Couplings......84 Flanged and Bolted Gland Joints.....85 405. 406. Excavation of Trenches and Open Channels......85 Timbering or sheeting......86 407.

Backfilling of Trenches......86

Excavating and Backfilling trenches in 'Rock'......87

408. 409.

410.	Pipelaying General	87
411.	Examination of pipes prior to laying	
412.	Laying and jointing pressure pipes	
413.	Laying and Jointing Concrete Gravity Pipelines	
414.	Concrete surround to pipelines	
415.	Thrust and Anchor Blocks	
416.	Flotation of Pipeline	91
417.	Fixing Valves and Penstocks	
418.	Fixing Surface Boxes and Covers	
419.	Grouting in Ironwork	
420.	Proving Pipelines free form Obstruction	92
421.	Granular Bedding or Bed and Surround	92
422.	Pipelines on Concrete	
423.	Flexibility in Pipelines	
424.	Testing pressure pipelines	
425.	Testing Gravity pipelines	96
426.	Painting	
427.	Manholes and Chambers	97
428.	Channels and Benchings	97
429.	Testing of Non-water-retaining structures	98
430.	Fixing of Manhole and inspection Frames and Covers	
431.	Fixing Step Irons and other Fittings	
432.	Pipes built in or through walls	
433.	River Crossings	
434.	Valves Penstocks etc	
435.	Setting out of Lateral Drains and Junctions	105
436.	Concrete Pipes and Fittings	106
437.	uPVC Pipes and Fittings	106
438.	Ductile Iron Pipes and Fittings	
439.	Steel pies and Fitters	
440.	Precast Concrete Invert Blocks	
441.	Precast concrete paving slabs for open channels	109

#### **PIPEWORK**

# 401 VALVES PIPES FITTINGS AND OTHER MATERIALS

401.1 The Contractor shall supply all valves, pipes fittings and all other materials required for the proper execution of the Works in accordance with the Bill of Quantities.

Should it be necessary for the Contractor to supply additional valves pipes fittings or other materials besides those in the Bill of Quantities they shall conform with the Specifications or other detailed Specification which may be prepared by the Engineer.

# 402 HANDLING AND DISTRIBUTION OF PIPES

402.1 Loading unloading and handling shall be carried out using special lifting hooks with a curved plate to fit the curvature of the pipes etc. or webbing slings not less than 30 cm wide or other means approved by the Engineer's Representative. Sheathed pipes shall only be transported on trucks or trailers fitted with approved padded timber cradles shaped to fit the curvature of the pipes and of adequate dimensions so as to prevent any damage to the pipe sheating. Successive tiers of sheathed pipes shall be separated by similar suitable shaped timber cradles when more than one tier of pipes is being transported. Pillows shall be provided between securing chains or lashing when loads are being transported.

# 402.2 HANDLING AND DISTRIBUTION OF PIPES

402.1 Loading unloading and handling shall be carried out using special lifting hooks with a curved plate to fit the curvature of the pipes etc. or webbing slings not less than 30cm wide or other means approved by the Engineer's Representative. Sheathed pipes shall only be transported on trucks or trailers fitted with

approved padded timber cradles shaped to fit the curvature of the pipes and of adequate dimensions so as to prevent any damage to the pipe sheathing. Successive tiers of sheathed pipes shall be separated by similar suitable shaped timber cradles when more than one tier of pipes is being transported. Pillows shall be provided between securing chains of lashings when loads are being transported.

402.2 Particular care shall be taken during unloading, loading, handling and transportation to avoid distortion flattening denting scoring or any other damage to the piped fittings etc. and any damage to the external or internal coating sheathing or lining of the pipes fittings etc.

#### 403 STOCKPILING AND STORAGE OF PIPES AND FITTINGS

- 403.1 When stockpiled shall not be stacked more than three tiers high without the Engineer's prior approval. The pipes shall be stacked clear of the ground on timbers of adequate dimensions or prevent any damage to the pipes or to external sheathing or coating and successive tiers shall be separated by timber of similarly adequate dimensions with wooden wedges nailed to the ends of these timbers to prevent the pipes form rolling. UPVC pipes shall be adequately protected from direct sunlight to the satisfaction of the Engineer.
- 403.2 Fittings etc. shall not be stacked more than one tier high and shall similarly be supported clear of the ground on timbers.
- 403.3 Pipe end covers wooden discs and other transit protections fixed by the pipe and other manufacturers shall be retained in place until the pipes etc. are inspected shortly before they're laid.
- 403.4 When pipes etc. are strung adjacent to the pipe trench prior to laying they shall be supported clear of the ground on suitable approved supports to prevent any damage to the pipes etc. or to external sheathing and coating and gaps shall be left at intervals and at well-defined tracks and roads to permit the free passage of livestock vehicles and persons.
- 403.5 Air valves rubber joint rings gasket bolts and similar fittings and materials shall be kept in approved locked premises and such fittings and materials shall not be distributed to the trench side until immediately prior to laying fixing jointing or assembly thereof. All rubber joint rings and gaskets must be stored in a cool damp location and all fittings and materials shall at all times be stored in the shade under cover and protected from the weather to the satisfaction of the Engineer's Representative.

# 404 PROPRIETARY JOINTS AND COUPLINGS

- 404.1 The Contractor shall make himself and his employees acquainted with and comply with the instructions issued by the manufacturers of the various types of proprietary joints and couplings supplied for incorporation in the works. The Contractor shall be responsible for obtaining copies of any such instructions.
- 404.2 All tools and apparatus necessary for making the joints and protecting them shall be provided by the Contractor.

# 405 FLANGED AND BOLTED GLAND JOINTS

- 405.1 Flanged and bolted gland type joints shall be made with the joint rings and nuts washers and bolts provided. Two washers shall be used per bolt one under the bolt head and the other under the nut. The tightening of the bolts shall be evenly done all round by tightening be exerted on any nut or bolt spanners shall be of a suitable length but not exceeding 300mm from the axis of the bolt to the extremity of the handle.
- 405.2 Spanners shall not be lengthened in any manner in order to increase the purchase. After the satisfactory conclusion of the watertightness test all buried joints shall be wrapped using "Density" mastic and "Densyl" Tape manufactured by Winn and Coales, Chapel Road, London, S.E. 27, or other approved wrapping in accordance with the manufacturer's instructions. All exposed flanged joints shall be cleaned and given two coats of an approved bituminous paint.

# 406 EXCAVATION OF TRENCHES AND OPEN CHANNELS

406.1 Trenches for pipes and channels shall be excavated to the lines and levels shown on the drawings or as directed by the Engineer. Trenches for pipes shall have a width at the bottom of the trench equal to or less than the widths given in Table 4.1 below or as directed by the Engineer. For concrete pipes the maximum trench width shall be the internal diameter plus 750mm.

# TABLE 4.1 PERMISSIBLE MAXIMUM TRENCH WIDTHS (uPVC PIPES)

MAXIMUM TRENCH WIDTH (mm) MINIMUM TRENCH WIDTH DIAMETER OF PIPE (mm) (mm) 200 or LESS 300 400 500 600 700 800 750 850 950 1050 1150 1250 1350 500 600 700 800 900 1000 1100

- 406.2 Excavations for open channels, inlet or outfall drains, catch water drains, subsoil pipe drains, and French drains shall be to the widths and depths shown on the drawings of as directed by the Engineer.
- 406.3 In the first instance excavation shall be to within 150mm of formation level and proper grade pegs shall then be set in the bottom of the trench by the Contractor for the accurate taking out of the rest of the excavation.

The bottom of trenches and open channels shall be excavated true to line and level and where pipes are to be laid without concrete beds holes shall be excavated under the joints to permit jointing. The bottom of the trench shall be smooth and free from stones and other projections

- 406.4 When directed by the Engineer, such as in the excavation of trenches in an existing road, the Contractor shall carefully set aside the various materials encountered so that they may be replaced in their original position.
- 406.5 Trenches shall be kept clean and free from water during the excavation, laying of pipes and backfilling and the contractor shall dig diversion channels, erect coffer dams or otherwise dewater the trench.
- 406.6 Where, in the opinion of the Engineer, any invert has become soft or unsuitable due to the Contractors method of working the Contractor shall at this own expense remove and replace the material with Class 15 Concrete or other imported material as directed by the Engineer.
- 406.7 Where any trench or open channel has been over excavated below the invert required, the Contractor shall at his own expense, backfill the trench with Class 15 concrete or other imported material, as directed by the Engineer.

# 407 TIMBERING OR SHEETING

407.1 The sides of trenches shall be supported, where necessary, by adequately shored and strutted timbering or sheeting, which shall be carefull removed when the trench is backfilled. The Engineer may direct the timbering or sheeting be left in the trench.

- 408.1 No sewer or culvert shall be covered up until approved by the Engineer.
- 408.2 Backfilling, where no concrete haunch or surround is called for, shall be of gravel material and/or selected fill material as directed by the Engineer.
- 408.3 Backfill material around the lower half of the barrel of the pipe and in the joint holes shall be watered or dried as necessary mixed, and compacted to 100% BS. Selected fill materials shall then be laid in layers, not exceeding 0.15m loose thickness, watered or dried as necessary, mixed, and compacted to 90% BS and brought up uniformly on both sides of the pipe up to the top of the trench.
- 408.4 Timbering and sheeting shall be eased up 0.15m at a time in step with the backfill layer and compaction of 90% BS shall be obtained under such timber and sheeting.

# 409 EXCAVATING AND BACKFILLLING TRENCHES IN "ROCK"

- 409.1 Trenches in "rock" shall be excavated as described in Clause 406 but in addition shall be excavated to such a depth that everywhere the rock surface is not closer to the barrel or socket of the pipe then 75mm.
- 409.2 In the particular case of concrete pipes the invert of the trench shall be backfilled and smoothed with Class 10 concrete, or other material, as directed by the Engineer, so that the barrel or the pipes rests uniformly along its length and holes are left under the joints and sockets.
- 409.3 Trenches excavated in "rock" shall be backfilled as described in Clause 408 with imported material approved by the Engineer.

#### 410 PIPELAYING GENERAL

- 410.1 Pipes shall be laid true to line by means of a string line stretched along the sides of the pipes and true to level by means of a straight edge of at least 4 metres long kept inside the pipes and pulled forward to pegs boned in at suitable intervals between sight rails set to the proper levels.
- 410.2 Where pipes are to be laid on 'normal' or imported material the floor of the trench shall be compacted and shaped so that the barrel rests over a width of the least one third of its diameter and throughout the length of the barrel upon the floor. Holes shall be excavated under the joints and sockets so that the sockets do no bear on the ground. The underside of the barrel and socket shall then be packed hard with earth or gravel fill material as directed by the Engineer and of maximum particle size not exceeding 25mm diameter and rammed solid. Refer to Clause 441 for the laying of uPVC pipes.

#### 411 EXAMINATION OF PIPES PRIOR TO LAYING

Shortly before laying or fixing any valve pipe or fitting the contractor shall in the presence of the Engineer's Representative carefully examine each valve pipe and fitting as detailed in this Clause to ascertain damage or defect occasioned to the valves pipes and fittings during manufacture loading, unloading, handling and transportation. All damage and all defects revealed by this examination shall be repaired and remedied to the satisfaction of the Engineer's Representative.

- 411.2 The Contractor shall give the Engineer's Representative not less than 48 hours' notice of his intention to examine any pipes etc. and the contractor shall not proceed to lay such pipes until they have been approved as free from damage and defects by the Engineer's Representative.
- 411.3 The ends of steel pipes and fittings shall be examined for circularity. Any distorted ends shall be corrected by an approved method to within the tolerances required by the mechanical couplings or other joints by which the pipes or fittings are to be jointed.
- 411.4 In the case of the internal lining of steel pipes any surface cracks and crazing shall be made good by lightly flaming the areas with a blow lamp or torch sufficient to cause the bitumen to flow and fill in the cracks. In the case of loose patches the lining shall be removed from the affected areas and the bare metal cleaned and primed with the bituminous paint. The area shall then be filled in with hot bitumen moulding mixture and the surface smoothed with a metal tool to produce a uniform finish.
- 411.5 If ordered by the Engineer, the Contractor shall carry out inspection of the external sheathing of steel pipes with a "Holiday" detector immediately prior to laying and the contractor shall supply all necessary labour, tools, materials, and equipment for the carrying out of the "Holiday" detection test.

- 411.6 All ductile iron pipes and fittings which are severely dented or similarly damaged shall be discarded unless in the opinion of the Engineer's Representative a portion of such pipe or fitting may usefully be salvaged in which case the contractor may cut off and discard the damaged portion only.
- 411.7 Asbestos cement pipes and fittings shall be carefully examined fir cracks damaged ends and any other defects. All pipes and fittings which are found to be cracked or which have any defect which in the opinion of the Engineer' Representative adversely affects their suitability for incorporation in the works shall be discarded.

All damaged ends shall be cut off well beyond the damaged area and machined true.

- 411.8 All pre-stressed concrete pipes and fittings which may be damaged in the opinion of the Engineer's Representative in such a way as to adversely affect their suitability for incorporation in the Works shall be discarded. Pre-stressed concrete pipes have fittings shall on no account be cut.
- 411.9 All concrete pipes and fittings shall be slung vertically and "rung" with a wooden mallet. Any damaged or cracked pipe shall be rejected.
- 411.10 After examination and any necessary repairs and attention all pipes fittings etc. shall be cleaned internally particular care being taken to ensure that no stones etc. are bedded in bitumen or coal tar linings.

#### 412 LAYING AND JOINTING PRESSURE PIPES

- 412.1 Immediately before any new pipe is lowered into the trench the plut to be provided in accordance with this clause shall be removed from the end of the last pipe laid and the new pipe shall be carefully lowered into the trench with a crane or gantry operating within its designed working load or by other approved means.
- 412.2 Each pipe and fitting shall be laid true to alignment curve and gradient in accordance with the Drawings or as directed by the Engineer's Representative. The minimum cover and the minimum gradient shall not be less than 0.6m and 1 in 500 respectively except by prior agreement with the Engineer.
- 412.3 Where gradients are slack or where invert levels are shown on the Drawings or where required by the Engineer's Representative the pipes shall be boned to even gradients and sight rails shall be provided for this purpose at intervals not exceeding 60m and at all changes in grade.
- 412.4 Long radius curves in the pipelines shall be negotiated by deflections taken up in the joints of one or more pipes. The deflection at each of the various type of joint used in the Works shall confirm with the Manufacturer's recommendations and shall not exceed the following

Mechanical couplings 30
Bolted gland or "Tyton" joints 2.50
Joints on Asbestos Cement pipes 30

- 412.5 Pipes laid underground in trenches shall be laid and firmly bedded on an even and uniform bed and if considered necessary by the Engineer's Representative fine screened material shall be placed and consolidated in the trench bottom to provide such bed. Pipes shall not be dragged along the trench bottom. Joint holes shall be as small as possible and shall be filled in compactly after pressure testing and before the refilling of the trench is completed.
- 412.6 Where pipes are to be laid above ground on piers or bridges the piers and bridges shall be constructed true to line and level and the pipes shall then be laid thereon jointed and firmly secured thereto in the matter shown on the Drawings.
- 412.7 Pipes shall be jointed with the joints and couplings supplied and each type of joint shall be made in full compliance with the manufacturer's instructions. Special care shall be taken to ensure the absolute cleanliness of the pipe ends and joint components and only the lubricants recommended by the respective manufacturer shall be used. Should the Contractor require further quantities of joint lubricants or joints assemblies he shall supply them to the approval of the Engineer's Representative and the Contractor shall bear the cost of supplying such additional lubricants or assemblies.
- 412.8 The Contractor shall take all steps necessary to ensure that no dirty water or other extraneous matter is allowed to enter the pipes during or after laying. In the event of dirty water or extraneous matter entering the pipes the Contractor shall immediately carry out the necessary cleansing as may be directed by the

Engineer's Representative. No extra payment will be made or allowed for such work.

- 412.9 Except when necessary for jointing the end of the last pipe laid shall be plugged to the satisfaction of the Engineer's Representative and the Contractor shall provide a sufficient number of the use proper plugs for this purpose.
- 412.10 Pipe trenches shall not be refilled until permission to do so has been obtained from the Engineer's Representative. Subject to such permission being obtained trenches shall be refilled without delay to at least the minimum extent required by Clause 424.3 hereof in readiness for pressure testing.

# 413 LAYING AND JOINTING CONCRETE GRAVITY PIPELINES

# 413.1 Rigid jointed pipes

Joints are to be made as detailed below. In all cases the joints shall be cured and protected from the wind, sun and rain by a covering approved by the Engineer and shall be kept constantly damp for a period of at least 3 days. All pipes shall be saturated with water before jointing.

- 413.2 For spigot and socket pipes yarn soaked in cement grout shall be called into the socket to a depth of between 10 and 20mm. 1:2 cement/sand mortar shall be rammed into the socket and finished off with a fillet at an angle of 450.
- 413.3 For pipes with ogee or butt joints the fuses shall be thickly covered with 1:2 cement/sand mortar and the newly laid pipes shall be driven hard up to the previously laid pipes. The outside of the joint shall be pointed up with a fillet of 1:2 cement/sand mortar 75,, wide and 25mm thick all the way round the barrel and central over the joint.

# 413.4 Flexibly jointed pipes

For flexibility – joined concrete pipes the rubber rings used are to be thoroughly cleaned and the joints are to be made in accordance with the manufacturer's instructions.

# 414 CONCRETE SURROUND TO PIPELINES

- 414.1 Where pipelines pass under streams and rivers or under roads the sections of pipeline under the stream river or road and for a minimum distance of 1.0m clear on either side of the bank or edge thereof or such greater distance as the Engineer's Representative may require shall be surrounded with Class 15 concrete in accordance with the typical detail shown on the Drawings so as to provide a minimum 150mm thickness protective surround to the pipe.
- 414.2 Similar class 15 concrete surround shall be provided elsewhere as may be required by the Engineer for the added protection of the pipeline at any point along the pipeline route.

#### 415 THRUST AND ANCHOR BLOCKS

- 415.1 Concrete thrust and anchor blocks shall be formed at bends tees and valves in accordance with the typical sections shown on the Drawings or otherwise as directed by the Engineer. The additional excavation shall be made after the bends etc. have been jointed and the concrete shall then be placed with all possible speed. The back of supports and blocks shall abut on to solid ground all loose material being removed before concreting.
- 415.2 The concrete used for thrust and anchor blocks shall be Class 15 and after placing shall be kept in view for not less than six hours. No pressure shall be applied in any section of main until the concrete has had at least three days curing.

# 416 FLOTATION OF PIPELINE

- 416.1 The Contractor shall be solely responsible for ensuring that flotation of the pipeline does not occur during construction. The extent of the backfill placed over each pipe after laying and before testing shall be such as will prevent flotation of the pipeline and the requirements of Clause 424.3 hereof shall not be construed as limiting in any way the extent of the backfill so placed or which may be so required.
- 416.2 Should any section of the pipeline float out of line or level the section of pipeline so affected shall

be removed and re-laid in accordance with the Specification to the satisfaction of the Engineer's Representative.

#### 417 FIXING SURFACE BOXES AND PENSTOCKS

417.1 Valves penstocks and other fittings shall be securely fixed and where required extension spindles and headstocks shall be properly aligned and fixed in a vertical position. They shall be tested for ease of operation and water tightness and valve glands shall be repacked where necessary. Any damaged protective coating shall be made good and they shall be left clean in all respects.

# 418 FIXING SURFACE BOXES AND COVERS

418.1 Chamber covers and surface boxes shall be set in cement mortar to the correct levels camber and fall.

#### 419 GROUTING IN IRONWORK

- 419.1 All brackets rag bolts and other ironwork for which holes have been boxed out or left in the concrete of structures shall be carefully grouted in to their correct positions in all particulars. The grouting in shall be carried out with cement and sand grout in such a manner that there shall be no apparent difference in the texture or colour throughout the face of the finished structure and there shall be no seepage of water either between the iron work and the set grout or between the set grout and the surrounding structure.
- 419.2 The above instructions shall apply also to the building in of pipes except that concrete of the class used for that part of the structure shall be used in lieu of cement grout.

# 420 PROVING PIPELINES FREE FROM OBSTRUCTION

- 420.1 After the pipelines have been completed and pressure tested satisfactorily in accordance with Clause 424 and 425 hereof the Contractor shall on the instructions of the Engineer's Representative prove the pipeline free from obstruction.
- 420.2 Proving shall be carried out by means of passing through the pipelines a "badger" which must be kept in the pipes during the time they are being laid. The badger must be pulled forward and the obstructions removed immediately after the laying of each pipe and before the next one is placed in position so that the barrel of the pipe is left perfectly clean and smooth.

#### 421 GRANULAR BEDDING OR BED AND SURROUND

- 421.1 Sand or granular bedding material shall consist of approved local sand or non-flaky broken stone or gravel, graded 20mm nominal size, which materials shall have a compaction fraction ascertained by the test method described below of not greater than 0.15. The Contractor shall provide all necessary testing apparatus for the use of the Engineer's Representative on site. Frequency of tests shall be at the discretion of the Engineer's Representative.
- 421.2 Before placing pipe bedding material the trench bottom shall be prepared and all loose stones or lumps of clay, rock projections, boulders and other hard spots removed. The approved bedding material shall then be laid over the full width of the trench to such depth that after the pipes have been laid to line and level, the thickness of bed beneath the barrel of the pipes is not less than 150mm or as otherwise stated in the Bill of Quantities or on the drawings. The bedding material shall be evenly spread and carefully compacted and where the bedding beneath the pipe exceeds 200mm in thickness it shall be placed and compacted in two separate equal layers. Any clay, large stones, and other unsuitable material falling onto or into the bed from the trench sides or from any other source shall be immediately removed.
- 421.3 Timbering or any other form of trench support should be withdrawn, whenever possible, as the bedding material is placed so as to avoid disturbance of the bedding by later removal
- 421.4 Pipes shall be laid and jointed as specified elsewhere. Any adjustments to line and level must be made by adding or removing bedding material under the body of the pipe and not by wedging and blocking. All hard objects or timber shall be removed before laying the pipes.
- 421.5 After the pipes have been laid correctly to line and level the bedding material shall be brought up to half diameter of the pipe and compacted as before and so as to prevent any voids under the pipe barrel and

give uniform support all round. Care shall be taken not to disturb the pipeline from its approved position at this stage and as the subsequent backfilling of the trench proceeds as specified elsewhere.

- 421.6 For P.V.C. pipe and where sand or granular surround is billed, the pipe shall then be covered with bedding material compacted as before to a depth of 150mm above the top of the pipe barrel.
- 421.7 Where ground water conditions are such that the bedding material would be likely to act as a carrier for ground water from higher to lower ground, the Engineer's Representative may instruct flow barriers of suitable selected earth to be inserted in lieu of bedding material. Such barriers to be erected at reasonable intervals close to flexible joints in the pipe, without alteration of the rate for bedding etc.

# **Compaction Fraction Test**

Apparatus required

- i) Open-ended cylinder 250mm long and 150+ 5 mm internal diameter (150mm diameter pipe is suitable)
- ii) Metal hammer with striking face 38mm diameter and weighing 1 kg.
- iii) Rule Method.

Obtain a representative sample\* more than sufficient to fill the cylinder (viz. About 10kg). It is important that the moisture content of the sample should not differ from that of the main body of material at the time of its use in the trench.

Place the cylinder on a firm flat surface and gently pour the sample material into in, loosely and without tamping.

Strike off the top surface level with the top of the cylinder and remove all surplus material. Lift the cylinder up clear of its contents and place on a fresh area of flat surface. Place about one quarter of the material back in the cylinder and tamp vigorously until no further compaction can be obtained. Repeat with the second quarter, tamping as before, and so on for the third and fourth quarters, tamping the final surface as level as possible.

Measure down from the top of the cylinder to the surface of the compacted material. This distance in millimeters divided by the height of the cylinder (250mm) is the Compaction Fraction of the material under test.

\*To obtain a representative sample, about 50kg of the proposed material should be heaped on a clean surface and divided with the spade down the middle into two halves. One of these should then be similarly divided, and so on until the required weight of sample is left.

#### 422 PIPE LINES ON CONCRETE

- 422.1 Where a concrete bed to pipes is to be provided the excavation shall be taken out to the proper depth to receive the concrete and the pipes shall then be laid to line and level and jointed on precast Class '15' concrete blocks solidly bedded on the floor of the trench. When the pipes are jointed the trench bottom shall be cleaned and the concrete for the benching, haunching or surround as the case may be shall be carefully placed under and around the pipes, special care being taken to pack the concrete solidly under the pipes.
- 422.2 The concrete bed and protection shall extend along the length of the pipe to within 100mm of the joint collar and a gap shall be left adjacent to the joint. This gap shall be backfilled with selected excavated material.
- 422.3 All precautions shall be taken to avoid damage to the pipes during the placing of the concrete. The precast blocks shall be not less than 300mm x 150mm x 100mm and shall be notched to receive the barrel of the pipe and shall be placed immediately behind the joints.
- 422.4 For pipes of 600mm dia. and over, and on ground of soft formation, the concrete bed shall be cast in two layers. A bed of 50mm thickness shall be placed to receive the concrete blocks and after the pipes are jointed the remainder of the bed shall be cast.

# 423 FLEXIBILITY IN PIPELINES

- 423.1 All flexibly jointed pipelines shall be provided with additional flexibility between any structures, chamber, manholes, fixed points etc. and the remainder of pipeline.
- 423.2 Unless otherwise shown on the drawings the first joint shall not be more than 1.0m from the external face of the structure, chamber, manhole, fixed point etc. and the next joint shall not be more than 2.5m from the first joint.
- 423.3 The provision of the necessary short pipe lengths and additional flexible shall be included for in the rates for the pipeline.

# 424 TESTING PRESSURE PIPELINES

- 424.1 All pipelines shall be hydrostatically tested in the presence of the Engineer's Representative after laying.
- 424.2 The Contractor shall give the Engineer's Representative not less than 48 hours' notice of his intention to carry out a pressure test.
- 424.3 Before any pressure is applied to any pipeline each pipe shall be securely anchored and when in trench shall be covered for at least two-thirds of its length with not less than 60cm. Of the backfill material leaving the joints exposed. No joint shall be backfilled or moulded or covered in any way until after the satisfactory completion of the pressure test.
- 424.4 Pressure testing shall be carried out as the work proceeds in such lengths of pipeline as re convenient and meet the approval of the Engineer's Representative. The ends of the length of pipeline under test shall be closed by means of caps or blank flanges. Pipeline sluice valves shall not be used for this purpose. All washout valves shall be fitted with blank flanges and the valves opened before the commencement of any pressure test. The Contractor shall be solely responsible for the provision of all caps and blank flanges necessary for testing of the pipeline.
- 424.5 The test pressure in the section of the pipeline to be tested shall be the test pressure head level shown on the Drawings or other pressure as directed by the Engineer. The pressure in the pipeline shall be slowly raised to the test pressure the test pump disconnected and the pipeline left charged under pressure with all air valves open for a period of not less than 24 hours to allow air in the pipeline to be expelled and pipe linings and pipe walls of absorbent materials to become saturated.

At the end of this period of time the test pump shall be reconnected and the pressure in the pipeline shall not be allowed to fall or rise more than 6m head of water below or above the test pressure and this shall be accomplished by pumping water into or releasing water from the pipeline as required. The volume of water pumped into or released form the pipeline shall be carefully measured. At the end of the test period of 24 hours the pressure in the pipeline shall be adjusted to the test pressure by pumping water into or releasing water from the pipeline as required.

- 424.6 The leakage from the pipeline shall be ascertained from the net volume of water that has been pumped into the pipeline during the test period of 24 hours. The leakage so ascertained shall not exceed the volume determined by the following formula.
- 3 litres per kilometer of pipe per 25mm. of nominal bore per 3kgf/cm2 of pressure per 24 hours.
- 424.7 During the period of the pressure test all joints shall be inspected for water tightness. All signs of leakage or faults shall be remedied whether total leakage from the pipeline under test is less than the allowable leakage or not.
- 424.8 Should any length of pipeline fail to pass the pressure test the Contractor shall at his own expense carry out all work necessary to locate any remedy the faults and to retest the pipeline until it satisfactorily passes the test.
- 424.9 After the completion of pipe laying and installation of all fittings valves etc. the complete pipeline shall be subjected to a hydrostatic test under this test pressure the complete pipeline shall be inspected in the presence of the Engineer's Representative and all faults revealed shall be remedied to his satisfaction.
- 424.10 The water used for pressure testing shall be provided by the Contractor and shall be free from impurities and of such a quality which will not pollute or injure pipelines and to the satisfaction of the Engineer's Representative.
- 424.11 The Engineer's decision shall be final in all matters relating to pressure testing.

#### 425 TESTING GRAVITY PIPELINES

- 425.1 Gravity pipelines shall be watertight and shall not admit infiltration. They shall be tested by the Contractor in the presence of the Engineer during the progress of the work at the completion of same and if so instructed immediately prior to payment of the retention money or at any time as the Engineer may direct. The Contractor shall remedy and defective or leaky pipes, chambers, etc., and remove all dirt, silt or other matter of obstructions from them.
- 425.2 All gravity pipelines shall be water-tested under a minimum head of 1m or to twice the height of the maximum ground water level as decided by the Engineer. In either case the pipelines shall be watertight. If permitted by the Engineer they may be alternatively tested by air under an initial pressure of 100mm. head of water and the test of water and the test shall be deemed to be satisfactory provided that the loss of head is not greater than 25mm. in five minutes.
- 425.3 In every case the water used for testing the pipelines shall be left in the pipes until they are covered with earth or other trench filling material to a depth of at least 1.2m over the top of the pipes and until permission is given by the Engineer for the water to be released. If after the Engineer has approved of the pipelines and has given permission for the trenches to be refilled the pipes become damaged and lose water form any cause and/or admit sub-soil water the contractor shall have the pipes uncovered and the defect made good and the pipelines retested as before to the satisfaction of the Engineer and all at the Contractor's sole expense.
- 425.4 The Contractor shall provide all water, labour, drain stoppers, bends, and other needful appliances for carrying out tests and no pipes or other work must be covered up until they have been seen and passed by the Engineer. The Contractor shall allow for testing and all associated work in his pipe laying rates.

# 426 PAINTING

- 426.1 All pipes and fittings exposed to view shall be painted after making good the manufacturer's premier of shop coat with two coats of "Bitumastic Aluminium Solution D. 5909" manufactured by Wailes Dove Bitumastic Ltd., Hebburn, Country Durham, England, or other approved paint.
- 426.2 Steel Pipes and fittings in manholes or chambers shall be painted with two coats of "Bituros Solution" manufactured by Wailes Dove Bitumastic Ltd., or other approved paint. Valves and surface boxes shall be similarly painted.

# 427 MANHOLES AND CHAMBERS

- 427.1 Manholes and chambers shall be constructed in accordance with the standard manhole detail drawings. Where the Contractor wishes to construct manholes or chambers other than in accordance with the said drawings he shall submit details to the Engineer for his approval at least 14 days prior to the intended date of commencement of construction.
- 427.2 The incoming and outgoing lengths of pipes shall terminate at the internal face of the concrete with spigot ends which in the case of concrete pipes shall not be cut ends. The concrete surrounding the spigot ends shall be placed in the single operation to at least 150mm. over the top of the pipes for the full thickness of the wall and the whole of the base wall brought up to the same level. The concrete shall be of a minimum thickness of 40mm. between the pipe and structural floor and particular care shall be taken to ensure that the concrete completely fill the spaces beneath pipes and that a sound joint is made all round each pipe.
- 427.3 Access opening to manholes shall be sited on the downstream side of manholes unless another position is necessary for accommodating the rodding-eye of a backdrop.

Manholes and chambers are no necessary to be placed centrally over pipelines but shall be so located that the best use can be made of the area of the bottom of the manhole of chamber when arranging channels, particular regard being paid to backdrop.

# 428 CHANNELS AND BENCHES

428.1 Channels in manholes and chambers are to be formed in Class '20' concrete benching finished with 50mm, minimum Class '20' fine concrete or as directed by the Engineer. The invert of the channel is to be formed to a fall not less than the lesser gradient of the two adjacent pipelines. All branch drains are to be connected to the main channel with half-channel branches of a proper angle and radius to lead into the run

of the main channel the bends being as "slow" as possible.

- 428.2 Sides of channels and benchings are to be finished with 50mm thick Class '20' fine concrete and all shall be homogeneous. Special care shall be taken to produce perfectly smooth finish all over and to ensure the uniformity of the slope of the benching of the top of the nosing and of the invert and that proper clearance is given round valves, penstocks and other fittings.
- 428.3 Sides of channels shall be carried up vertically above the half round channel and shall join the benchings with nosings of 25mm. radius. Benchings shall rise at a slope of one in six from the edge of the main channel starting from an assumed line between the crowns of the incoming and outgoing pipes. Inverts sides of channels and benchings of each manhole are to be completed before the chamber slab is placed in position.

#### 429 TESTING OF NON-WATER RETAINING STRUCTURES

- 429.1 Manhole chambers and other non-water retaining structures shall be watertight. The Contractor shall if so required test them in the presence of the Engineer.
- 429.2 The Contractor shall provide all water, labour, drain stoppers, bends and other needful appliance for carrying out tests and no work must be covered up until it has been seen and passed by the Engineer. The test to be applied to chambers of manholes and other chambers shall be the filling of the chambers with water to 75mm. above the slab or to ground level respectively and after giving due time for saturation of the concrete shall be topped up to the original level. Thereafter the loss shall not be greater than the equivalent of 12mm, over the whole area of the chamber in 24 hours.
- 429.3 All covers and frames with recessed seating or which are close fitting have the edges thoroughly greased before the plug is put into the frame, if necessary all edges shall be re-cleaned and re-greased at the completion of the Works.

# 430 FIXING OF MANHOLE AND INSPECTION FRAMES AND COVERS

- 430.1 Before being incorporated in the work all manholes and inspection frames and covers shall be thoroughly including the removal of all grease and rust and shall then be coated immediately with an approved bituminous of other compound.
- 430.2 The frames of manhole and inspection covers shall be set in roads paths etc. so that the cover shall be flush with the surface of the road or path and elsewhere 250mm proud of the surrounding ground, one or more courses as may be required of concrete blocks shall be used to adjust the level of the frames and the whole shall be set in and on 1;3 cement mortar.
- 430.3 All covers and frames with recessed seating or which are close fitting shall have the edges thoroughly greased before the plug is put into the frame. If necessary all edges shall be re-cleaned and re-greased at the completion of the works.

# 431. FIXING STEP IRONS AND OTHER FITTINGS

- 431.1 Step irons shall be of galvanised malleable irons and comply in all particulars to B.S. 1247.
- 431.2 All step irons shall be built in as the work proceeds and shall be staggered 300mm. apart horizontally and be 300mm apart vertically. The lugs on the underside of step irons shall only be permitted where it is impossible to build them in as the concrete is being cast.
- 431.3 When a valve or penstock is to be built into a manhole of chamber the necessary bolts and frames are to be placed in position of built in as the work proceeds.

# 432 PES BUILT IN OR THROUGH WALLS

432.1 Pipes shall be built in as work proceeds. Where this is not practicable or the Engineer shall have given instructions to the contrary, pipes shall be built in subsequently. In such cases and where in particular pipes have rigid couplings care shall be taken in setting them to ensure that after the concrete has been cast around the pipes all adjacent pipes can be coupled up without strain on the joints. Care shall be also be exercised to ensure that puddle flanges are in the correct position.

432.2 Pipe work passing through walls for which holes have been boxed out shall be jointed completely and then tested before other pipes are finally concreted into the walls.

#### 433 RIVER CROSSINGS

433.1 Payment for referenced river crossings will be made in accordance with the tendered rates for the respective works included in the relevant section of the Bill. The Contractor shall in addition be entitled to extra payment in the form of a single fixed lump sum for each of the referenced crossings which sum shall be deemed to be inclusive of all additional costs and expenses incurred or arising on account of river diversion works difficulty of access the handling and laying pipes etc. on piers the provision of scaffolding and all other matters or things which affect or influence the cost of completing each crossing and no variation in any of the fixed sums will be permitted on account of adverse weather conditions increased flow of a water in rivers and streams or any other thing resulting in the work being or greater difficulty or of longer duration than provided for by the Contractor.

# 434 VALVES, PENSTOCKS ETC

#### 434.1 General

- 434.1.1 All valves and penstocks shall be the best of their respective kinds and shall be obtained from an approved manufacturer.
- 434.1.2 All sluice valve with extended spindles shall be provided with suitable indication to show that 'fully open' and 'fully closed' positions. This indication shall be easily visible from the operating position.
- 434.1.3 All flanges on all valves shall be BS 4622 type NP 16 unless otherwise stated.
- 434.1.4 All items of Aluminium construction shall be isolated from concrete by the use of bituminous felt or D.P.C. material or two coats of bituminous paint. All aluminium shall be isolated from dissimilar metal by the use of fibre washers and spacers.
- 434.2 Sluice Valves
- 434.2.1 Sluice valves shall be double flanged unless otherwise specified and shall comply with BS 5150, 5151, and 5163 as appropriate. They shall be suitable for a maximum working pressure of 915 Kpa.
- 434.2.2 Each sluice valve shall have a drain plug fitted at the bottom of its seating so that accumulations of silt may be removed. Spindles shall be of the non-rising type and screwed so as to close the valves when rotated in a clockwise direction.
- 434.2.3 Valves shall be both open-end and closed-end tested.
- 434.2.4 All sluice valves shall have body marked with cast on or stamped lettering giving the following information:-
- (a) The manufacturer's name or trade mark
- (b) The working pressure in metres head of water for which the valve is suitable.
- (c) The nominal size of the valve in millimeters.
- 434.3 Check Valves
- 434.3.1 Check valves shall comply with BS 5153:1974 and shall be double flanged swing check valves with cast iron body having the following features:-
- (i) Detachable cover-plate of ample dimensions to facilitate inspection and withdrawal of the flap.
- (ii) Cast iron disc to close on to gunmetal seats at an angle of not more than 800 to the axis of the pipe
- (iii) An ample pocket below the flap into which may fall any solid matter which might otherwise prevent the flap from closing.
- (iv) Suitable stops or other means to prevent the flaps from opening to an angle of less than 300 with the axis of the pipe.
- (v) Hinged pin of gunmetal or stainless steel and extended on one side of the valve casing through a gunmetal bushed gland, and fitted with mild steel external lever.
- (vi) Gunmetal drain plug fitted at the bottom of the body.

434.3.2 The maximum velocity through any check valve shall not be greater than 2.5 metres per second and they shall therefore be suitably sized to meet this condition.

#### 434.4 Sludge Valves

434.4.1 Sludge valves shall be the screw operated type and have gunmetal faces, forged bronze spindles, gunmetal nuts, and bushes. The body, bridge, and door shall be in cast iron with the body of the valve terminating in a flange drilled to BS 4622 type NP 16.

#### 434.5 Flap Valves

- 434.5.1 All flap valves shall be of flat-back, double hung type.
- 434.5.2 Flap valve frames and doors shall be of either best quality cast iron with gunmetal sealing faces and bronze hinge pins, or of aluminium alloy NP8 plate to BS 1477 and NE8 extrusions to BS 1474 with approved seating arrangements, hinges, fittings and fixings or of approved composite plastic contraction.

# 434.6 Telescopic Valves

- 434.6.1 Telescopic valves or bell mouths, shall consist of high quality cast iron stand pipe with an easy sliding non-ferrous tube and cast iron discharge bell mouth or shall be approved plastic construction. The joint between the standpipe and sliding tube shall be sealed with a gland. The sliding tube shall be complete with guide rods.
- 434.6.2 The base of the standpipe shall be flanged to BS 4622 NP 16.

# 434.7 Hand stops

434.7.1 Hand stops and frames shall be of galvanised mild steel, aluminium alloy NP8 and NE8 or approved composite plastic construction. Doors greater than 300mm wide shall have two lighting handles. Aluminium and galvanised mild hand stops shall have nylon inserts or guides an dneoprene seals.

#### 434.8 Penstocks

- 434.8.1 All penstocks shall be of the fiat-back type and shall be watertight, when tested to 90 Kpa head and to reverse pressure as particularly specified.
- 434.8.2 Penstock frames and doors shall be of either best quality cast iron with two gunmental faces, aluminium alloy NP 8, plate to BS 1474 or shall be of approved plastic construction.
- 434.8.3 An adequate number of cast iron wedges shall be provided on the doors and adjustable suitably faced wedge blocks as necessary fixed to the frame. The frame shall be of substantial construction.
- 434.8.4 All penstocks shall be provided with mild steel spindles screwed for clockwise closing and running in a suitable nut housed in the head gear which shall have a handwheel or key for operation as indicated.
- 434.8.5 Suitable gearing or anti-friction devices such as ball-bearing thrust collars shall be provided as necessary to enable each penstock to be operated from the closed position by a 13kg 'push-pull' effort (total 26kg) at the rim of the hand wheel or tee key. All penstocks fitted with headstocks shall be supplied with rising spindles except where otherwise indicated.
- 434.8.6 Where specified or shown on the drawings level invert penstocks shall be used and shall have a flush invert with adequate sealing arrangements.
- 434.8.7 Weir penstocks shall have a perfectly level cill and shall be complete with top seal unless otherwise stated.
- 434.8.8 All penstocks shall be supplied complete with all necessary nuts, bolts or studs and washers for fixing in position.

## 434.9 Headstocks

- 434.9.1 Any headstock required shall be of cast iron complete with a gunmetal index pointer working over a polished and graduated gunmetal indicator plate which shall be fixed to the side of the pillar. The pillar shall not be drilled for fixing. Bevel gearing, when required, shall be provided in a totally enclosed oil bath, or grease lubricated bevel gear housing.
- 434.9.2 Cast Iron footplate brackets shall be provided where indicated for penstocks of less than 0.3m2 opening.
- 434.9.3 Galvanized Mild Steel flanged spacer tubes shall be provided where indicated and shall support the headstock from the penstock frame.
- 434.10 Hand wheels
- All hand wheels shall be of best quality cast iron with completely smooth and rounded rims and marked thereon with direction of opening.

All valves and penstocks shall open by an anti-clockwise rotation of the wheel or turnkey.

- 434.11 Extension Spindles
- 434.11.1 Extension spindles shall be of mild steel, sherardized or hot dip galvanized with the threaded portion left untreated.
- Where indicated universal joints of approved type shall be provided to allow offsetting of the extension spindles.
- Spindle lengths as given in the Bill of Quantities are measured from the inverts of the pipes or openings to the top of the squared end of the spindle or to the base of the headstock pillar as the case may be, unless otherwise indicated.
- 434.12 Guide Brackets
- Guide brackets shall be of the cast iron split bearing type, and shall be built into the wall. The maximum spacing between brackets shall not be greater than 150m0m.
- 434.13 Key heads
- Key-operated valves and penstocks shall be provided with cast iron caps to spindles.
- 434.14 Operating Keys, Spares and Special Tools
- 434.14.1 The Contractor shall include for operating keys, spares, and special tools. The spares shall suffice for 24 months operations. Operating keys shall be supplied for each key head up to a maximum of 6 No. in any one range.
- 434.15 Swivel Draw-off Arms
- 434.15.1 Swivel draw-off arms shall consist of a galvanized mild steel or approved plastic tube, cast iron bend and support pillar. The bend shall swivel on a watertight bronze or neoprene sealing gland at one end, a bronze pin fitted into the support pillar at the other. The cast iron support pillar shall be bolted to the floor of the tank or chamber.
- The draw-off arm shall be raised or lowered by means of stainless steel cable operating over a gear winch, which shall incorporate a locking device, or by rising mild steel spindles with indicating capstan pillars as specified.
- 434.16 Fixing
- All bolts, nuts, washers and foundation bolts with expanding shells shall be cadmium plated.

# 434.17 Testing

- The performance of each unit shall be tested at the Supplier's Works in accordance with the conditions stipulated in the appropriate British Standards and to the requirements of the Engineer's Representative.
- The acceptance by the Engineer's Representative of equipment after testing at the Supplier's works shall in no way relieve the Contractor of his responsibility for the performance of the equipment after erection.

# 434.18 Air Valves

- 434.18.1 Single orifice air valves shall be of the single acting type for the automatic admission and discharge of either large quantities of air during main emptying or filling or small quantities of air under pressure during normal working conditions of the main.
- 434.18.2 Each single orifice air valve shall be complete with an isolating valve or cock.
- Double orifice air valves shall be of the double acting type suitable for the automatic admission and discharge of bulk volumes of air during drainage and filling of the main, and for the release of small quantities of air during normal working conditions of the main.
- 434.18.4 Each double-orifice air valve shall be provided with a screw-down valve for isolating purposes. Isolating valves shall have gunmetal seats and stoppers and forged bronze spindles fitted with cast iron caps for key operation. The spindles of the isolating valves shall be screwed so as to close the valve when rotated in a clockwise direction. The isolating valves shall be suitable for manual operation against the maximum working pressure.
- The design of the double-orifice air valves shall be such that the balls do not blow shut under any working or test conditions when large volumes of air are being released.
- 434.18.6 All double-orifice air valves shall be flanged. Flanges shall be faced and drilled and shall conform to the dimensions specified in B.S. 4504 tables for NP 10 unless otherwise stated.
- 434.18.7 All double-orifice air valves shall be supplied drilled with a 20mm. dia. hole tapped British Standard pipe. Thread suitable for fixing of a pressure gauge. Holes shall be fitted with a brass screwed plug and copper compression ring gasket.
- Each air valve shall be suitable for the maximum working pressure stated in the Bill of Ouantities.
- Each air valve body shall be marked with cast-on or stamped lettering giving the following information:-
- (a) Manufacturer's name or trade mark
- (b) Working pressure in meters head of water
- (c) Size of air valve in millimeters
- 434.18.10 The air valves are likely to be exposed to tropical sun temperatures and the balls and other parts shall be suitable for these conditions.

# 435 uPVC PIPES AND FITTINGS

# 435.1 Pressure pipes

Unplasticised polyvinyl chloride pressure pipes and fittings shall comply with the latest revision of BS 3505 (1968) 'Unplasticised PVC pipe for cold water services' and BS 4344 Part 2 (1970), "Mechanical joints and fittings principally of unplasticised PVC'.

# 435.2 Gravity Pipes

Unplasticised polyvinyl chloride pipes and fittings shall generally comply with the latest revision of BS 5481:1977, 'Specification of uPVC pipe and fittings for gravity sewers' and B.S. 4660:1973, 'uPVC underground drain pipe and fittings'.

Pipes shall have a S.D.R. of 41 or 34

Class B pipes to B.S. 3505:1968, 'Specification for Unplasticized PVC pipe for cold water services' shall be acceptable for S.D.R. 41 pipes.

#### 435.3 General

Each pipe and fitting shall be supplied with 1 No. flexible joint.

Flexible joints shall be either:-

- (a) of the unplastised PVC sleeve or integral socket type and shall comply with BS 4355 Part 2 (1970)
- (b) Couplings of the Dresser, Viking Johnson or similar mechanical type providing they meet the requirement of Clause ....... of this specification.

Solvent cement joints are not acceptable.

#### 438 DUCTILE IRON PIPES AND FITTINGS

438.1 Ductile Iron pipes and fittings shall comply with the latest edition of BS 4772 (1971), 'Ductile Iron pipes and Fittings'.

Unless otherwise described all pipes and fittings shall be supplied with flexible joints of an approved type.

#### 439 STEEL PIPES AND FITTERS

#### 439.1 Standard of Manufacture

Steel pipes shall comply with BS 3601:19878 – Steel Pipes and Tubes, while fittings will conform to BS 534:1990 (dimensions) and AWWA C208-59 (reinforcing). Flanges will be to BS 4504:1989.

Flexible joints shall be by use of flexible coupling of approved pattern. Pipe for use with flexible coupling shall be true ended with pipe ends appropriately prepared for the type of coupling proposed.

# 439.2 Steel Grade, Minimum Wall Thickness, and Working pressures

The steel pipes shall be PN16 manufactured from steel grade B of yield stress not less than 235N/mm2 and able to withstand working pressure up to 200 meters water column (i.e. 20 Bars).

The minimum wall thickness shall be as follows:

Pipe (N.D) Minimum Wall Diameter (mm) Thickness (mm)

50 2.5 100 2.5

#### **SECTION 5**

#### **BUILDERS WORK**

# **INDEX**

500	GENERAL	
501	DAMP PROOFING	111
502	CEMENT	111
503	CEMENT MORTAR	111
504	RENDERING	
505	BLOCKWORK	113
506	MASONRY	
507	BUILDING PAPER	
508	PRECAST CONCRETE PATHS	114
509	IRONMONGERY	114
510	PAINTING	
511	GALVANISED STEEL TUBES WITH SCREWED JOINTS	114
512	TIMBER	115
513	CARPENTRY	115
514	JOINERY	116
515	PRESERVATIVE TREATMENT OF TIMBER	116
516	PLUMBING	
517	SANITARY INSTALLATIONS	
518	METAL DOORS, DOOR FRAMES, WINDOWS ND LOUVRES.	118
519	FLOORS	118
520	TERRAZZO	119
521	GRANOLITHIC FLOORING	
522	PVC FLOOR TILES	
523	WOOD BLOCK FLOORING	
524	PVC FLOOR TILES	121
525	WOOD BLOCK FLOORING	121
526	PLASTERING	121
527	TYROLEAN FINISH	122
528	ROOFS	122
529	ROOF TILES	123
530	FLATROOF WATERPROOFING - PREPARATION WORK	123
531	FLATROOF WATERPROOFING - FILLING JOINTS	123
532	FLATROOF WATERPROOFING - TREATMENT	124

#### **BUILDERS WORK**

# 500 GENERAL

500.1 The Contractor shall construct the building as shown on the drawings in conformity with the Specification. Where any particular material, good, or method of fixing or construction is not specified the Controller shall seek the approval of the Engineer.

500.2 The Contractor shall at all times use the best available materials and use only suitable and well established methods of construction, and shall ensure that the construction is in accordance with the Building Regulations of Kenya.

#### 501 DAMP PROOFING

- 501.1 A bituminous damp proof layer shall be inserted in the walls in accordance with the drawings, and shall be a bitumen impregnated fibre complying with BS 743, to be not less than 150mm above the finished ground level. Before applying the DPC, all surfaces must be clean and free from dust, dirt, grease and loose material.
- 501.2 Bituminous damp proof courses shall be laid with laps of not less than 75mm and bedded solidly in cement mortar and with the exposed edges pointed.
- 501.3 A polythene vapour barrier shall be laid on the blinding to all floors which shall first be screeded with 25mm thickness of fine sand or as detailed on the Drawings. Joints shall be made with a suitable adhesive in a welded lap joint.
- 501.4 Alternatively the blinding may be given not less than four costs of a suitable bitumen emulsion to

give a thickness of not less than 2 mm.

#### 502 CEMENT

502.1 The cement used for mortar rendering grout screeding and other construction work shall be in accordance with the specified in Section 3.

# 503 CEMENT MORTAR

503.1 Cement mortar for blockwork, masonry, rendering, tiling, screeding, pitching and jointing concrete pipes shall consist of Ordinary Portland cement and natural sand mixed by hand or an approved mechanical mixer in the proportions by volume of one part cement to three parts sand. The cement and sand shall first be mixed dry until the cement colour can no longer be distinguished from the sand in any part of the mass and the whole shall then be uniformly wetted by approved means while undergoing further mixing. The water content shall be just sufficient to ensure a dense mortar of still consistency and adequate workability to permit trowelling or floating into place.

The workability of cement mortar to be used for rendering may be improved by adding an approved plasticizer in the proportions recommended by the supplier of the plasticizer.

- 503.2 Mortar shall be prepared and used in such quantities that no more than 20 minutes shall elapse between first wetting and its completed use. Under no circumstances shall any mortar that has stiffened by commencing to set be used. Fresh mortar shall not be mixed with mortar prepared earlier and all batches shall be used entirely separately.
- 503.3 Sand for cement mortar to be used for rendering shall comply with BS 1199. Sand for cement mortar for all other uses shall comply with BS 1200.
- 503.4 Water used for cement mortar, rendering, grout, screeding and other construction work shall be in accordance with that specified in Section 3.

#### 504 RENDERING

- 504.1 Surfaces to receive a finishing cost of rendering shall be thoroughly cleaned. Concrete surfaces shall be roughened by treating the formwork with an approved retarder and wire brushing after removing the formwork whilst the concrete is still green to form an adequate key. Alternatively concrete surfaces shall be treated with an approved cement bonding agent in accordance with the manufacturer's recommendation.
- 504.2 Rendering shall consist of cement mortar with an approved plasticizer used as and in the proportions directed by the manufacturers and approved by the Engineer.
- 504.3 All surfaces shall be dampened as necessary and the rendering applied immediately afterwards. The rendering shall be applied in two coats of 20mm total thickness. The undercoat which shall have a thickness of 12mm shall be roughened to provide an adequate key for the finishing coat. A strip of expanded metal not less than 50mm wide and conforming to BS 405 shall be set in the undercoat at all joints between different surfaces being rendered (eg concrete/blockwork) and across all chases of electrical and similar services.
- 504.4 The finishing coat shall be applied with a wood skimming float and afterwards trimmed with a feather edge rule to a true and even surface. The surface shall then be thoroughly scoured with a hand float and any inequalities filled in. Overworking of the surface shall be avoided to reduce the tendency of surface crazing.
- 504.5 All rendering shall be protected from sun and rain by adequate and suitable coverings and the rendering shall be kept damp while setting. Any cracks or parts which sound hollow when tapped or other defects in the rendering shall be cut out and re-rendered.

#### 505 BLOCKWORK

505.1 Precast concrete blocks for blockwork shall be solid blocks or hollow blocks manufactured from Ordinary Portland cement as specified for concrete in Section 3 and aggregates conforming to BS 882. All blocks shall be manufactured mechanically by compression and vibration. The mix used shall be not richer than one part cement to six parts of combined fine and coarse aggregate by volume. Blocks shall be dried for 24 hours after which curing shall start for a period of not less than 10 days.

After curing all blocks shall be grouped carefully stacked and shall not be laid before 28 days after casting. All blocks shall be cast in clean moulds or accurate shape and dimensions. The tolerance on all dimensions shall be +/- 3mm and no membrane or web of any block shall be less than 40mm. Unless otherwise stated on the Drawings, solid blocks shall attain a strength not less than 3.5 N/mm2 after 28 days and hollow blocks shall attain a strength not less than 3.0 N/mm2 on the real area after 28 days.

- 505.2 All blocks shall be handled and stacked with care. The blocks shall be stacked protected from rain by a cover and in such a way that air circulates around them. No broken block or block of improper quality shall be used.
- 505.3 All blockwork shall be bonded pointed and uniformly bedded in true horizontal coursed in cement mortar and built true to line and profile. Blockwork shall be carried up evenly and in regular stages and no part shall be raised more than 1m above any other part of work at any time. All blocks shall be well soaked before use and the top of unfinished walls wetted and raked back before work is recommended. All blockwork shall be built with vertical shall exceed 12mm thickness. Courses shall be properly levelled and perpendicular joints, quoins, jambs and angles shall be plumbed as the work proceeds.
- 505.4 Blockwork which is not to be rendered shall be finished with a fair face and the blocks shall be selected for even texture and unmarked faces regular shape and square unbroken arises. The blockwork shall be pointed as the work proceeds with a neat joint as required by the Engineer's Representative. Where blockwork is to be rendered the joint shall be raked out 12mm deep as the work proceeds to form an adequate key.
- 505.5 Blockwork shall be bonded o concrete columns and walls by approved galvanized metal ties cast into the concrete spaced at alternate courses and extending not less than 150mm into the block joints.
- 505.6 In unreinforced blockwork the block cavities shall be filled with Class 20 fine concrete.
- 505.7 In reinforced blockwork the block cavities shall be similarly filled with Class 20 fine concrete and reinforced with steel bars as detailed on the Drawings.
- 505.8 Chases shall be cut as necessary for services but no excessive cutting will be permitted. Chases shall be made good after the erection of services by building in pieces of block or mortar.

# 506 MASONRY

- 506.1 Masonry shall be constructed from approved hard durable stone laid to bond. The stones shall be rough dressed so that the beds and sides are roughly perpendicular to the exposed face of the wall. The joints shall be 12mm thick on the average and completely filled with mortar. The face of the work shall be true to profile and the joints shall be neatly pointed in mortar.
- 506.2 Where the walls are to be rendered the joints shall be raked out to a depth of 12mm to form a key.

#### **SECTION 7**

FENC	· -	
205	INDEX	
206	GENERAL REQUIREMENTS	136
207	CONCRETE POSTS FOR CHAIN LINK FENCING	136
208	CHAIN LINK FENCE	137
209	BARBED WIRE FENCING ON WOODEN POSTS	138
210	GATES	139

#### SECTION 7 -FENCING

# 700 GENERAL REQUIREMENTS

#### 700.1 Erection

As soon as the Contractor is placed in possession of any part of the site he shall immediately erect fencing on the boundaries of the land where shown on the Drawings. In places where permanent fencing cannot be erected immediately, or where none is required, the Contractors shall, as directed by the Engineer, erect, and when and where required re-erect and maintain temporary fencing as is necessary for the proper protection of the works.

#### 700.2 Access

Provision shall be made in temporary fencing for Access, where directed by the Engineer, for the use of owners, tenants and any other occupiers of the 'adjacent lands. Temporary fencing shall remain in position until it is replaced by permanent fencing or completion of the whole of the works unless the Engineer permits its earlier removal.

#### 700.3 Maintenance

All fences shall be regularly inspected and maintained, any defects being made good immediately they are noticed by or brought to the attention of the Contractor. The Contractor shall be responsible for all wear and tear of fencing howsoever arising until the construction of all other works has been completed, when the permanent fencing shall be handed over in sound condition, and the temporary fencing shall be removed.

#### 700.4 Temporary Fencing

Unless specified otherwise on drawings of directed otherwise by the Engineer, Temporary fencing shall be post and wire fencing to BS 1722 Part 3 Type SW 48 using plain wire and round wooden posts, or an alternative approved by the Engineer which shall not be inferior. Where temporary fencing has to be removed temporarily for the execution of any part of the works it shall be reinstated as soon as possible and in the meantime the gap in the fencing shall be patrolled to ensure that no unauthorized crossing of the fence line occurs, and that no animal stock escape from adjoining lands.

# 701 CONCRETE POSTS FOR CHAIN LINK FENCING

#### 701.1 Standard

In general all fencing is to be in accordance with BS 1722, Part I: 1963.

#### 701.2 Reinforced Precast Concrete Posts

Concrete posts and struts shall be of Class 30 reinforced concrete, generally in accordance with Section 3 of the Specification. The course aggregate shall not exceed 10 m.

## 701.2.1 Straining Posts

These shall be 130 mm square in Section and 3.280 metres long overall with 600 mm top length cranked at an angle of 45 degrees to the vertical, slightly rounded at the external and internal cranked angles and also at the top end. The post is to be reinforced with 4 No. 8mm diameter mild steel bars bound by No. 12 SWG wire (2.64 mm diameter) stirrups placed at 150 mm intervals, and suitably holed for stretcher bolts or stirrup wires. The minimum concrete cover to the reinforcing bars shall be not less than 15 mm. The post will be notched twice to receive ends or raking struts. Two faces of the post will have two sets of galvanised mild

steel angleiron cleats held by galvanised 25 mm x 4 mm GMS flatiron stretcher bar and GMS bolts and nuts.

The strainer posts shall be provided at all ends and corners, at changes in direction or acute variation in levels and at intervals not exceeding 70 metres in straight length of fence. The post shall be set in the ground to a depth of 0.75 m in a 450 mm square hole which is to be backfilled with Class 15 concrete.

# 701.2.2 Special Corner Posts

These shall be provided at all corners. The posts shall be 130 mm square, generally as straining posts, but the top cranked length and angle shall be altered to suit the corner angle to allow he barbed wire to run straight and level

The post shall be set in the ground to a depth of 0.75m in a 500 mm square hole which is o be backfilled with Class 15 concrete.

# 701.2.3 Struts or Stays

The raking struts shall be 100 mm square in section and 3.000 m long overall with one end splayed to suit the notch in the strainer post. The strut is to be reinforced with 4 No. 8mm dia. mild steel bars held by No.12 SWG wire stirrups placed at 130 mm intervals. The strut will be suitably holed for fixing by GMS bolts through the strainer post. The strut will be set in the ground in a hole 300 mm wide by 850 mm long by 750 mm with Class 15 concrete and the rest with good earth.

# 702 CHAIN LINK FENCE

- 702.1 The line shall be so erected that on completion it is truly on the boundary line of the plot. The top of the fence shall follow a general profile of the ground as agreed by the Engineer. The fence shall be embedded up to a depth of 80 mm underground which will be graded to a general profile prior to the erection of the fencing.
- 702.2 Chain link fencing shall comply with BS 1722, Part 1, Clause 4 in general, and shall be of 50 mm galvanised mesh, not less than No. 10.5 SWG, and shall be Type LC 72.B.
- 702.3 Fittings for securing the fencing to the p.c.c. posts shall be in accordance with BS 1722, Part I, Clause 14 and shall be heavily galvanised.
- 702.4 Line wire shall be No. 9.5 SWG galvanised wire, and shall be attached and strained tightly to each straining post by means of winding brackets and to intermediate posts by a wire stirrup passed through a hole in the post. The top wire shall be secured 25 mm below the top and the bottom wire reasonably close to the ground. The intermediate wire shall be secured approximately midway between top and bottom wires.
- 702.5 Stirrup wire shall be No. 12.5 SWG galvanised wire
- 702.6 Tying wire for securing the chain link fencing to the line wire shall be galvanised No. 14.5 SWG.
- 702.7 Three rows of barbed wire shall be attached and stained to each straining post and secured with stirrup wire to holes in the cranked top of each intermediate post.
- 702.8 In general all chain link fencing shall be fixed according to BS 1722, Part I, Clause 22.
- 703 BARBED WIRE FENCING ON WOODEN POSTS
- 703.1 All timber used for fencing shall be well seasoned, straight grained red cedar.
- 703.2 Straining Posts shall be 2.60 m long and 150 mm in diameter. These shall be firmly embedded in ground and shall be provided at all ends, corners, and acute changes in direction or level, and shall be erected at intervals not exceeding 100 m in straight lengths of fences.
- 703.3 Struts shall be 100 m in diameter and 3.0 m long secured to the straining post at an angle of 450 with a bird's mouth rebated joint spiked through with at least 2 No. 45 mm galvanised iron nails in previously drilled holes. The foot of the strut shall be sunk into the ground to a depth of 0.75 m and the roots shall bear against the undisturbed ground. There shall be one strut to each line of wires leaving the post.

- 703.4 Intermediate posts shall be 2.40 m long and of 100 m diameter and either pointed at one end and driven into the ground to a depth of 0.60 m or sunk into the ground by excavating a hole and backfilling. These shall be provided at intervals of not exceeding 5 metres.
- 703.5 Droppers shall be40 to 50 mm in diameter and 1.5 m long, threaded between wire strands at intervals not exceeding 5 m between strainer posts, except where intermediate posts occur.
- 703.6 The fence shall consist of six strands of wire spaced at 0.286 m intervals, the bottom strand being 0.30 m and the top 1.75 m from ground level or such other spacing as directed.
- 703.7 The top wire shall be No. 12 SWG two ply galvanised steel wire with four point barbs 150 mm apart. The lower 5 strands shall be either the same as the top wire, or plain No. 8 SWG galvanised wire, as set out in the Bill of Quantities. Binding wire, where used, shall be No.12 SWG galvanised and the stapled shall be 38 mm No.8 SWG galvanised. The wire shall comply with BS 1052 and the galvanizing to BS 443. The minimum breaking strength for plain No. 8 SWG steel wire shall be 1110 1b. and for two ply 12 SWG barbed wire 950 1bs.
- 703.8 Each wire shall be strained tight by means of at least one ratched winder or other approved strainer and the end made fast by two complete turns round the strainer post and by two staples driven tight. Each wire shall then be attached to the intermediate post and dropper by a single staple or binding wire.

#### 704 GATES

700.1 Gates shall be constructed to details shown on the drawings. All steelwork shall comply with the requirements of Section 9 of the Specifications.

#### SECTION 8 - DRAINAGE

#### **INDEX**

801	-	GENERAL	141
802	-	uPVC PIPES	141
803	-	CONCRETE PIPES AND FITTINGS	141
804	-	JOINTING CONCRETE PIPES	142
805	-	PIPES ON GRAVEL BEDDING	142
806	-	LAYING PIPES FOR SEWERAGE AND DRAINAGE	142
807	-	CONSTRUCTION OF CHAMBERS AND MANHOLES	142
808	-	INSPECTION COVERS AND MANHOLE COVERS	143
809	-	TESTING DRAINS, MANHOLES, ETC	143
810	-	RAINWATER PIPES AND GUTTERS	144

# **SECTION 8**

#### **DRAINAGE**

- 801 GENERAL
- 801.1 All drainage works shall comply with the Building Code of the Republic of Kenya, and any local by-laws.
- 801.2 The Contractor shall bring to the Engineer's attention in writing any part of the Works which he considers does not conform to such code or bylaws. If the Engineer considers that such part of the Works does not so conform he will issue an instruction.
- 802 uPVC PIPES
- 802.1 Unplasticised polyvinyl chloride (uPVC) pipes and fittings for sewerage and drainage shall comply generally with BS 3506, Class "B" and shall be obtained from an approved manufacturer. Joints shall comply with BS 4346 Part 1.

#### 803 CONCRETE PIPES AND FITTINGS

- 803.1 Concrete pipes and fittings shall comply generally with BS 5911: Part 1 and shall be obtained from an approved manufacturer. The pipes and fittings shall have a smooth internal surface and the internal dimensions shall be true and regular and shall permit an even invert to be laid.
- 803.2 Before any length of pipe is laid all pipes shall be stood or slung vertically along the sides of the trench and be 'rung' with a wooden mallet. Any damaged or cracked pipe shall be rejected.
- 803.3 The bedding to and class of concrete pipes shall be suitable for the total external loads to be imposed on them, having consideration to the depth of cover, soil type, trench width and location. The Contractor shall determine the bedding type and class, full calculations shall be submitted to the Engineer for approval before the pipes are laid.
- 803.4 Joints be of either rubber ring or spun hempen tarred yarn type.

#### 804 JOINTING CONCRETE PIPES

- 804.1 Immediately before each pipe having a spigot and socket joint is laid a gasket of 12 mm spun hempen tarred yarn shall be looped around the spigot end which shall then be firmly pushed home into the socket of the preceding pipe. The yarn shall be cut to such a length as to form a butt joint at the top of the pipe. The yarn shall be caulked into the joint with a caulking tool particular care being taken to ensure that the spigot end is held truly central in the socket. A jointing mixture of cement mortar as specified shall then be forced into the joint with the fingers. The compound shall be finished square with the end of the socket with a trowel. No joint shall be cemented until the gaskets of the next three joints in advance have been completed.
- 804.2 In the case of concrete pipes with ogee joints he joints shall be buttered with cement mortar before pressing the pipes together and then flush pointed internally and externally.
- 804.3 Any jointing material which gets inside the pipes when a joint is being made shall be removed by a "budger" which must be kept in the pipes during the time they are being laid. The badger shall be pulled

forward and the surplus jointing material removed immediately after the laying of each pipe and before the next one is placed in position so that the barrel of the pipe is left perfectly smooth and clean.

804.4 Joints shall be cured by covering with sacking which shall be kept moist until the joints have completely set.

#### 805 PIPES ON GRAVEL BEDDING

- 805.1 Unless otherwise dictated by the requirements of sub-clause 804.3, all concrete and uPVC pipes for drainage sewerage and ducts shall be laid on a 100 m thick gravel bedding brought up to at least the horizontal diameter of the pipe. The bedding material shall consist of crushed stone or gravel passing an 11.2 mm sieve but retained on a 4 mm sieve mixed with coarse sand in the proportions of 2 parts of stone or gravel to 1 part sand.
- 805.2 Coarse graded gravel all-in ballast or screened selected excavated material may be used for the gravel bedding if it is of similar grading to that specified above and to the approval of the Engineer.

# 806 LAYING PIPES FOR SEWERAGE AND DRAINAGE

806.1 Pipes shall be laid true to line stretched along the side of the pipes and true to level by means of a straight edge 4 m in length kept inside the pipes and pulled forward to pegs boned in at suitable intervals between sight rails set to the proper levels. All pipes shall be cleaned out as the work proceeds.

# 807 CONSTRUCTION OF CHAMBERS AND MANHOLES

- 807.1 Chambers and manholes shall be constructed as shown on the detailed Drawings in the locations shown on the drawings or as directed by the Engineer.
- 807.2 Step irons shall be built into the walls as the work proceeds. Step irons shall be of galvanised malleable iron, complying in all particulars to BS 1247 and set at 300 mm centers vertically and 300 mm apart horizontally center to center.
- 807.3 Invert channels to chambers and manholes for sewers and drains (where used) shall be laid in precast concrete channels to the fall of the pipeline and jointed in cement mortar. All branch drains shall be connected to the main drain channel with half-channel bends of a proper angle and radius to lead with the run of the main drain channel, the bends being as "slow" as possible. The invert of the branch drain shall where possible be at least 80 mm above the invert of the main drain. Where it is found impossible to give a satisfactory lead with a precast concrete channel, the Engineer's Representative may direct the invert channel to be formed in concrete and rendered.
- 807.4 Manholes and chambers constructed of blockwork shall be rendered internally with 1:3 cement sand mortar. Manholes and chambers constructed of blockwork and protruding above ground level shall be rendered externally with 1:3 cement sand mortar to be depth of 200 mm below finished ground level. Manholes and chambers constructed of concrete cast in-situ shall be finished with fair faces and shall not be rendered.

# 808 INSPECTION COVERS AND MANHOLE COVERS

- 808.1 Manholes and chambers shall be fitted with covers and frames as indicated on the Drawings.
- 808.2 Heavy duty covers shall be fitted to manholes and chambers in roadways and in verges adjacent to roadway. Heavy duty covers shall be suitable for a wheel load of not less than 11 tonnes and shall be of the three point suspension non-rocking type.
- 808.3 Except where otherwise specified on the Drawings, medium heavy duty covers shall be fitted to manholes and chambers not subject to traffic loading. Medium duty covers shall be suitable for a uniformly distributed loading of not less than 70 kN/m2 and shall be of the recessed steel type suitable for in-situ filling with concrete.
- 808.4 Covers fitted to manholes and chambers on sewers and drains shall be of the sealed type. The Contractor shall submit to the Engineer's Representative for approval full details of all inspection and manhole covers to be supplied.

- 808.5 All manhole and inspection covers shall be set in cement mortar or built into concrete slabs as shown or directed to the correct levels, cambers or falls.
- 809 TESTING DRAINS, MANHOLES ETC.
- 809.1 All drains and manholes shall be watertight and clean throughout and shall be tested by the Contractor under a minimum head of 1 m in the presence of the Engineer's Representative during the progress of the work at the completion of same and if so instructed immediately prior to the payment of the retention money or at any time as the Engineer may direct.
- 809.2 No pipelines or other work shall be covered up until they have been seen and approved by he Engineer's Representative.
- 809.3 Should the pressure fall during test the Contractor shall locate the leaks and make them good after which the pressure shall be re-applied and the process repeated until the drains are satisfactory.
- 809.4 In every case the water used for testing the pipes shall be left in the pipes until they are covered with earth or other filling to the top of the trench or depth of at least 1.2 m over the top of the pipes and until permission is given by the Engineer's Representative for the water to be released. If after the Engineer's Representative has approved the pipes and has given permission for the trenches to be refilled the pipes become damaged and lose water from any cause and/or admit subsoil water the pipe shall be uncovered and the defect made good and the pipe retested as before to the satisfaction of the Engineer's Representative.
- 810 RAINWATER PIPES AND GUTTERS
- 810.1 Asbestos-cement rainwater down pipes, fittings and gutters shall comply with BS 569.
- 810.2 PVC rainwater down pipes, fittings and gutters shall comply with BS 457.
- 810.3 Cast iron rainwater down pipes shall be of medium grade and comply with BS 460.

# PREAMBLE AND NOTES TO BILLS OF QUANTITIES

- 1. These Bills of Quantities form part of the Contract Documents and are to be read in conjunction with the Conditions of Contract, Standard and Special Specifications and Drawings. The Particular Specifications overrides any Clauses / General Specifications given in the Preamble.
- 2. Whenever reference is made to "The Engineer" or "The Engineer's Representative" in the Bills of Quantities, it shall be construed to mean the person appointed by the Employer to act as the Project Manager or Engineer for the purposes of the Contract and named in the Contract Data, or other person appointed from time to time by the Employer and notified to the Contractor.
- 3. The quantities set forth in the Bills of Quantities represent the character of the work to be carried out. There is no guarantee to the Contractor that he will be required to carry out the quantities of work indicated under any one particular item or group of items in the Bills of Quantities. Though on the Contract as a whole, the quantities are intended to represent the overall value of the work to be carried out.
- 4. The prices and rates inserted in the Bills of Quantities will be used for valuing the work executed and the Engineer will measure the whole of the works executed in accordance with the Contract.
- 5. The prices and rates inserted in the Bills of Quantities are to be the full inclusive costs of the works described under the items, complete in place and in accordance with the Specifications and Drawings, including setting out of the works, including costs and expenses which may be required in and for the construction of the works described, together with any temporary works and installations which may be necessary and all general risks, liabilities and obligations set forth or implied in the Documents on which the Contract is based.
- 6. The brief description of the items given in the Bills of Quantities are purely for the purpose of identification and in no way modify or supersede the detailed descriptions given in the Conditions of Contract, Specifications or Drawings. When pricing items, reference is to be made to the Conditions of Contract, Standard Specifications, Drawings and Special Specification for the full directions and description of work and materials.
- 7. A price or rate is to be inserted, in ink, against each item in the Bills of Quantities, whether quantities are stated or not, and if the Bidder includes the cost of a particular item elsewhere in his rates or prices, he shall insert the word "nil" against both the rate and extension of that particular item. Should the Bidder omit to price an item, then it will be assumed that he has included the cost of the item elsewhere in his rates or prices.
- 8. No alteration shall be made to the Bills of Quantities and no extra item shall be inserted. The Bidder shall satisfy himself that the Contract Sum arrived at by pricing the quantities and items given is sufficient compensation for constructing and maintaining the whole of the works in accordance with the Contract Documents.
- 9. Lump Sum values shall not be inserted where unit rates are applicable and the contractor shall ensure that identical items occurring in separate bills are not priced at different rates, unless this is the deliberate intention.
- 10. The contractor shall check against the summaries that each copy of the Bill of Quantities is complete in the number of pages and in the reproduction of each page.
- 11. Unit rates, prices and extensions shall be given in the Kshs with Cents taken to two decimal places.
- 12. The Bill of Quantities has generally been measured in accordance with Civil Engineering Standard Method of Measurement Fourth Edition (CESMM4), as published by Institution of Civil Engineers (ICE) publishing,40 Marsh Wall, London E14 9TP
- 13. The Quantities inserted against items in the Bill of Quantities are estimated quantities of the Works for the purpose of Tender Evaluations, and the Contractor shall be deemed to have checked and verified such quantities in the compilation of his Tender Price prior to the submission of his Tender. Upon the award of the Contract, the priced Bill of Quantities shall be used solely for evaluating interim payments due to the Contractor, and as a schedule of rates for establishing the value of variations.
- 14. The Contractor shall not use the Bill of Quantities for the purpose of ordering materials or arranging Subcontractors. References to these activities shall be the Specifications and Drawings and instructions issued by the Engineer.

- 15. For the purpose of payment by Interim Certificate of "Lump Sum" items the Engineer may assess the portion of the work completed on the "Lump Sum" item and allow for payment of the portion of the "Lump Sum" he deems fair and reasonable. The total of all portions allowed shall not exceed the "Lump Sum". All interim payments shall be subject to the retention stipulated in the Contract Documents.
- 16. During construction, the unit rate established for an item in one Bill of Quantities may be used as a basis for establishing a unit rate for similar work in another Bill of Quantities which contains no such item. No additional cost will be considered for such an eventuality.
- 17. The Contractor will be provided by the Employer with all that land occupied by the Permanent Works including the specified working width for pipe laying and other permanent construction works. The costs of compensation and entry upon land (if any) for the specified working width will be paid by the Employer. All other costs for temporary access to the works or additional working space shall be borne by the Contractor.
- 18. All costs related to strict adherence to all Health and Safety regulations stipulated in the National Legislation of Kenya as well acceptable international good practices for both temporary and permanent works pertaining to nature of the works under this Contract, shall be deemed included in the Contractor's rates.
- 19. It shall be the responsibility of the Contractor to arrange for the removal of, or alteration to existing services where necessitated by the Works. Costs incurred will be paid under relevant items in the Bills of Quantities.
- 20. Quantities for site clearance, stripping and spreading shall be based on plan area cleared or stripped.
- 21. The rates for excavation items shall be deemed to include inter alia for setting aside spoil for reuse in the Works or disposing to approved tips identified by the Contractor in liaison with the Local Authority and approved by the Engineer, except where otherwise provided for in the Bills of Quantities.
- 22. Generally, excavation items are based on volumes for structures and on linear measurements for certain pipelines. The work may be covered by one or more items. The rates shall include as appropriate for:
  - a) Breaking through surfaces, handling different classes of material separately; excavation beyond the net plan area of the foundations, for safe working space and for battering or timbering etc.
  - b) Timbering
  - c) Dealing with water from any source whatsoever
  - d) Backfilling as specified
  - e) Disposal of surplus spoil
- 23. Measurement of volume of excavation for structures shall be calculated from the plan dimensions of the structure without allowance for working space.
- 24. The depth of excavation in pipe trenches will be measured from stripped ground level to the invert of the pipe. Measurement for other excavations will be to the size which is required to accommodate the permanent works. A Bidder shall accordingly allow in his prices for any amount of extra excavation, which may be necessary for safe working space to complete the work to the satisfaction of the Engineer.
- 25. Items are included for "Extra Over for Rock" on a volume basis and within the specified trench dimensions. The rates shall include for breaking out, mucking and disposal by method(s) approved by the Engineer and any other additional costs for other works or special methods adopted for excavation and disposal by the Contractor, encountered within measured excavation.
- 26. Different rock classifications are defined in the Specifications and have been billed separately. Rock shall be measured as a volume calculated from the thickness encountered within the plan area of a mass excavation, within the plan dimensions of a structure, or within the nominal width of a trench.
- 27. The decision of the Engineer on the classification of rock encountered in excavation shall be final and binding. Note: Any excavation of murram in whatever form will be taken as common excavation.
- 28. Timbering left in excavations shall only be measured for payment where it is specified or ordered by the Engineer.
- 29. Excavation by mechanical equipment may not be possible in some area due to restricted wayleaves, slopes/topographical features, ground water from whatsoever source, existing structures, drains, roads, trees, fences, walls, etc. The Contractor's rates for pipe trench excavation shall be deemed to cover mechanical and/or manual excavation. No claim for restricted space or double haulage will be entertained.
- 30. The Contractor shall indemnify the Employer against all claims for damage which in opinion of the Engineer may be caused by Excavation. This includes reinstatement of road surfaces, drains, fences, wall, culverts, etc., all in

accordance to relevant authority.

- 31. When the site of any particular item of the Works has been sufficiently cleared of trees, undergrowth etc. and before any excavation or filling has been carried out, the Contractor shall carry out a survey under the Supervision of the Engineer's Representative to take, record and agree upon an adequate number of original ground levels. The data so obtained shall be used as a basis for the computation of excavation and filling and preparation of "As-Built" Drawings by the Contractor. If for whatever reason the Contractor commences excavation without taking levels, the Engineer's decision on the original ground levels to be used for computation will be final.
- 32. The volume of fill will be measured net to the finished levels as shown on drawings or as amended by the Engineer.

# 33. METHOD RELATED CHARGES

- a) In order that the Contractor may cover his cost in executing specific portions of work, where those costs are not properly attributable to the quality of permanent works to be executed, he may cover such costs in the Bills of Quantities in accordance with the following provisions.
- **b**) For the purpose of these charges the following words and expressions shall have the meaning hereby assigned to them.
  - i. 'Method Related Charge' means the sum for an item inserted in the Bills of Quantities by a Bidder in accordance with paragraph 20 c).
  - ii. 'Time Related Charge' means a Method Related Charge for work the cost of which is to be considered as proportional to the length of time taken to execute the work.
  - iii. 'Fixed Charge' means a Method Related Charge which is not a Time Related Charge.
- c) A Bidder may insert in the Bills of Quantities, in the Bill provided, such items for Method Related Charges as he may decide to cover items of work relating to his intended method of executing the works, the costs of which are not to be considered as proportional to the quantities, rates and prices for the other items.
- **d**) Each item for a Method Related Charge inserted by the Bidder shall be fully described so as to define precisely the extent of work covered and to identify the constructional resources (plant, equipment, etc.) to be used and particular items of permanent or temporary works to which the items relate. The description shall include the type of charge (Time Related or Fixed) and in the case of a Time Related Charge, shall include also the expected duration, and the rate of charge.
- e) The insertion by a Bidder of an item for a Method Related Charge in the Bills of Quantities shall not bind him to adopt the method stated in the description of the item. However, in the case of a Time Related Charge, where the method is changed, a revised rate of charge shall be used taking account of the revised execution period to give the same total charge, had the original method, time and charge rate been adhered to.
  - If the charge is a Fixed Charge, then payment to the Contractor for such an item shall be in equal installments spread evenly throughout the duration of that part of the works which is the subject of the Fixed Charge.
- f) Method Related Charges shall not be admeasured but shall be deemed to be prices for the purpose of Clauses 36 of the Conditions of Contract and shall be paid in accordance with Clause 40.4 of the Conditions of Contract.
- g) In the event of the satisfactory execution of any part of the works which has been the subject of an item for a Method Related Charge using, whether in whole or in part, a method other than that described in the item, the Contractor shall nevertheless be entitled to payment of the Method Related Charge or the balance thereof, as the case may be, such instalments at such times and upon such events as may from time to time be agreed between the Engineer and the Contractor. In default of such agreement the Method Related Charge, or the balance then unpaid, shall be allowed to the Contractor by way of instalments in interim certificates at such times and upon such events as the Engineer shall decide.

The amount of Method Related Charge shall be neither increased nor decreased by reason of any change in method made by the Contractor, unless such change has been ordered by the Engineer, in which case the provisions of Clause 38 of the Conditions of Contract shall apply.

- 34. The rates for concrete shall include for fresh and hardened concrete tests prescribed in the Specifications including making and testing concrete cubes and forwarding the results to the Engineer. Testing to be carried out by a Test Laboratory approved by the Engineer. The Contactor shall maintain a written log of cubes prepared indicating date of testing and results achieved. The Contractor shall designate a qualified person for preparation and follow-up on cube tests in co-ordination with the Engineer's Representative.
- 35. The rates for precast concrete paving shall include for all cutting, bedding, jointing and laying to falls.
- 36. The rates for precast concrete edging and kerbs shall include for formwork, concrete bed and backing, all cutting, jointing and laying.
- 37. All formwork must be cleaned and oiled prior to use. All exposed concrete edges shall have a 20 mm chamfer unless otherwise directed and costs deemed to be included in formwork rates. The formwork rates shall also be inclusive of all necessary box outs and cut outs for individual holes up to 1 square metre.
- 38. The rates for forming rebates in concrete walls etc. shall include for forming pockets for the fish tail fixing cleats where required.
- 39. Deductions from formwork quantities will be made for openings more than 1 square metre in area.
- 40. Formwork for upper surfaces inclined at 30 degrees or less to the horizontal is not measured and the cost of any such formwork used will be deemed to be included in the relevant concrete item rate.
- 41. Wrought formwork where specified will be measured to 150 mm below final ground levels.
- 42. Items required for Structural Joints and Construction Joints shown on drawings shall be paid for as per the rates in the Bills of Quantities; the rate for providing and fixing PVC water bar is deemed to be inclusive of all joints, overlaps, junctions, welding, etc. formwork not shown on drawings shall be deemed to be included in the unit rates for concrete work.
- 43. All rates and sums in the Bills of Quantities shall be in Kenya Shillings and Cents.
- 44. If possible, a construction wayleave of up to 9m for the Transmission Mains and construction wayleave of up to 3m for Distribution Mains will generally be allowed. In the event the above-mentioned wayleave widths are not available due to obstructions or restricted access, the Contractor will execute the works using suitable approved alternative methods. The costs for alternative methods are deemed to be covered by bid rates. No additional costs will be allowed.
- 45. Payment for site clearance will be based upon this width except that the Engineer reserves the right to restrict this width due to the presence of obstructions, roads, houses, footpaths, boundary walls, fences, trees and the like. Payment shall then be according to the actual area cleared. In case additional space is required this may be made available by the Contractor at his own cost.
- 46. No claim for additional space will be entertained by the Engineer. No claims for inconvenience and the like caused by obstruction will be entertained. The rates shall be deemed to include for reinstatement of fences, gates, etc.
- 47. All pipe diameters indicated in the Bills of Quantities and on Drawings are nominal. Fittings dimensions to suit size/type of pipes supplied by the Bidder and Bidder's rates are deemed to allow for this. No additional cost adjustment will be allowed.
- 48. The Bill of Quantities has generally been measured in accordance with Civil Engineering Standard Method of Measurement Fourth Edition (CESMM4), as published by Institution of Civil Engineers (ICE) publishing,40 Marsh Wall, London E14 9TP.A Contractor shall be deemed to have priced the items accordingly and no claims relating to variation from the method of measurement stated in these documents shall be considered.
- 49. Items for buildings, electrical and mechanical works are not described using CESMM 4 for clarity purposes.
- 50. All quantities have been measured in Metric Units.
- 51. Explanation of abbreviations used in the Bills of Quantities are as follows: -

L.S.	_	Lump Sum
P.S.	_	Provisional Sum
P.C.	_	Prime Cost
E.O.	-	Extra Over
Avg.	_	Average
Max.	-	Maximum
Min.	-	Minimum
n.e.	-	Not Exceeding
Nr	-	Number
mm	-	Millimeter
m	-	Linear Meter
$m^2$	-	Square Metre
$m^3$	-	Cubic Metre
На.	-	Hectare
Drg.	-	Drawing
Kg.	-	Kilogramme
H.T.	-	High Tensile
M.S.	-	Mild Steel
B.L.	-	Bitumen Lined
Dia.	-	Diameter
E.C.	-	Epoxy Coated
E.L.	-	Epoxy Lined
S & S	-	Socket & Spigot
C.L.	-	Cement-mortar Lined
C.I.	-	Cast Iron
D.I.	-	Ductile Iron
uPVC	-	Unplasticised Polyvinyl Chloride
G.I.	-	Galvanised Iron
G.M.S.	-	Galvanised Mild Steel
P.E.H.	-	Palothene
PE	-	Polyethylene
Hr.	-	Hour
FE/Fe	-	Ferrous

- 52. The rates for metalwork shall include for bolts, nuts, washers and rag-bolts, fixing as specified or in accordance with the manufacturer's instructions and rectifying as specified any parts of the painted, coated or galvanized surface that may be damaged either before or after erection.
- 53. The rates for fixing penstocks and flap valves etc. shall include for bedding and grouting, testing for water tightness, greasing all working parts and leaving in good working order; where the item includes supply, the rates shall also include for supplying drawings for approval before manufacture is commenced.

# 54. Concrete Works

a) Item: Concrete

Unit:  $m^3$  of each class

Concrete shall be measured by the cubic metre of each class calculated from the dimensions given on the drawings or as instructed by the Engineer.

No deduction shall be made in the measurement for:

- i) bolt holes, pockets, box outs and cast-in components provided that the volume of each is less than 0.15 cubic metres;
- ii) mortar beds, fillets, drip moulds, rebates, recesses, grooves, chamfers and the like of 100 mm total width or less;
- iii) reinforcement.

The rates for concrete shall include for the cost of:

- i) provision and transport of cement, aggregate and water;
- ii) admixtures and workability agents including submission of details unless otherwise specified;
- iii) batching, mixing, transporting, placing, compacting and curing;
- iv) class UF1 finish;
- v) laying to sloping surfaces not exceeding 15 degrees from the horizontal and laying to falls;
- vi) formwork to blinding concrete;
- vii) placing and compacting against excavated surfaces where required including any additional concrete to fill overbreak or working space;
- viii) complying with all the requirements of the Specifications.
- b) Item: <u>Blinding Concrete</u>

Unit: m<sup>3</sup>

Blinding concrete shall be measured by the cubic metre calculated as the product of the plan area of the foundation as shown on the drawings and the instructed thickness. No deduction shall be made for openings provided that the area of each is less than 0.5 square metres. Blinding concrete over hard material shall be measured as the volume used provided that the maximum thickness of 150 mm allowed for overbreak is not exceeded.

The rate for blinding concrete shall include for all costs itemised in Note 37(a) of this Preamble.

c) Item: No Fines Concrete

Unit:  $m^3$ 

No fines concrete shall be measured by the cubic metre calculated from the dimensions given on the drawings or as instructed by the Engineer.

The rate for no fines concrete shall include for all costs stated in Note 37(a) of this Preamble.

d) Item: <u>Unformed Surface Finishes</u>

Unit: m<sup>2</sup> of each class of finish

Unformed surface finishes shall be measured by the square metre from the dimensions given on the drawings or as instructed by the Engineer.

The rate for concrete in Notes 35(a), (b) and (c) shall include for class UF1 finish.

The rate for unformed surface finishes shall include for the cost of complying with Clause 410 of the Specification.

e) Item: Formwork for Formed Surface Finishes

Unit: m<sup>2</sup> of formwork for each class of finish for each range of inclinations

Except as stated below, formwork shall be measured by the square metre of formwork actually in contact with the finished face of the concrete. No deduction shall be made in the measurement for openings, pipes, ducts and the like, provided that the area of each is less than 0.50 square metres. Unless otherwise stated, if the volume or area of concrete has not been deducted when measuring the concrete in accordance with Notes 37(a), (b) and (c), formwork to form or box out the void shall not be measured.

Formwork less than 300 mm high to edges of slabs shall be measured by the linear metre in accordance

with Note 37(f) of this Preamble.

Inclined formwork shall be measured in accordance with the following classifications:

i) Horizontal: 85 to 90 degrees inclination from vertical

ii) Sloping: 10 to 85 degrees inclination from vertical

iii) Battered: 0 to 10 degrees inclination from vertical

iv) Vertical: 0 degrees

v) Sloping upper surfaces inclined at more than 15 degrees from the horizontal

Formwork required for blinding concrete, to form construction joints and shear keys for future concrete and other construction surfaces shall not be measured and the costs shall be included in the rates for other work.

Formwork to contraction and expansion joints shall be measured by the square metre on one face only. The rates shall include for the costs stated below and for forming recesses for sealant and channels for grout.

The rates for formwork shall include for the cost of submission of details, providing and transporting all materials for formwork and falsework, erection including provision of supports, fillets and chamfers 75 mm and less in width, bolts, ties, fixings, cutting to waste, drilling or notching the formwork for reinforcement where required, working around pipes, ducts, conduits and waterstops, temporary openings, cleaning, dressing, stripping, filling bolt holes and any remedial work and for complying with all the requirements of the Specifications.

f) Item: Formwork to Edges of Slabs

Unit: m of each class of finish

Formwork less than 300mm high to edges of slabs shall be measured by the linear metre.

The rate shall include for the costs stated in Note 37 (e) of this Preamble.

g) Item: <u>Waterstops</u>

Unit: m of each type

Waterstops shall be measured by the metre run of each type.

The rate for water stops shall include for the provision, installation, jointing, any sealants required at the face of the concrete and for placing and compacting concrete around the waterstop.

h) Item : <u>Mortar</u>

Unit: m<sup>2</sup>

Mortar used for bedding base plates and the like shall be measured by square metre as the area of the base plate at the specified nominal thickness of bedding.

Mortar used in filling bolts pockets and the like shall not be measured separately and the costs shall be included in the rates for the bolts.

The rates for mortar shall include for the cost of providing and placing the mortar and of complying with all the requirements of the Specifications.

i) Item : Admixture Workability and Hardening Agents

Unit : As specified in the Special Specification

Where required by the Special Specification admixtures, workability and hardening agents shall be measured and paid for in accordance with the Special Specification.

j) Item: Reinforcement

Unit : Tonne of each type for each range of diameters

Reinforcement shall be measured separately for each of the following ranges:

i) of diameter equal to or less than 16mm

ii) of diameter greater than 16mm

Steel fabric reinforcement shall be measured in accordance with Note 37(k) of this Preamble.

Steel (plain and deformed bars) reinforcement shall be measured by the tonne and shall be the calculated weight of the steel required including splice lengths shown on the drawings. No allowance shall be made in the measurement for rolling margins or cutting waste. The density of steel shall be taken as 7850 kilogrammes per cubic metre.

The rates for reinforcement shall include for cost of providing, cutting to length, splice lengths additional to those shown on the drawings, laps, bending, hooking, waste incurred by cutting, cleaning, spacer blocks, provision and fixing of chairs or other types of supports, welding, fixing the reinforcement in position including the provision of wire or other material for supporting and tying the reinforcement in place, being reinforcement aside temporarily and straightening, placing and compacting concrete around reinforcement and for complying with all the requirements of the Specifications.

k) Item: Fabric Reinforcement

Unit:  $m^2$  of each type

Steel fabric reinforcement shall be measured by the square metre and shall be the calculated area excluding any allowance for laps.

The rate for steel fabric reinforcement shall include for the costs stated in Note 37(j) of this Preamble.

# Sewers, Drains and Pipelines

- 55. The rates for pipes, pipework and specials shall include for supply of all materials, setting of concrete blocks and hardwood wedges where specified, providing any temporary support that may be necessary, preparing ends of pipes for jointing and all labour in jointing, protection to detachable joints, cleaning pipelines and rectifying as specified any damage to surface coating. The rates shall also include for all cutting of pipes consequent upon structures, specials and fittings being constructed in the designated positions.
- 56. The rates for concrete surround, bed and haunching to pipes, concrete in anchor blocks to pipes, and to gully pots shall include for all formwork required and for any additional concrete the Contractor may place for his own convenience or by reason of the method of carrying out the work.
- 57. <u>Pipes, Fittings and Valves General Specifications are given in applicable International Standards referred to in the following SRNs:</u>
  - a) uPVC pipes and fittings to SRN 300 Class 'E' (16 bar), or as specified
  - b) Steel pipes and fittings to SRN 210, SRN 212 and SRN 216
  - c) Ductile Iron (DI) pipes and fittings to SRN 202
  - d) Galvanized Iron (GI) pipes and fittings to SRN 203
  - e) Flexible joint spigot and socket precast concrete (PVC) pipes to SRN 409

Rigid joint spigot and socket pcc pipes to SRN 409

Ogee joint PCC pipes to SRN 407

- f) All flanges to SRN 207, NP 16 or as specified
- g) Gate valves to SRN 501, NP 16 or as specified
- h) Double orifice air valves as specified
  - Single large orifice air valves as specified
  - Single small orifice air valves as specified
- i) Fire hydrants to SRN 509
- j) Butterfly valves to SRN 506, NP 16 as specified
- k) Ball float valves as specified
- 1) All pipe, fittings and valve diameters indicated are nominal diameters
- m) Supply of pipes and fittings to include for cost of supply of all jointing materials like bolts, nuts, washers, gaskets, packings, jointing glue, etc.
- n) uPVC pipes to be supplied complete with compression joints
- o) Supply of C/L steel pipes to be with flange or push-in joints. If plain ended pipes are offered, one number coupling per length is to be included. Coupling is subject to approval by Project Manager
- p) Ductile Iron pipes to be with push-in type joints
- q) Galvanized Iron pipes to be with threaded coupling joints, or as specified
- r) Precast concrete ogee pipes to be complete with all jointing materials

### **Shop Drawings**

58. Detailed shop drawings, in triplicate, to be provided for all items where ferrous pipework, fittings and any metalwork i.e. penstocks, ladders etc., are indicated to be installed as outlined in the bills of quantities and drawings. These drawings to be submitted well in advance of ordering of the above materials and the billed rates are deemed to include for provision of these drawings, samples where requested, and inspection where fabricated by the Engineer or his Representative.

### Prime Cost Items

- 59. Attendance on nominated Sub-Contractors shall include for all or any of the following as appropriate labour, materials and plant required for taking delivery, carting, storing, hoisting and builder's work entailed in fixing, erecting and installing as specified or in accordance with the manufacturer's instructions and all overheads and profits.
- 60. When, in the opinion of the Engineer, it is reasonable to expect the Contractor to price the attendance item it will be so included in the Bills of Quantities. In all other cases it will form the subject of a Provisional Sum to be expended on a Dayworks basis.
- 61. Profit shall include for establishment charges, profit and any other costs not included in the attendance item.
- 62. The rates for the supply of any mechanical and electrical equipment shall include for the submission of factory test results.
- 63. <u>Definitions of Terms used in Bill of Quantities</u>
  - a) 'Provide' shall mean all costs to cover purchase of materials in good condition, services for transaction

with the supplier, supervision, transport to site of works all charges for rental, consumptions, overheads and profits throughout the Contract. It shall also include for all maintenance, insurance and handling and storage whenever applicable.

- b) **'Excavate for'** shall mean handling of any material from its incumbent position intended for specified work shown in the drawings or directed by the Project Manager and backfilling and compacting part of material after laying of pipes or erection of structures, and cart away remaining to tips to be provided by the Contractor. The cost for this work shall include all survey, supervision, labour, tools, machinery, protection of work, pumping, insurances and overheads and profits.
- c) **'Laying'** shall cover all work necessary for placing an object or material to true line and level specified in a drawing or as directed by the Engineer.
- d) 'Jointing' shall mean process of fixing specified material, pipes, fittings and specials together using appropriate tools, material, labour and machinery. It should cover for all work necessary to provide matching of opposite parts in size, shape and position indicated and clamps, seatings and holders to hold firmly.
- e) **'Testing'** shall mean provision of all materials, apparatus, labour, machinery, charges for the media or chemical to be used and their transport, repair of object to be tested if required, re-testing, excavation of any part for visual inspection, erection of any type all until the object has been certified as having passed the required test satisfactorily.
- f) 'Install' shall include for all work requirements stipulated for "laying" and "jointing". It will cover all expenses for the provision of labour, materials, removal from stores, complete erection, installation, supervision, site testing and commissioning as per the Specifications.
- 64. The unit rates for the various items listed in the BOQ shall include, except insofar as it is otherwise provided under the Contract, all labour, construction equipment, materials, erection, maintenance, supervision, insurances etc. set forth or implied in the Contract. These are all deemed to include all allowances for waste or surplus of any kind, which are not subject to measurement.
- 65. The rates to be indicated in the Bills of Quantities shall be inclusive of all applicable Government duties and taxes except Value Added Tax (VAT). The VAT amount shall be added to the Overall Bills Total in the Grand Summary. The Grand Total from the Grand Summary (inclusive of VAT) shall be carried to the Letter of Bid.
  - 66. The Employer's portion (50%) of DAAB's fees and expenses shall be covered by the contingencies.

# Bills of Quantities (Volume II: Bills of Quantities attached)

# PART III - CONDITIONS OF CONTRACT AND CONTRACT FORMS

### SECTION VIII - GENERAL CONDITIONS OF CONTRACT

These General Conditions of Contract (GCC), read in conjunction with the Special Conditions of Contract (SCC) and other documents listed therein, should be a complete document expressing fairly the rights and obligations of both parties.

These General Conditions of Contract have been developed on the basis of considerable international experience in the drafting and management of contracts, bearing in mind a trend in the construction industry towards simpler, more straightforward language.

The GCC can be used for both smaller admeasurement contracts and lump sum contracts.

### **General Conditions of Contract**

### A. General

### 1. Definitions

- 1.1 Bold face type is used to identify defined terms.
  - a) **The Accepted Contract** Amount means the amount accepted in the Letter of Acceptance for the execution and completion of the Works and the remedying of any defects.
  - b) **The Activity Schedule** is a schedule of the activities comprising the construction, installation, testing, and commissioning of the Works in a lump sum contract. It includes a lump sum price for each activity, which is used for valuations and for assessing the effects of Variations and Compensation Events.
  - c) **The Adjudicator** is the person appointed jointly by the Procuring Entity and the Contractor to resolve disputes in the first instance, as provided for in GCC 23.
  - d) **Bill of Quantities** means the priced and completed Bill of Quantities forming part of the Bid.
  - e) **Compensation Events** are those defined in GCC Clause 42 hereunder.
  - f) **The Completion Date** is the date of completion of the Works as certified by the Project Manager, in accordance with GCC Sub-Clause 53.1.
  - g) **The Contract** is the Contract between the Procuring Entity and the Contractor to execute, complete, and maintain the Works. It consists of the documents listed in GCC Sub-Clause 2.3 below.
  - h) **The Contractor** is the party whose Bid to carry out the Works has been accepted by the Procuring Entity.
  - i) **The Contractor's Bid** is the completed bidding document submitted by the Contractor to the Procuring Entity.
  - j) **The Contract Price** is the Accepted Contract Amount stated in the Letter of Acceptance and thereafter as adjusted in accordance with the Contract.
  - k) **Days** are calendar days; months are calendar months.
  - 1) **Day work**s are varied work inputs subject to payment on a time basis for the Contractor's employees and Equipment, in addition to payments for associated Materials and Plant.
  - m) **ADefect** is any part of the Works not completed in accordance with the Contract.
  - n) **The Defects** Liability Certificate is the certificate issued by Project Manager upon correction of defects by the Contractor.
  - o) **The Defects Liability Period** is the period **named in the SCC** pursuant to Sub-Clause 34.1 and calculated from the Completion Date.
  - p) **Drawings** means the drawings of the Works, as included in the Contract, and any additional and modified drawings issued by (or on behalf of) the Procuring Entity in accordance with the Contract, include calculations and other information provided or approved by the Project Manager for the execution of the Contract.
  - q) **The Procuring Entity** is the party who employs the Contractor to carry out the Works, **as specified in the SCC**, who is also the Procuring Entity.
  - r) **Equipment** is the Contractor's machinery and vehicles brought temporarily to the Site to construct the Works.
  - s) "In writing" or "written" means hand-written, type-written, printed or electronically made, and

- resulting in a permanent record;
- t) The Initial Contract Price is the Contract Price listed in the Procuring Entity's Letter of Acceptance.
- u) **The Intended Completion Date** is the date on which it is intended that the Contractor shall complete the Works. The Intended Completion Date is **specified in the SCC**. The Intended Completion Date may be revised only by the Project Manager by issuing an extension of time or an acceleration order.
- v) **Materials** are all supplies, including consumables, used by the Contractor for incorporation in the Works.
- w) **Plant i**s any integral part of the Works that shall have a mechanical, electrical, chemical, or biological function.
- x) **The Project Manager** is the person **named in the SCC** (or any other competent person appointed by the Procuring Entity and notified to the Contractor, to act in replacement of the Project Manager) who is responsible for supervising the execution of the Works and administering the Contract.
- y) SCC means Special Conditions of Contract.
- z) The Site is the area of the works as defined as such in the SCC.
- aa) **Site Investigation Reports** are those that were included in the bidding document and are factual and interpretative reports about the surface and subsurface conditions at the Site.
- bb) **Specification** means the Specification of the Works included in the Contract and any modification or addition made or approved by the Project Manager.
- cc) **The Start Date** is **given in the SCC**. It is the latest date when the Contractor shall commence execution of the Works. It does not necessarily coincide with any of the Site Possession Dates.
- dd) **A Subcontractor** is a person or corporate body who has a Contract with the Contractor to carry out a part of the work in the Contract, which includes work on the Site.
- ee) **Temporary Works** are works designed, constructed, installed, and removed by the Contractor that are needed for construction or installation of the Works.
- ff) **A Variation** is an instruction given by the Project Manager which varies the Works.
- gg) **The Works** are what the Contract requires the Contractor to construct, install, and turn over to the Procuring Entity, **as defined in the SCC**.

### 2. Interpretation

- 21 In interpreting these GCC, words indicating one gender include all genders. Words indicating the singular also include the plural and words indicating the plural also include the singular. Headings have no significance. Words have their normal meaning under the language of the Contract unless specifically defined. The Project Manager shall provide instructions clarifying queries about these GCC.
- 22 If sectional completion is specified in the SCC, references in the GCC to the Works, the Completion Date, and the Intended Completion Date apply to any Section of the Works (other than references to the Completion Date and Intended Completion Date for the whole of the Works).
- 23 The documents forming the Contract shall be interpreted in the following order of priority:
  - a) Agreement,
  - b) Letter of Acceptance,
  - c) Contractor's Bid,
  - d) Special Conditions of Contract,
  - e) General Conditions of Contract, including Appendices,
  - f) Specifications,
  - g) Drawings,
  - h) Bill of Quantities<sup>6</sup>, and
  - i) any other document **listed in the SCC** as forming part of the Contract.

 $<sup>^6</sup>$ In lump sum contracts, delete "Bill of Quantities" and replace with "Activity Schedule."

### 3. Language and Law

- 3.1 The language of the Contract is English Language and the law governing the Contract are the Laws of Kenya.
- 32 Throughout the execution of the Contract, the Contractor shall comply with the import of goods and services prohibitions in the Procuring Entity's Country when
- a) as a matter of law or official regulations, Kenya prohibits commercial relations with that country; or
- b) by an act of compliance with a decision of the United Nations Security Council taken under Chapter VII of the Charter of the United Nations, Kenya prohibits any import of goods from that country or any payments to any country, person, or entity in that country.

### 4. Project Manager's Decisions

4.1 Except where otherwise specifically stated, the Project Manager shall decide contractual matters between the Procuring Entity and the Contractor in the role representing the Procuring Entity.

### 5. Delegation

5.1 Otherwise **specified in the SCC**, the Project Manager may delegate any of his duties and responsibilities to other people, except to the Adjudicator, after notifying the Contractor, and may revoke any delegation after notifying the Contractor.

### 6. Communications

61 Communications between parties that are referred to in the Conditions shall be effective only when in writing. A notice shall be effective only when it is delivered.

### 7. Subcontracting

7.1 The Contractor may subcontract with the approval of the Project Manager, but may not assign the Contract without the approval of the Procuring Entity in writing. Subcontracting shall not alter the Contractor's obligations.

### 8. Other Contractors

81 The Contractor shall cooperate and share the Site with other contractors, public authorities, utilities, and the Procuring Entity between the dates given in the Schedule of Other Contractors, as **referred to in the SCC.** The Contractor shall also provide facilities and services for them as described in the Schedule. The Procuring Entity may modify the Schedule of Other Contractors, and shall notify the Contractor of any such modification.

### 9. Personnel and Equipment

- 9.1 The Contractor shall employ the key personnel and use the equipment identified in its Bid, to carry out the Works or other personnel and equipment approved by the Project Manager. The Project Manager shall approve any proposed replacement of key personnel and equipment only if their relevant qualifications or characteristics are substantially equal to or better than those proposed in the Bid.
- 92 If the Project Manager asks the Contractor to remove a person who is a member of the Contractor's staff or work force, stating the reasons, the Contractor shall ensure that the person leaves the Site within seven days and has no further connection with the work in the Contract.
- 93 If the Procuring Entity, Project Manager or Contractor determines, that any employee of the Contractor be determined to have engaged in Fraud and Corruption during the execution of the Works, then that employee shall be removed in accordance with Clause 9.2 above.

### 10. Procuring Entity's and Contractor's Risks

10.1 The Procuring Entity carries the risks which this Contract states are Procuring Entity's risks, and the Contractor carries the risks which this Contract states are Contractor's risks.

### 11. Procuring Entity's Risks

- 11.1 From the Start Date until the Defects Liability Certificate has been issued, the following are Procuring Entity's risks:
  - a) The risk of personal injury, death, or loss of or damage to property (excluding the Works, Plant, Materials, and Equipment), which are due to
    - i) use or occupation of the Site by the Works or for the purpose of the Works, which is the unavoidable result of the Works or
    - ii) negligence, breach of statutory duty, or interference with any legal right by the Procuring Entity or by any person employed by or contracted to him except the Contractor.
  - b) The risk of damage to the Works, Plant, Materials, and Equipment to the extent that it is due to a fault of the Procuring Entity or in the Procuring Entity's design, or due to war or radioactive contamination directly affecting the country where the Works are to be executed.
- 112 From the Completion Date until the Defects Liability Certificate has been issued, the risk of loss of or damage to the Works, Plant, and Materials is a Procuring Entity's risk except loss or damage due to
  - aa) a Defect which existed on the Completion Date,
  - bb) an event occurring before the Completion Date, which was not itself a Procuring Entity's risk, or
  - cc) the activities of the Contractor on the Site after the Completion Date.

### 12. Contractor's Risks

121 From the Starting Date until the Defects Liability Certificate has been issued, the risks of personal injury, death, and loss of or damage to property (including, without limitation, the Works, Plant, Materials, and Equipment) which are not Procuring Entity's risks are Contractor's risks.

### 13. Insurance

- 13.1 The Contractor shall provide, in the joint names of the Procuring Entity and the Contractor, insurance cover from the Start Date to the end of the Defects Liability Period, in the amounts and deductibles **stated in the SCC** for the following events which are due to the Contractor's risks:
  - a) loss of or damage to the Works, Plant, and Materials;
  - b) loss of or damage to Equipment;
  - c) loss of or damage to property (except the Works, Plant, Materials, and Equipment) in connection with the Contract; and
  - d) personal injury or death.
- 132 Policies and certificates for insurance shall be delivered by the Contractor to the Project Manager for the Project Manager's approval before the Start Date. All such insurance shall provide for compensation to be payable in the types and proportions of currencies required to rectify the loss or damage incurred.
- 133 If the Contractor does not provide any of the policies and certificates required, the Procuring Entity may effect the insurance which the Contractor should have provided and recover the premiums the Procuring Entity has paid from payments otherwise due to the Contractor or, if no payment is due, the payment of the premiums shall be a debt due.
- 134 Alterations to the terms of an insurance shall not be made without the approval of the Project Manager.
- 135 Both parties shall comply with any conditions of the insurance policies.

### 14. Site Data

14.1 The Contractor shall be deemed to have examined any Site Data **referred to in the SCC**, supplemented by any information available to the Contractor.

### 15. Contractor to Construct the Works

15.1 The Contractor shall construct and install the Works in accordance with the Specifications and Drawings.

### 16. The Works to Be Completed by the Intended Completion Date

161 The Contractor may commence execution of the Works on the Start Date and shall carry out the Works in accordance with the Program submitted by the Contractor, as updated with the approval of the Project Manager, and complete them by the Intended Completion Date.

### 17. Approval by the Project Manager

- 17.1 The Contractor shall submit Specifications and Drawings showing the proposed Temporary Works to the Project Manager, for his approval.
- 172 The Contractor shall be responsible for design of Temporary Works.
- 173 The Project Manager's approval shall not alter the Contractor's responsibility for design of the Temporary Works.
- 174 The Contractor shall obtain approval of third parties to the design of the Temporary Works, where required.
- 175 All Drawings prepared by the Contractor for the execution of the temporary or permanent Works, are subject to prior approval by the Project Manager before this use.

### 18. Safety

18.1 The Contractor shall be responsible for the safety of all activities on the Site.

### 19. Discoveries

19.1 Anything of historical or other interest or of significant value unexpectedly discovered on the Site shall be the property of the Procuring Entity. The Contractor shall notify the Project Manager of such discoveries and carry out the Project Manager's instructions for dealing with them.

### 20. Possession of the Site

20.1 The Procuring Entity shall give possession of all parts of the Site to the Contractor. If possession of a part is not given by the date **stated in the SCC**, the Procuring Entity shall be deemed to have delayed the start of the relevant activities, and this shall be a Compensation Event.

### 21. Access to the Site

21.1 The Contractor shall allow the Project Manager and any person authorized by the Project Manager access to the Site and to any place where work in connection with the Contract is being carried out or is intended to be carried out.

### 22. Instructions, Inspections and Audits

- 22.1 The Contractor shall carry out all instructions of the Project Manager which comply with the applicable laws where the Site is located.
- 222 The Contractor shall keep, and shall make all reasonable efforts to cause its Subcontractors and subconsultants to keep, accurate and systematic accounts and records in respect of the Works in such form and details as will clearly identify relevant time changes and costs.
- 223 The Contractor shall permit and shall cause its subcontractors and sub-consultants to permit, the Procuring Entity and/or persons appointed by the Public Procurement Regulatory Authority to inspect the Site and/or the accounts and records relating to the procurement process, selection and/or contract execution, and to have such accounts and records audited by auditors appointed by the Public Procurement Regulatory Authority. The Contractor's and its Subcontractors' and sub-consultants' attention is drawn to Sub-Clause 25.1 (Fraud and Corruption) which provides, inter alia, that acts intended to materially impede the exercise of the Public Procurement Regulatory Authority's inspection and audit rights constitute a prohibited practice subject to contract termination (as well as to a determination of ineligibility pursuant to the Public Procurement Regulatory Authority's prevailing sanctions procedures).

### 23. Appointment of the Adjudicator

- 23.1 The Adjudicator shall be appointed jointly by the Procuring Entity and the Contractor, at the time of the Procuring Entity's issuance of the Letter of Acceptance. If, in the Letter of Acceptance, the Procuring Entity does not agree on the appointment of the Adjudicator, the Procuring Entity will request the Appointing Authority designated in the SCC, to appoint the Adjudicator within 14 days of receipt of such request.
- 232 Should the Adjudicator resign or die, or should the Procuring Entity and the Contractor agree that the Adjudicator is not functioning in accordance with the provisions of the Contract, a new Adjudicator shall be jointly appointed by the Procuring Entity and the Contractor. In case of disagreement between the Procuring Entity and the Contractor, within 30 days, the Adjudicator shall be designated by the Appointing Authority designated in the SCC at the request of either party, within 14 days of receipt of such request.

### 24. Settlement of Claims and Disputes

### **241** Contractor's Claims

- 24.1.1 If the Contractor considers itself to be entitled to any extension of the Time for Completion and/or any additional payment, under any Clause of these Conditions or otherwise in connection with the Contract, the Contractor shall give Notice to the Project Manager, describing the event or circumstance giving rise to the claim. The notice shall be given as soon as practicable, and not later than 30 days after the Contractor became aware, or should have become aware, of the event or circumstance.
- 24.1.2 If the Contractor fails to give notice of a claim within such period of 30 days, the Time for Completion shall not be extended, the Contractor shall not be entitled to additional payment, and the Procuring Entity shall be discharged from all liability in connection with the claim. Otherwise, the following provisions of this Sub- Clause shall apply.
- 24.1.3 The Contractor shall also submit any other notices which are required by the Contract, and supporting particulars for the claim, all as relevant to such event or circumstance.
- 24.1.4 The Contractor shall keep such contemporary records as may be necessary to substantiate any claim, either on the Site or at another location acceptable to the Project Manager. Without admitting the Procuring Entity's liability, the Project Manager may, after receiving any notice under this Sub-Clause, monitor the record- keeping and/or instruct the Contractor to keep further contemporary records. The Contractor shall permit the Project Manager to inspect all these records, and shall (if instructed) submit copies to the Project Manager.
- 24.1.5 Within 42 days after the Contractor became aware (or should have become aware) of the event or circumstance giving rise to the claim, or within such other period as may be proposed by the Contractor and approved by the Project Manager, the Contractor shall send to the Project Manager a fully detailed claim which includes full supporting particulars of the basis of the claim and of the extension of time and/or additional payment claimed. If the event or circumstance giving rise to the claim has a continuing effect:
  - a) this fully detailed claim shall be considered as interim;
  - b) the Contractor shall send further interim claims at monthly intervals, giving the accumulated delay and/or amount claimed, and such further particulars as the Project Manager may reasonably require; and
  - c) the Contractor shall send a final claim within 30 days after the end of the effects resulting from the event or circumstance, or within such other period as may be proposed by the Contractor and approved by the Project Manager.
- 24.1.6 Within 42 days after receiving a Notice of a claim or any further particulars supporting a previous claim, or within such other period as may be proposed by the Project Manager and approved by the Contractor, the Project Manager shall respond with approval, or with disapproval and detailed comments. He may also request any necessary further particulars, but shall nevertheless give his response on the principles of the claim within the above defined time period.
- 24.1.7 Within the above defined period of 42 days, the Project Manager shall proceed in accordance with Sub-Clause
- 24.1.8 [Determinations] to agree or determine (i) the extension (if any) of the Time for Completion (before or after its expiry) in accordance with Sub-Clause 8.4 [Extension of Time for Completion], and/or (ii) the

additional payment (if any) to which the Contractor is entitled under the Contract.

- 24.1.9 Each Payment Certificate shall include such additional payment for any claim as has been reasonably substantiated as due under the relevant provision of the Contract. Unless and until the particulars supplied are sufficient to substantiate the whole of the claim, the Contractor shall only be entitled to payment for such part of the claim as he has been able to substantiate.
- 24.1.10 If the Project Manager does not respond within the timeframe defined in this Clause, either Party may consider that the claim is rejected by the Project Manager and any of the Parties may refer to Arbitration in accordance with Sub-Clause 24.4 [Arbitration].
- 24.1.11 The requirements of this Sub-Clause are in addition to those of any other Sub-Clause which may apply to a claim. If the Contractor fails to comply with this or another Sub-Clause in relation to any claim, any extension of time and/or additional payment shall take account of the extent (if any) to which the failure has prevented or prejudiced proper investigation of the claim, unless the claim is excluded under the second paragraph of this Sub-Clause 24.3.

### 242 Amicable Settlement

24.2.1 Where a notice of a claim has been given, both Parties shall attempt to settle the dispute amicably before the commencement of arbitration. However, unless both Parties agree otherwise, the Party giving a notice of a claim in accordance with Sub-Clause 24.1 above should move to commence arbitration after the fifty-sixth day from the day on which a notice of a claim was given, even if no attempt at an amicable settlement has been made.

### 243 Matters that may be referred to arbitration

- 24.3.1 Notwithstanding anything stated herein the following matters may be referred to arbitration before the practical completion of the Works or abandonment of the Works or termination of the Contract by either party:
  - a) The appointment of a replacement Project Manager upon the said person ceasing to act.
  - b) Whether or not the issue of an instruction by the Project Manager is empowered by these Conditions.
  - c) Whether or not a certificate has been improperly withheld or is not in accordance with these Conditions.
  - e) Any dispute arising in respect of war risks or war damage.
  - f) All other matters shall only be referred to arbitration after the completion or alleged completion of the Works or termination or alleged termination of the Contract, unless the Procuring Entity and the Contractor agree otherwise in writing.

### 244 Arbitration

- 24.4.1 Any claim or dispute between the Parties arising out of or in connection with the Contract not settled amicably in accordance with Sub-Clause 24.3 shall be finally settled by arbitration.
- 24.4.2 No arbitration proceedings shall be commenced on any claim or dispute where notice of a claim or dispute has not been given by the applying party within ninety days of the occurrence or discovery of the matter or issue giving rise to the dispute.
- 24.4.3 Notwithstanding the issue of a notice as stated above, the arbitration of such a claim or dispute shall not commence unless an attempt has in the first instance been made by the parties to settle such claim or dispute amicably with or without the assistance of third parties. Proof of such attempt shall be required.
- 24.4.4 The Arbitrator shall, without prejudice to the generality of his powers, have powers to direct such measurements, computations, tests or valuations as may in his opinion be desirable in order to determine the rights of the parties and assess and award any sums which ought to have been the subject of or included in any certificate.
- 24.4.5 The Arbitrator shall, without prejudice to the generality of his powers, have powers to open up, review and revise any certificate, opinion, decision, requirement or notice and to determine all matters in dispute which shall be submitted to him in the same manner as if no such certificate, opinion, decision requirement or notice had been given.
- 24.4.6 The arbitrators shall have full power to open up, review and revise any certificate, determination, instruction, opinion or valuation of the Project Manager, relevant to the dispute. Nothing shall disqualify representatives of the Parties and the Project Manager from being called as a witness and giving evidence before the arbitrators on any matter whatsoever relevant to the dispute.
- 24.4.7 Neither Party shall be limited in the proceedings before the arbitrators to the evidence, or to the reasons for dissatisfaction given in its Notice of Dissatisfaction.
- 24.4.8 Arbitration may be commenced prior to or after completion of the Works. The obligations of the Parties, and the Project Manager shall not be altered by reason of any arbitration being conducted during the progress of the Works.
- 24.4.9 The terms of the remuneration of each or all the members of Arbitration shall be mutually agreed upon by the

Parties when agreeing the terms of appointment. Each Party shall be responsible for paying one-half of this remuneration.

### 245 Arbitration with National Contractors

- 24.5.1 If the Contract is with national contractors, arbitration proceedings will be conducted in accordance with the Arbitration Laws of Kenya. In case of any claim or dispute, such claim or dispute shall be notified in writing by either party to the other with a request to submit it to arbitration and to concur in the appointment of an Arbitrator within thirty days of the notice. The dispute shall be referred to the arbitration and final decision of a person to be agreed between the parties. Failing agreement to concur in the appointment of an Arbitrator, the Arbitrator shall be appointed, on the request of the applying party, by the Chairman or Vice Chairman of any of the following professional institutions;
  - i) Architectural Association of Kenya
  - ii) Institute of Quantity Surveyors of Kenya
  - iii) Association of Consulting Engineers of Kenya
  - iv) Chartered Institute of Arbitrators (Kenya Branch)
  - v) Institution of Engineers of Kenya
- 24.5.2 The institution written to first by the aggrieved party shall take precedence over all other institutions.

### 246 Alternative Arbitration Proceedings

24.6.1 Alternatively, the Parties may refer the matter to the Nairobi Centre for International Arbitration (NCIA) which offers a neutral venue for the conduct of national and international arbitration with commitment to providing institutional support to the arbitral process.

### 247 Failure to Comply with Arbitrator's Decision

- 24.7.1 The award of such Arbitrator shall be final and binding upon the parties.
- 24.7.2 In the event that a Party fails to comply with a final and binding Arbitrator's decision, then the other Party may, without prejudice to any other rights it may have, refer the matter to a competent court of law.

### 248 Contract operations to continue

- 24.8.1 Notwithstanding any reference to arbitration herein,
  - a) the parties shall continue to perform their respective obligations under the Contract unless they otherwise agree; and
  - b) the Procuring Entity shall pay the Contractor any monies due the Contractor.

### 25. Fraud and Corruption

- 25.1 The Government requires compliance with the country's Anti-Corruption laws and its prevailing sanctions policies and procedures as set forth in the Constitution of Kenya and its Statutes.
- 252 The Procuring Entity requires the Contractor to disclose any commissions or fees that may have been paid or are to be paid to agents or any other party with respect to the bidding process or execution of the Contract. The information disclosed must include at least the name and address of the agent or other party, the amount and currency, and the purpose of the commission, gratuity or fee.

### **B.** Time Control

### 26. Program

- 26.1 Within the time stated in the SCC, after the date of the Letter of Acceptance, the Contractor shall submit to the Project Manager for approval a Program showing the general methods, arrangements, order, and timing for all the activities in the Works. In the case of a lump sum contract, the activities in the Program shall be consistent with those in the Activity Schedule.
- 262 An update of the Program shall be a program showing the actual progress achieved on each activity and the effect of the progress achieved on the timing of the remaining work, including any changes to the sequence of the activities.
- 263 The Contractor shall submit to the Project Manager for approval an updated Program at intervals no longer than the period stated in the SCC. If the Contractor does not submit an updated Program within this period, the Project Manager may withhold the amount stated in the SCC from the next payment certificate and

continue to withhold this amount until the next payment after the date on which the overdue Program has been submitted. In the case of a lump sum contract, the Contractor shall provide an updated Activity Schedule within 14 days of being instructed to by the Project Manager.

264 The Project Manager's approval of the Program shall not alter the Contractor's obligations. The Contractor may revise the Program and submit it to the Project Manager again at any time. A revised Program shall show the effect of Variations and Compensation Events.

### 27. Extension of the Intended Completion Date

- 27.1 The Project Manager shall extend the Intended Completion Date if a Compensation Event occurs or a Variation is issued which makes it impossible for Completion to be achieved by the Intended Completion Date without the Contractor taking steps to accelerate the remaining work, which would cause the Contractor to incur additional cost.
- 272 The Project Manager shall decide whether and by how much to extend the Intended Completion Date within 21 days of the Contractor asking the Project Manager for a decision upon the effect of a Compensation Event or Variation and submitting full supporting information. If the Contractor has failed to give early warning of a delay or has failed to cooperate in dealing with a delay, the delay by this failure shall not be considered in assessing the new Intended Completion Date.

### 28. Acceleration

- 28.1 When the Procuring Entity wants the Contractor to finish before the Intended Completion Date, the Project Manager shall obtain priced proposals for achieving the necessary acceleration from the Contractor. If the Procuring Entity accepts these proposals, the Intended Completion Date shall be adjusted accordingly and confirmed by both the Procuring Entity and the Contractor.
- 282 If the Contractor's priced proposals for an acceleration are accepted by the Procuring Entity, they are incorporated in the Contract Price and treated as a Variation.

### 29. Delays Ordered by the Project Manager

29.1 The Project Manager may instruct the Contractor to delay the start or progress of any activity within the Works.

### 30. Management Meetings

- 30.1 Either the Project Manager or the Contractor may require the other to attend a management meeting. The business of a management meeting shall be to review the plans for remaining work and to deal with matters raised in accordance with the early warning procedure.
- 302 The Project Manager shall record the business of management meetings and provide copies of the record to those attending the meeting and to the Procuring Entity. The responsibility of the parties for actions to be taken shall be decided by the Project Manager either at the management meeting or after the management meeting and stated in writing to all who attended the meeting.

### 31. Early Warning

- 31.1 The Contractor shall warn the Project Manager at the earliest opportunity of specific likely future events or circumstances that may adversely affect the quality of the work, increase the Contract Price, or delay the execution of the Works. The Project Manager may require the Contractor to provide an estimate of the expected effect of the future event or circumstance on the Contract Price and Completion Date. The estimate shall be provided by the Contractor as soon as reasonably possible.
- 312 The Contractor shall cooperate with the Project Manager in making and considering proposals for how the effect of such an event or circumstance can be avoided or reduced by anyone involved in the work and in carrying out any resulting instruction of the Project Manager.

### C. Quality Control

### 32. Identifying Defects

321 The Project Manager shall check the Contractor's work and notify the Contractor of any Defects that are found. Such checking shall not affect the Contractor's responsibilities. The Project Manager may instruct the Contractor to search for a Defect and to uncover and test any work that the Project Manager considers may have a Defect.

### 33. Tests

33.1 If the Project Manager instructs the Contractor to carry out a test not specified in the Specification to check whether any work has a Defect and the test shows that it does, the Contractor shall pay for the test and any samples. If there is no Defect, the test shall be a Compensation Event.

### 34. Correction of Defects

- 34.1 The Project Manager shall give notice to the Contractor of any Defects before the end of the Defects Liability Period, which begins at Completion, and is defined in the SCC. The Defects Liability Period shall be extended for as long as Defects remain to be corrected.
- 342 Every time notice of a Defect is given, the Contractor shall correct the notified Defect within the length of time specified by the Project Manager's notice.

### 35. Uncorrected Defects

35.1 If the Contractor has not corrected a Defect within the time specified in the Project Manager's notice, the Project Manager shall assess the cost of having the Defect corrected, and the Contractor shall pay this amount.

### **D. Cost Control**

# **36.** Contract Price<sup>7</sup>

361 The Bill of Quantities shall contain priced items for the Works to be performed by the Contractor. The Bill of Quantities is used to calculate the Contract Price. The Contractor will be paid for the quantity of the work accomplished at the rate in the Bill of Quantities for each item.

# 37. Changes in the Contract Price<sup>8</sup>

- 37.1 If the final quantity of the work done differs from the quantity in the Bill of Quantities for the particular item by more than 25 percent, provided the change exceeds 1 percent of the Initial Contract Price, the Project Manager shall adjust the rate to allow for the change. The Project Manager shall not adjust rates from changes in quantities if thereby the Initial Contract Price is exceeded by more than 15 percent, except with the prior approval of the Procuring Entity.
- 372 If requested by the Project Manager, the Contractor shall provide the Project Manager with a detailed cost breakdown of any rate in the Bill of Quantities.

### 38. Variations

- 38.1 All Variations shall be included in updated Programs 9 produced by the Contractor.
- 382 The Contractor shall provide the Project Manager with a quotation for carrying out the Variation when requested to do so by the Project Manager. The Project Manager shall assess the quotation, which shall be given within seven (7) days of the request or within any longer period stated by the Project Manager and before the Variation is ordered.
- 383 If the Contractor's quotation is unreasonable, the Project Manager may order the Variation and make a change to the Contract Price, which shall be based on the Project Manager's own forecast of the effects of the Variation on the Contractor's costs.
- 384 If the Project Manager decides that the urgency of varying the work would prevent a quotation being given and considered without delaying the work, no quotation shall be given and the Variation shall be treated as a Compensation Event.

In lump sum contracts, replace GCC Sub-Clauses 36.1 as follows:

<sup>36.1</sup> The Contractor shall provide updated Activity Schedules within 14 days of being instructed to by the Project Manager. The Activity Schedule shall contain the priced activities for the Works to be performed by the Contractor. The Activity Schedule is used to monitor and control the performance of activities on which basis the Contractor will be paid. If payment for materials on site shall be made separately, the Contractor shall show delivery of Materials to the Site separately on the Activity Schedule.

In lump sum contracts, replace entire GCC Clause 37 with new GCC Sub-Clause 37.1, as follows:

The Activity Schedule shall be amended by the Contractor to accommodate changes of Program or method of working made at the Contractor's own discretion. Prices in the Activity Schedule shall not be altered when the Contractor makes such changes to the Activity Schedule.

 $<sup>^9</sup>$ In lump sum contracts, add "and Activity Schedules" after "Programs."  $^{10}$ In lump sum contracts, delete this paragraph.

- 385 The Contractor shall not be entitled to additional payment for costs that could have been avoided by giving early warning
- 386 If the work in the Variation corresponds to an item description in the Bill of Quantities and if, in the opinion of the Project Manager, the quantity of work above the limit stated in Sub-Clause 39.1 or the timing of its execution do not cause the cost per unit of quantity to change, the rate in the Bill of Quantities shall be used to calculate the value of the Variation. If the cost per unit of quantity changes, or if the nature or timing of the work in the Variation does not correspond with items in the Bill of Quantities, the quotation by the Contractor shall be in the form of new rates for the relevant items of work
- 387 Value Engineering: The Contractor may prepare, at its own cost, a value engineering proposal at any time during the performance of the contract. The value engineering proposal shall, at a minimum, include the following;
  - a) the proposed change(s), and a description of the difference to the existing contract requirements;
  - b) a full cost/benefit analysis of the proposed change(s) including a description and estimate of costs (including life cycle costs) the Procuring Entity may incur in implementing the value engineering proposal; and
  - c) a description of any effect(s) of the change on performance/functionality.

388 The Procuring Entity may accept the value engineering proposal if the proposal demonstrates benefits that:

- a) accelerate the contract completion period; or
- b) reduce the Contract Price or the life cycle costs to the Procuring Entity; or
- c) improve the quality, efficiency, safety or sustainability of the Facilities; or
- d) yield any other benefits to the Procuring Entity, without compromising the functionality of the Works.

389 If the value engineering proposal is approved by the Procuring Entity and results in:

- a) a reduction of the Contract Price; the amount to be paid to the Contractor shall be the **percentage specified** in the SCC of the reduction in the Contract Price; or
- b) an increase in the Contract Price; but results in a reduction in life cycle costs due to any benefit described in (a) to (d) above, the amount to be paid to the Contractor shall be the full increase in the Contract Price.

### 39. Cash FlowForecasts

39.1 When the Program<sup>11</sup>, is updated, the Contractor shall provide the Project Manager with an updated cash flow forecast. The cash flow forecast shall include different currencies, as defined in the Contract, converted as necessary using the Contract exchange rates.

### 40. Payment Certificates

- 40.1 The Contractor shall submit to the Project Manager monthly statements of the estimated value of the work executed less the cumulative amount certified previously.
- 402 The Project Manager shall check the Contractor's monthly statement and certify the amount to be paid to the Contractor.
- 403 The value of work executed shall be determined by the Project Manager.
- 404 The value of work executed shall comprise the value of the quantities of work in the Bill of Quantities that have been completed 12.
- 405 The value of work executed shall include the valuation of Variations and Compensation Events.
- 406 The Project Manager may exclude any item certified in a previous certificate or reduce the proportion of any item previously certified in any certificate in the light of later information.
- 407 Where the contract price is different from the corrected tender price, in order to ensure the contractor is not paid less or more relative to the contract price (which would be the tender price), payment valuation certificates and variation orders on omissions and additions valued based on rates in the Bill of Quantities or schedule of rates in the Tender, will be adjusted by a plus or minus percentage. The percentage already worked out during tender evaluation is worked out as follows: (corrected tender price tender price)/tender price X 100.

### 41. Payments

- 41.1 Payments shall be adjusted for deductions for advance payments and retention. The Procuring Entity shall pay the Contractor the amounts certified by the Project Manager within 30 days of the date of each certificate. If the Procuring Entity makes a late payment, the Contractor shall be paid interest on the late payment in the next payment. Interest shall be calculated from the date by which the payment should have been made up to the date when the late payment is made at the prevailing rate of interest for commercial borrowing for each of the currencies in which payments are made.
- 412 If an amount certified is increased in a later certificate or as a result of an award by the Adjudicator or an Arbitrator, the Contractor shall be paid interest upon the delayed payment as set out in this clause. Interest shall be calculated from the date upon which the increased amount would have been certified in the absence of dispute.
- 413 Unless otherwise stated, all payments and deductions shall be paid or charged in the proportions of currencies comprising the Contract Price.
- 414 Items of the Works for which no rate or price has been entered in shall not be paid for by the Procuring Entity and shall be deemed covered by other rates and prices in the Contract.

### 42. Compensation Events

- 42.1 The following shall be Compensation Events:
  - d) The Procuring Entity does not give access to a part of the Site by the Site Possession Date pursuant to GCC Sub-Clause 20.1.
  - e) The Procuring Entity modifies the Schedule of Other Contractors in a way that affects the work of the Contractor under the Contract.
  - f) The Project Manager orders a delay or does not issue Drawings, Specifications, or instructions required for execution of the Works on time.
  - g) The Project Manager instructs the Contractor to uncover or to carry out additional tests upon work, which is then found to have no Defects.
  - h) The Project Manager unreasonably does not approve a subcontract to be let.
  - i) Ground conditions are substantially more adverse than could reasonably have been assumed before issuance of the Letter of Acceptance from the information issued to bidders (including the Site Investigation Reports), from information available publicly and from a visual inspection of the Site.
  - j) The Project Manager gives an instruction for dealing with an unforeseen condition, caused by the Procuring Entity, or additional work required for safety or other reasons.
  - k) Other contractors, public authorities, utilities, or the Procuring Entity does not work within the dates and other constraints stated in the Contract, and they cause delay or extra cost to the Contractor.
  - 1) The advance payment is delayed.
  - m) The effects on the Contractor of any of the Procuring Entity's Risks.
  - n) The Project Manager unreasonably delays issuing a Certificate of Completion.
- 422 If a Compensation Event would cause additional cost or would prevent the work being completed before the Intended Completion Date, the Contract Price shall be increased and/or the Intended Completion Date shall be extended. The Project Manager shall decide whether and by how much the Contract Price shall be increased and whether and by how much the Intended Completion Date shall be extended.
- 423 As soon as information demonstrating the effect of each Compensation Event upon the Contractor's forecast cost has been provided by the Contractor, it shall be assessed by the Project Manager, and the Contract Price shall be adjusted accordingly. If the Contractor's forecast is deemed unreasonable, the Project Manager shall adjust the Contract Price based on the Project Manager's own forecast. The Project Manager shall assume that the Contractor shall react competently and promptly to the event.

<sup>11</sup> In lump sum contracts, add "or Activity Schedule" after "Program."

<sup>&</sup>lt;sup>12</sup>In lump sum contracts, replace this paragraph with the following: "The value of work executed shall comprise the value of completed activities in the Activity Schedule."

424 The Contractor shall not be entitled to compensation to the extent that the Procuring Entity's interests are adversely affected by the Contractor's not having given early warning or not having cooperated with the Project Manager.

### 43. Tax

43.1 The Project Manager shall adjust the Contract Price if taxes, duties, and other levies are changed between the date 30 days before the submission of bids for the Contract and the date of the last Completion certificate. The adjustment shall be the change in the amount of tax payable by the Contractor, provided such changes are not already reflected in the Contract Price or are a result of GCC Clause 44.

### 44. Currency y of Payment

44.1 All payments under the contract shall be made in Kenya Shillings

### 45. Price Adjustment

45.1 Prices shall be adjusted for fluctuations in the cost of inputs only if **provided for in the SCC.** If so provided, the amounts certified in each payment certificate, before deducting for Advance Payment, shall be adjusted by applying the respective price adjustment factor to the payment amounts due in each currency. A separate formula of the type specified below applies:

### P = A + B Im/Io

where:

P is the adjustment factor for the portion of

the Contract Price payable.

A and B are coefficients<sup>13</sup> **specified in the SCC**, representing the non-adjustable and adjustable portions, respectively, of the Contract Price payable and Im is the index prevailing at the end of the month being invoiced and IOC is the index prevailing 30 days before Bid opening for inputs payable.

452 If the value of the index is changed after it has been used in a calculation, the calculation shall be corrected and an adjustment made in the next payment certificate. The index value shall be deemed to take account of all changes in cost due to fluctuations in costs.

### 46. Retention

- 461 The Procuring Entity shall retain from each payment due to the Contractor the proportion stated in the SCC until Completion of the whole of the Works.
- 462 Upon the issue of a Certificate of Completion of the Works by the Project Manager, in accordance with GCC 53.1, half the total amount retained shall be repaid to the Contractor and half when the Defects Liability Period has passed and the Project Manager has certified that all Defects notified by the Project Manager to the Contractor before the end of this period have been corrected. The Contractor may substitute retention money with an "on demand" Bank guarantee.

### 47. Liquidated Damages

- 47.1 The Contractor shall pay liquidated damages to the Procuring Entity at the rate per day stated in the SCC for each day that the Completion Date is later than the Intended Completion Date. The total amount of liquidated damages shall not exceed the amount defined in the SCC. The Procuring Entity may deduct liquidated damages from payments due to the Contractor. Payment of liquidated damages shall not affect the Contractor's liabilities.
- 472 If the Intended Completion Date is extended after liquidated damages have been paid, the Project Manager shall correct any overpayment of liquidated damages by the Contractor by adjusting the next payment certificate. The Contractor shall be paid interest on the overpayment, calculated from the date of payment to the date of repayment, at the rates specified in GCC Sub-Clause 41.1.

### 48. Bonus

48.1 The Contractor shall be paid a Bonus calculated at the rate per calendar day **stated in the SCC** for each day (less any days for which the Contractor is paid for acceleration) that the Completion is earlier than the Intended Completion Date. The Project Manager shall certify that the Works are complete, although they may not be due to be complete.

### 49. Advance Payment

- 49.1 The Procuring Entity shall make advance payment to the Contractor of the amounts stated in the SCC by the date stated in the SCC, against provision by the Contractor of an Unconditional Bank Guarantee in a form and by a bank acceptable to the Procuring Entity in amounts and currencies equal to the advance payment. The Guarantee shall remain effective until the advance payment has been repaid, but the amount of the Guarantee shall be progressively reduced by the amounts repaid by the Contractor. Interest shall not be charged on the advance payment.
- 492 The Contractor is to use the advance payment only to pay for Equipment, Plant, Materials, and mobilization expenses required specifically for execution of the Contract. The Contractor shall demonstrate that advance payment has been used in this way by supplying copies of invoices or other documents to the Project Manager.
- 493 The advance payment shall be repaid by deducting proportionate amounts from payments otherwise due to the Contractor, following the schedule of completed percentages of the Works on a payment basis. No account shall be taken of the advance payment or its repayment in assessing valuations of work done, Variations, price adjustments, Compensation Events, Bonuses, or Liquidated Damages.

### **50.** Securities

50.1 The Performance Security shall be provided to the Procuring Entity no later than the date specified in the Letter of Acceptance and shall be issued in an amount **specified in the SCC**, by a bank or surety acceptable to the Procuring Entity, and denominated in the types and proportions of the currencies in which the Contract Price is payable. The Performance Security shall be valid until a date 28 day from the date of issue of the Certificate of Completion in the case of a Bank Guarantee, and until one year from the date of issue of the Completion Certificate in the case of a Performance Bond.

### 51. Dayworks

- 51.1 If applicable, the Dayworks rates in the Contractor's Bid shall be used only when the Project Manager has given written instructions in advance for additional work to be paid for in that way.
- 512 All work to be paid for as Dayworks shall be recorded by the Contractor on forms approved by the Project Manager. Each completed form shall be verified and signed by the Project Manager within two days of the work being done.
- 513 The Contractor shall be paid for Dayworks subject to obtaining signed Dayworks forms.

### 52. Cost of Repairs

521 Loss or damage to the Works or Materials to be incorporated in the Works between the Start Date and the end of the Defects Correction periods shall be remedied by the Contractor at the Contractor's cost if the loss or damage arises from the Contractor's acts or omissions.

### E. Finishing the Contract

### 53. Completion

53.1 The Contractor shall request the Project Manager to issue a Certificate of Completion of the Works, and the Project Manager shall do so upon deciding that the whole of the Works is completed.

## 54. Taking Over

54.1 The Procuring Entity shall take over the Site and the Works within seven days of the Project Manager's issuing a certificate of Completion.

### 55. Final Account

55.1 The Contractor shall supply the Project Manager with a detailed account of the total amount that the Contractor considers payable under the Contract before the end of the Defects Liability Period. The Project Manager shall issue a Defects Liability Certificate and certify any final payment that is due to the Contractor within 56 days of receiving the Contractor's account if it is correct and complete. If it is not, the Project Manager shall issue within 56 days a schedule that states the scope of the corrections or additions that are necessary. If the Final Account is still unsatisfactory after it has been resubmitted, the Project Manager shall decide on the amount payable to the Contractor and issue a payment certificate.

 $<sup>^{13}</sup>$ The sum of the two coefficients A and B should be 1 (one) in the formula for each currency. Normally, both coefficients shall be the same in the formulae for all currencies, since coefficient A, for the non-adjustable portion of the payments, is a very approximate figure (usually 0.15) to take account of fixed cost elements or other non-adjustable components. The sum of the adjustments for each currency are added to the Contract Price.

### 56. Operating and Maintenance Manuals

- 561 If "as built" Drawings and/or operating and maintenance manuals are required, the Contractor shall supply them by the dates stated in the SCC.
- 562 If the Contractor does not supply the Drawings and/or manuals by the dates stated in the SCC pursuant to GCC Sub-Clause 56.1, or they do not receive the Project Manager's approval, the Project Manager shall withhold the amount **stated in the SCC** from payments due to the Contractor.

### 57. Termination

- 57.1 The Procuring Entity or the Contractor may terminate the Contract if the other party causes a fundamental breach of the Contract.
- 572 Fundamental breaches of Contract shall include, but shall not be limited to, the following:
  - a) the Contractor stops work for 30 days when no stoppage of work is shown on the current Program and the stoppage has not been authorized by the Project Manager;
  - b) the Project Manager instructs the Contractor to delay the progress of the Works, and the instruction is not withdrawn within 30 days;
  - c) the Procuring Entity or the Contractor is made bankrupt or goes into liquidation other than for a reconstruction oramalgamation;
  - d) a payment certified by the Project Manager is not paid by the Procuring Entity to the Contractor within 84 days of the date of the Project Manager's certificate;
  - e) the Project Manager gives Notice that failure to correct a particular Defect is a fundamental breach of Contract and the Contractor fails to correct it within a reasonable period of time determined by the Project Manager;
  - f) the Contractor does not maintain a Security, which is required;
  - g) the Contractor has delayed the completion of the Works by the number of days for which the maximum amount of liquidated damages can be paid, as **defined in the SCC**; or
  - h) if the Contractor, in the judgment of the Procuring Entity has engaged in Fraud and Corruption, as defined in paragraph 2.2 a of the Appendix A to the GCC, in competing for or in executing the Contract, then the Procuring Entity may, after giving fourteen (14) days written notice to the Contractor, terminate the Contract and expel him from the Site.
- 573 Notwithstanding the above, the Procuring Entity may terminate the Contract for convenience.
- 574 If the Contract is terminated, the Contractor shall stop work immediately, make the Site safe and secure, and leave the Site as soon as reasonably possible.
- 575 When either party to the Contract gives notice of a breach of Contract to the Project Manager for a cause other than those listed under GCC Sub-Clause 56.2 above, the Project Manager shall decide whether the breach is fundamental or not.

### 58. Payment upon Termination

- 581 If the Contract is terminated because of a fundamental breach of Contract by the Contractor, the Project Manager shall issue a certificate for the value of the work done and Materials ordered less advance payments received up to the date of the issue of the certificate and less the percentage to apply to the value of the work not completed, as specified in the SCC. Additional Liquidated Damages shall not apply. If the total amount due to the Procuring Entity exceeds any payment due to the Contractor, the difference shall be a debt payable to the Procuring Entity.
- 582 If the Contract is terminated for the Procuring Entity's convenience or because of a fundamental breach of Contract by the Procuring Entity, the Project Manager shall issue a certificate for the value of the work done, Materials ordered, the reasonable cost of removal of Equipment, repatriation of the Contractor's personnel employed solely on the Works, and the Contractor's costs of protecting and securing the Works, and less advance payments received up to the date of the certificate.

### 59. Property

59.1 All Materials on the Site, Plant, Equipment, Temporary Works, and Works shall be deemed to be the property of the Procuring Entity if the Contract is terminated because of the Contractor's default.

### **60.** Release from Performance

60.1 If the Contract is frustrated by the outbreak of war or by any other event entirely outside the control of either the Procuring Entity or the Contractor, the Project Manager shall certify that the Contract has been frustrated. The Contractor shall make the Site safe and stop work as quickly as possible after receiving this certificate and shall be paid for all work carried out before receiving it and for any work carried out afterwards to which a commitment wasmade.

# SECTION IX - SPECIAL CONDITIONS OF CONTRACT

Number of GC Clause	Amendments of, and Supplements to, Clauses in the General Conditions of Contract						
	A	. General					
GCC 1.1 (q)	The Procuring Entity is  NORTHERN WATER WORK Maji House, Kismayu Road PO Box 495 – 70100 Garissa, I Tel: +254-46-2103598/3797 E-mail: info@nwwda.go.ke	KS DEVELOPMENT AGENCY Kenya					
GCC 1.1 (u)	The Intended Completion Date for	the whole of the Works shall be After 12 ca	lendar Months				
GCC 1.1 (x)	The Project Manager is The Tech	nical Services Manager NWWDA					
GCC 1.1 (z)	The Site is located at <b>Masalani To</b>	own, Ijara Sub-County of Garissa County					
GCC 1.1 (cc)	The Start Date shall be <b>after signi</b> works	ng of the Contract and issuance of letter to	commence				
GCC 1.1 (gg)	works Construction of 1No 150m Technical Training Centre Rehabilitation of Existing Institutional capacity build Connections Rehabilitation of 3No 150	N 110-160 HDPE Gababa-Masalani Pipeline n3 Sectional Steel Elevated Water Tank- Ijara	a Vocational and				
GCC 2.2	Sectional Completions are: N/A						
GCC 5.1	The Project manager may delegate	any of his duties and responsibilities.					
GCC 8.1	Schedule of other contractors: <i>N/A</i>						
GCC 9.1	Key Personnel GCC 9.1 is replaced with the following: 9.1 Key Personnel are the Contractor's personnel named in this GCC 9.1 of the Special Conditions of Contract. The Contractor shall employ the Key Personnel and use the equipment identified in its Bid, to carry out the Works or other personnel and equipment approved by the Project Manager. The Project Manager shall approve any proposed replacement of Key Personnel and equipment only if their relevant qualifications or characteristics are substantially equal to or better than those proposed in the Bid.						
	No. Position Minimum Qualifications Experience in Similar Works (years)						
	•Degree in Civil or Water Engineering or equivalent or •Higher Diploma in Civil or Water Engineering or equivalent or •Ordinary Diploma in Civil or Water Engineering						

Number of GC Clause	Amendments of, and Supplements to, Clauses in the General Conditions of Contract						
<u>Ge clause</u>	2. Surveyor- One (1 I	Nr) • Diploma in Survey or equivalent	5				
	3. General Foreman (	•Diploma in Civil or Water Engineering and Registration with NCA	5				
	4. Clerk of Works (1	Oiploma in Civil or Water Engineering and Registration with NCA or     Construction Technician Course and Registration with NCA	5				
	5. Power Plant Mecha	Diploma in Mechanical Engineering     (Plant Option) and Registration with     NCA	5				
	6. Artisan/Plumber -	Two (2 Nr) •Certificate in plumbing and Registration with NCA	5				
	7. Carpenter	<ul> <li>Certificate in Carpentry &amp; Joinery and Registration with NCA</li> </ul>	5				
GCC 13.1	The minimum insurance a	amounts and deductibles shall be:					
	contract price; (b) For loss or damage (c) For loss or damage connection with Co (d) For personal injury (i) of the Contract	actor's employees: KES 5 Million	Equipment) in				
(ii) of other people: Kshs5 million: <b>KES 5 Million</b>							
GCC 14.1	Site Data are: The bidder shall rely on the provided contract drawings, data and physical site inspections and investigations by the bidder.						
GCC 20.1	The Site Possession Date(s) shall be: Within 14 days of the Commencement Date						
GCC 23.1 & GCC 23.2	Appointing Authority for  The Kenya Chapter of the Chartered Institute of Arbitrators, P.O Box 50163-00200, Nairobi.						
	Hourly rate and types of reimbursable expenses to be paid to the Adjudicator:  **Kshs. 25,000/-						
B. Time Contro	ol						
GCC 26.1	The Contractor shall subm date of the Letter of Acce	nit for approval a Program for the Works within 14 day ptance.	vs from the				
GCC 26.3	The period between Progr	ram updates is <i>Quarterly</i>					
	The amount to be withhele	d for late submission of an updated Program is					
	KES 100,000						
	The period for submission	n of progress reports is <i>Monthly</i>					
C. Quality Con	trol						
GCC 34.1	The Defects Liability Peri	iod is: 6 Months (180 Days).					
D. Cost Contro	1						
GCC 38.9	If the value engineering p	proposal is approved by the Procuring Entity the amoun	t to be paid to				

Number of GC Clause	Amendments of, and Supplements to, Clauses in the General Conditions of Contract
	the Contractor shall be N/A
GCC 44.1	The currency of the Procuring Entity's Kenya <b>Shillings</b>
GCC 45.1	The Contract <b>IS NOT</b> subject to price adjustment in accordance with GCC Clause 45, and the following information regarding coefficients <i>does not</i> apply.
GCC 46.1	The proportion of payments retained is: 10%
	Limit of Retention: 5% of Accepted Contract Amount (inclusive of VAT)
GCC 47.1	The liquidated damages for the whole of the Works are five (0.05%) of final Contract Price per day. The maximum amount of liquidated damages for the whole of the Works is 5% of the final Contract Price
GCC 49.1	The Advance Payments shall be: 20% of Accepted Contract Amount (inclusive of VAT)
GCC 50.1	The Performance Security amount is:
	(a) Performance Security – Bank Guarantee (unconditional and on demand): in the amount(s) of <b>ten</b> (10) <b>percent</b> of the Accepted Contract Amount and in the same currency (ies) of the Accepted Contract Amount.
	(b) Performance Security – Performance Bond: N/A .
E. Finishing the	e Contract
GCC 56.1	The date by which operating and maintenance manuals are required is
	30 days after substantial completion certificate.
	The date by which "as built" drawings are required is
	30 days after substantial completion.
GCC 56.2	The amount to be withheld for failing to produce "as built" drawings and/or operating and maintenance manuals by the date required in GCC Sub-Clause 58.1 is <b>KES 250, 000/-</b>
GCC 57.2 (g)	The maximum number of days is: 90 Days
GCC 58.1	The percentage to apply to the value of the work not completed, representing the Employer's additional cost for completing the Works, is 15% (Fifteen Percent)

### FORM No 1: NOTIFICATION OF INTENTION TO AWARD

This Notification of Intention to Award shall be sent to each Tenderer that submitted a Tender. Send this Notification to the Tenderer's Authorized Representative named in the Tender Information Form on the format below.

\_\_\_\_\_\_

FO	RN	ΙA	T
----	----	----	---

1.	For the attention	of Tenderer's	Authorized Re	presentative
----	-------------------	---------------	---------------	--------------

- i) Name: [insert Authorized Representative's name]
- *ii)* Address: [insert Authorized Representative's Address]
- *iii)* Telephone: [insert Authorized Representative's telephone/fax numbers]
- iv) Email Address: [insert Authorized Representative's email address]

[IMPORTANT: insert the date that this Notification is transmitted to Tenderers. The Notification must be sent to all Tenderers simultaneously. This means on the same date and as close to the same time as possible.]

2.	Date of transmission:	[email] on [date	e] (local time)

This Notification is sent by (Name and designation)

### 3. Notification of Intention to Award

- i) Procuring Entity Northern Water Works Development Agency
- ii) Project: Ijara Water Supply Project:-Proposed Construction of Masalani-Gababa Pipeline & Ancillary Works
- iii) Contract title: Ijara Water Supply Project:-Proposed Construction of Masalani-Gababa Pipeline & Ancillary Works
- iv) Country: Kenya

### v) ITT No: NWWDA/T/CW/004/2022-2023

- vi) This Notification of Intention to Award (Notification) notifies you of our decision to award the above contract. The transmission of this Notification begins the Standstill Period. During the Standstill Period, you may:
- 4. Request a debriefing in relation to the evaluation of your tender

Submit a Procurement-related Complaint in relation to the decision to award the contract.

- a) The successful tenderer
  - i) Name of successful Tender\_\_\_\_\_
  - ii) Address of the successful Tender\_\_\_\_\_
  - iii) Contract price of the successful Tender Kenya Shillings \_\_\_\_\_\_

### b) Other Tenderers

Names of all Tenderers that submitted a Tender. If the Tender's price was evaluated include the evaluated price as well as the Tender price as read out. For Tenders not evaluated, give one main reason the Tender was unsuccessful.

SNo	Name of Tender	Tender Price as read out	Tender's evaluated price (Note a)	One Reason Why not Evaluated
1				
2				
3				

4		
5		

(Note a) State NE if not evaluated

### 5. <u>How to request a debriefing</u>

- a) DEADLINE: The deadline to request a debriefing expires at midnight on [insert date] (local time).
- b) You may request a debriefing in relation to the results of the evaluation of your Tender. If you decide to request a debriefing your written request must be made within three (5) Business Days of receipt of this Notification of Intention to Award.
- c) Provide the contract name, reference number, name of the Tenderer, contact details; and address the request for debriefing as follows:
  - i) Attention: [insert full name of person, if applicable]
  - ii) Title/position: [insert title/position]
  - ii) Agency: [insert name of Procuring Entity]
  - iii) Email address: [insert email address]
- d) If your request for a debriefing is received within the 3 Days deadline, we will provide the debriefing within five (3) Business Days of receipt of your request. If we are unable to provide the debriefing within this period, the Standstill Period shall be extended by five (3) Days after the date that the debriefing is provided. If this happens, we will notify you and confirm the date that the extended Standstill Period will end.
- e) The debriefing may be in writing, by phone, video conference call or in person. We shall promptly advise you in writing how the debriefing will take place and confirm the date and time.
- f) If the deadline to request a debriefing has expired, you may still request a debriefing. In this case, we will provide the debriefing as soon as practicable, and normally no later than fifteen (15) Days from the date of publication of the Contract Award Notice.

### 6. How to make a complaint

- a) Period: Procurement-related Complaint challenging the decision to award shall be submitted by midnight, [insert date] (local time).
- b) Provide the contract name, reference number, name of the Tenderer, contact details; and address the Procurement-related Complaint as follows:
  - i) Attention: [insert full name of person, if applicable]
  - ii) Title/position: [insert title/position]
  - iii) Agency: [insert name of Procuring Entity]
  - iv) Email address: [insert email address]
- c) At this point in the procurement process, you may submit a Procurement-related Complaint challenging the decision to award the contract. You do not need to have requested, or received, a debriefing before making this complaint. Your complaint must be submitted within the Standstill Period and received by us before the Standstill Period ends.
- d) Further information: For more information refer to the Public Procurement and Disposals Act 2015 and its Regulations available from the Website <a href="mailto:info@ppra.go.ke">info@ppra.go.ke</a> or <a href="mailto:complaints@ppra.go.ke">complaints@ppra.go.ke</a>.
  - You should read these documents before preparing and submitting your complaint.
- e) There are four essential requirements:
  - i) You must be an 'interested party'. In this case, that means a Tenderer who submitted a Tender in this tendering process, and is the recipient of a Notification of Intention to Award.
  - ii) The complaint can only challenge the decision to award the contract.
  - iii) You must submit the complaint within the period stated above.
  - iv) You must include, in your complaint, all of the information required to support your complaint.

### 7. Standstill Period

i) DEADLINE: The Standstill Period is due to end at midnight on [insert date] (local time).

- ii) The Standstill Period lasts ten (14) Days after the date of transmission of this Notification of Intention to Award.
- iii) The Standstill Period may be extended as stated in paragraph Section 5 (d) above.

If you have any questions regarding this Notification please do not hesitate to contact us. On behalf of the Procuring Entity:

Signature:	Name:	
Title/position:	Telephone:	Email:

### FORM NO. 2 - REQUEST FOR REVIEW

**Board Secretary** 

### FORM FOR REVIEW (r.203(1))

# PUBLIC PROCUREMENT ADMINISTRATIVE REVIEW BOARD APPLICATION NO......OF......20...... **BETWEEN** .....APPLICANT **AND** ......RESPONDENT (Procuring Entity) Request for review of the decision of the.............(Name of the Procuring Entity of .......................dated the...day of REQUEST FOR REVIEW I/We....,the above named Applicant(s), of address: Physical address...........P. O. Box review the whole/part of the above mentioned decision on the following grounds, namely: 1. 2. By this memorandum, the Applicant requests the Board for an order/orders that: 1. 2. FOR OFFICIAL USE ONLY Lodged with the Secretary Public Procurement Administrative Review Board on......day of ......20..... **SIGNED**

### FORM NO 3: LETTER OF AWARD

[letterhead paper of the Procuring Entity] [date]

To: [name and address of the Contractor]

You are requested to furnish the Performance Security within 30 days in accordance with the Conditions of Contract, using, for that purpose, one of the Performance Security Forms included in Section VIII, Contract Forms, of the Tender Document.

Authorized Signature:
Name and Title of Signatory:
Name of Procuring Entity
Attachment: Contract Agreement

# FORM NO 4: CONTRACT AGREEMENT

THI	S AG	REEMENT	made the			_day of_				_,
20 <u>2</u> 2	2022					, between <b>Northern Water Works</b>				
Dev	Development Agency hereinafter "the Procuring of					ne part, a	and			of_
						_(herein	after "th	ne Contracto	or"), of the o	ther
part	:									
WH	EREA	AS the	Procuring	Entity	desires	that	the	Works	known	as sł
ould	l be ex	xecuted by the	ne Contractor,	and has ac	cepted a Ter	nder by t	he Cont	ractor for th	ne execution	
		•	Vorks and the re		•	•				
TI	D	oda - Endido	1 41 C 4	-4	<i>C</i> - 11					
The	Proci	iring Entity	and the Contra	ctor agree	as follows:					
1.			ent words and m in the Contra				ame me	eanings as	are respect	ively
2.		reement. Th	documents sha is Agreement s						d as part of	this
	a)	the Letter of	of Acceptance							
	b)	the Letter of	of Tender							
	c)	the addend	la Nos	_(if any)						
	d)	the Special	Conditions of	Contract						
	e)	the Genera	l Conditions of	Contract;						
	f)	the Specifi	cations							
	g)	the Drawin	ngs; and							
	h)	the comple	eted Schedules	and any oth	ner documen	ts formi	ng part o	of the contra	ct.	
3.	In consideration of the payments to be made by the Procuring Entity to the Contractor as specified in this Agreement, the Contractor hereby covenants with the Procuring Entity to execute the Works and to remedy defects therein in conformity in all respects with the provisions of the Contract.							ty to		
4.	The Procuring Entity hereby covenants to pay the Contractor in consideration of the execution and completion of the Works and the remedying of defects therein, the Contract Price or such other sum as may become payable under the provisions of the Contract at the times and in the manner prescribed by the Contract.							other		
			of the parties he ya on the day,					e executed	in accordan	ce
Sigr Enti	ned an ty)	d sealed by_						(for	the Procurin	ng
	ned an tracto							(f	or the	

# **FORM NO. 5 - PERFORMANCE SECURITY**

# $[Option\ 1\ -\ Unconditional\ Demand\ Bank\ Guarantee]$

[Gu	arantor letterhead]
Ben	reficiary:[insert name and Address of Procuring Entity] Date:
	[Insert date of issue]
Gua	arantor: [Insert name and address of place of issue, unless indicated in the letterhead]
1.	We have been informed that
2.	Furthermore, we understand that, according to the conditions of the Contract, a performance guarantee is required.
3.	At the request of the Contractor, we as Guarantor, hereby irrevocably undertake to pay the Beneficiary any sum or sums not exceeding in total an amount of
4.	This guarantee shall expire, no later than the Day of, 2 <sup>2</sup> , and any demand for payment under it must be received by us at the office indicated above on or before that date.
5.	The Guarantor agrees to a one-time extension of this guarantee for a period not to exceed [six months] [one year], in response to the Beneficiary's written request for such extension, such request to be presented to the Guarantor before the expiry of the guarantee."
	[Name of Authorized Official, signature(s) and seals/stamps].
	<b>Note:</b> All italicized text (including footnotes) is for use in preparing this form and shall be deleted from the final product.

<sup>&</sup>lt;sup>1</sup>The Guarantor shall insert an amount representing the percentage of the Accepted Contract Amount specified in the Letter of Acceptance, less provisional sums, if any, and denominated either in the currency of the Contract or a freely convertible currency acceptable to the Beneficiary.

<sup>&</sup>lt;sup>2</sup>Insert the date twenty-eight days after the expected completion date as described in GC Clause 11.9. The Procuring Entity should note that in

the event of an extension of this date for completion of the Contract, the Procuring Entity would need to request an extension of this guarantee from the Guarantor. Such request must be in writing and must be made prior to the expiration date established in the guarantee.

# FORM No. 6 - PERFORMANCE SECURITY

# [Option 2– Performance Bond]

INote: Procuring Entities are advised to use Perfo

	te: Procuring Entities are advised to use Performance Security – Unconditional Demand Bank Guarantee instedd erformance Bond due to difficulties involved in calling Bond holder to action]			
-	arantor letterhead or SWIFT identifier code] eficiary: Northern Water Works Development Agency] Date:[Insert date of issue].			
PE	RFORMANCE BONDNo.:			
Gu	rantor: [Insert name and address of place of issue, unless indicated in the letterhead]			
.•	By this Bondas Principal (hereinafter called "the Contractor") and as Surety (hereinafter called "the Surety"), are held and firmly bound unto_Northern Water Works Development Agency as Obligee (hereinafter called "the Procuring Entity") in the amount of for the payment of which sum well and truly to be made in the types and proportions of currencies in which the Contract Price is payable, the Contractor and the Surety bind themselves, their heirs, executors, administrators, successors and assigns, jointly and severally, firmly by these presents.			
2.	WHEREAS the Contractor has entered into a written Agreement with the Procuring Entity dated theday of, 20, forin accordance with the documents, plans, specifications, and amendments thereto, which to the extent herein provided for, are by reference made part hereof and are hereinafter referred to as the Contract.			
3.	NOW, THEREFORE, the Condition of this Obligation is such that, if the Contractor shall promptly and faithfully perform the said Contract (including any amendments thereto), then this obligation shall be null and void; otherwise, it shall remain in full force and effect. Whenever the Contractor shall be, and declared by the Procuring Entity to be, in default under the Contract, the Procuring Entity having performed the Procuring Entity's obligations thereunder, the Surety may promptly remedy the default, or shall promptly:  1) complete the Contract in accordance with its terms and conditions; or  2) obtain a tender or tenders from qualified tenderers for submission to the Procuring Entity for completing the Contract in accordance with its terms and conditions, and upon determination by the Procuring Entity and the Surety of the lowest responsive Tenderers, arrange for a Contract between such Tenderer, and Procuring Entity and make available as work progresses (even though there should be a default or a succession of defaults under the Contract or Contracts of completion arranged under this paragraph) sufficient funds to pay the cost of completion less the Balance of the Contract Price; but not exceeding, including other costs and damages for which the Surety may be liable hereunder, the amount set forth in the first paragraph hereof. The term "Balance of the Contract Price," as used in this paragraph, shall mean the total amount payable by Procuring Entity to Contractor under the Contract, less the amount properly paid by Procuring Entity to Contractor; or  3) pay the Procuring Entity the amount required by Procuring Entity to complete the Contract in accordance with its terms and conditions up to a total not exceeding the amount of this Bond.			
4.	The Surety shall not be liable for a greater sum than the specified penalty of this Bond.			
5.	Any suit under this Bond must be instituted before the expiration of one year from the date of the issuing of the Taking-Over Certificate. No right of action shall accrue on this Bond to or for the use of any person or corporation other than the Procuring Entity named herein or the heirs, executors, administrators, successors, and assigns of the Procuring Entity.			
6.	In testimony whereof, the Contractor has hereunto set his hand and affixed his seal, and the Surety has caused these presents to be sealed with his corporate seal duly attested by the signature of his legal representative, this day			

SIGNED ON	on behalf of By in the capacity of In the
presence of	
SIGNED ON	on behalf of By_in the capacity of In the
presence of	

### FORM NO. 7 - ADVANCE PAYMENT SECURITY

# [Demand Bank Guarantee] [Guarantor letterhead] Beneficiary: [Insert name and Address of Procuring Entity] [Insert date of issue] ADVANCE PAYMENTGUARANTEE No.: [Insert guarantee reference number] Guarantor: [Insert name and address of place of issue, unless indicated in the letterhead] We have been informed that \_\_\_\_\_ (hereinafter called "the Contractor") has entered into Contract No. \_\_\_\_\_ dated \_\_\_\_ with the Beneficiary, for the execution of \_\_\_\_\_ 1. (hereinafter called "the Contract"). 2. Furthermore, we understand that, according to the conditions of the Contract, an advance payment in the sum \_\_\_\_(in words) is to be made against an advance payment guarantee. 3. At the request of the Contractor, we as Guarantor, hereby irrevocably undertake to pay the Beneficiary any sum or sums not exceeding in total an amount of \_\_\_\_\_\_(in words\_\_\_\_\_\_\_)' upon receipt by us of the Beneficiary's complying demand supported by the Beneficiary's statement, whether in the demand itself or in a separate signed document accompanying or identifying the demand, stating either that the Applicant: has used the advance payment for purposes other than the costs of mobilization in respect of the Works; or a) has failed to repay the advance payment in accordance with the Contract conditions, specifying the amount b) which the Applicant has failed to repay. A demand under this guarantee may be presented as from the presentation to the Guarantor of a certificate from 4. the Beneficiary's bank stating that the advance payment referred to above has been credited to the Contractor on its account number\_\_\_\_at\_\_\_\_. The maximum amount of this guarantee shall be progressively reduced by the amount of the advance payment 5. repaid by the Contractor as specified in copies of interim statements or payment certificates which shall be presented to us. This guarantee shall expire, at the latest, upon our receipt of a copy of the interim payment certificate indicating that ninety (90) percent of the Accepted Contract Amount, less provisional sums, has been certified for payment, or on the \_\_\_\_\_ day of\_\_\_\_\_\_, 2, whichever is earlier. Consequently, plemand for payment under this guarantee must be received by us at this office on or before that date. 6. The Guarantor agrees to a one-time extension of this guarantee for a period not to exceed [six months] [one year], in response to the Beneficiary's written request for such extension, such request to be presented to the Guarantor before the expiry of the guarantee. [Name of Authorized Official, signature(s) and seals/stamps]

final product.

Note: All italicized text (including footnotes) is for use in preparing this form and shall be deleted from the

in the Contract

<sup>&</sup>lt;sup>1</sup>The Guarantor shall insert an amount representing the amount of the advance payment and denominated either in the currency of the advance payment as specified

Insert the expected expiration date of the Time for Completion. The Procuring Entity should note that in the event of an extension of the time for completion of the Contract, the Procuring Entity would need to request an extension of this guarantee from the Guarantor. Such request must be in writing and must be made prior to the expiration date established in the guarantee.

# FORM NO. 8 - RETENTION MONEY SECURITY

# [Demand Bank Guarantee]

[Guarantor letterhead]							
Beneficiary: Date:		[Insert name and	dAddress of Procuring En	itity]			
		[Insert date o	[Insert date of issue]				
Adva	Advance payment guarantee no. [Insert guarantee reference number]						
Gua	rantor: [Insert i	ame and address of place of issue, un	less indicated in the lette	rhead]			
1.	of a joint ventu	nformed that[inserve shall be the name of the joint ventuo Contract No.					
		[insert reference number of the control of the execution of					
2.	retains moneys the Taking-Ove Money has bee	we understand that, according to the coup to the limit set forth in the Contracter Certificate has been issued under the concertified for payment, and payment made against a Retention Money guara	t ("the Retention Money" Contract and the first half of [insert the second half	), and that when of the Retention			
3.	Beneficiary any ([insert amound demand support signed document breach of its o	of the Contractor, we, as Guarantor, a sum or sums not exceeding in total at in words	an amount of [insert am of by us of the Beneficial ether in the demand itself demand, stating that the	ount in figures] ary's complying or in a separate Contractor is in			
4.	certificate from referred to about	er this guarantee may be presented as from the Beneficiary's bank stating that the re has been credited to the Contractor and address of Applicant's bank].	e second half of the Rete	ention Money as			
5. Th	2	all expire no later than the, and any demand for payment under on or before that date.					
6.	months] [one y	agrees to a one-time extension of this ear], in response to the Beneficiary's esented to the Guarantor before the exp	written request for such				
	[Name of Auth	orized Official, signature(s) and seals/	'stamps]				
		ized text (including footnotes) is for t te final product.	use in preparing this for	n and shall be			

<sup>&</sup>lt;sup>1</sup>The Guarantor shall insert an amount representing the amount of the second half of the Retention Money.

<sup>2</sup>Insert a date that is twenty-eight days after the expiry of retention period after the actual completion date of the contract. The Procuring Entity should note that in the event of an extension of this date for completion of the Contract, the Procuring Entity would need to request an extension of this guarantee from the Guarantor. Such request must be in writing and must be made prior to the expiration date established in the guarantee.

### FORM NO. 9 BENEFICIAL OWNERSHIP DISCLOSURE FORM

### INSTRUCTIONS TO TENDERERS: DELETE THIS BOX ONCE YOU HAVE COMPLETED THE FORM

This Beneficial Ownership Disclosure Form ("Form") is to be completed by the successful tenderer. In case of joint venture, the tenderer must submit a separate Form for each member. The beneficial ownership information to be submitted in this Form shall be current as of the date of its submission.

For the purposes of this Form, a Beneficial Owner of a Tenderer is any natural person who ultimately owns or controls the Tenderer by meeting one or more of the following conditions:

- Directly or indirectly holding 25% or more of the shares.
- Directly or in directly holding 25% or more of the voting rights.
- Directly or indirectly having the right to appoint a majority of the board of directors or equivalent governing body of the Tenderer.

Tender Reference No.:	[insert		
identification no] Name of the Assignment:	[insert		
ame of the assignment] to:[insert complete name of Procuring Entity]			
In response to your notification of award datedto furnish additional information on beneficial ownership:delete the options that are not applicable]	[insert date of notification of award] [select one option as applicable and		
I) We here by provide the following beneficial ownership in	formation.		

### **Details of beneficial ownership**

Identity of Beneficial Owner	Directly or indirectly holding 25% or more of the shares (Yes / No)	Directly or indirectly holding 25 % or more of the Voting Rights (Yes / No)	Directly or indirectly having the right to appoint a majority of the board of the directors or an equivalent governing body of the Tenderer (Yes / No)
[include full name (last, middle, first), nationality, country of residence]			

OR

ii) We declare that there is no Beneficial Owner meeting one or more of the following conditions: directly or indirectly holding 25% or more of the shares. Directly or indirectly holding 25% or more of the voting rights. Directly or indirectly having the right to appoint a majority of the board of directors or equivalent governing body of the Tenderer.

OR

We declare that we are unable to identify any Beneficial Owner meeting one or more of the following conditions. [If this option is selected, the Tenderer shall provide explanation on why it is unable to identify any Beneficial Owner]

Directly or indirectly holding 25% or more of the shares. Directly or indirectly holding 25% or more of the voting rights.

Directly or indirectly having the right to appoint a majority of the board of directors or equivalent governing body of the Tenderer]"

Name of the Tenderer:*[insert complete name of the Tenderer]
Name of the person duly authorized to sign the Tender on behalf of the Tenderer: ** [insert complete name of person duly authorized to sign the Tender]
Title of the person signing the Tender: [insert complete title of the person signing the Tender]
Signature of the person named above:
Date signed [insert date of signing] day of [Insert month], [insert year]

### NWWDA

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	LIST OF PRINCIPAL ITEMS				
1	Rehabiliation and installation of Pumping Sets;various duties	Nr	6	N/A	N//
2	Supply and installation of power control boards	Nr	1	N/A	N/A
3	Supply and installation of steel/GI pipe fittings; various sizes	Items	Various	N/A	N/A
4	Civil Works: Construction of Gate Valve Chambers	Nr	12	N/A	N/A
5 6	Civil Works: Construction of Air Valve Chambers  Excavation of pipeline trenches	Nr Km	16 17	N/A	N/
7	Civil Works: Breaking up and reinstatement of murrum	m	30	N/A	N/A
8	Roads Construction of DN 160 PN 12.5 HDPE Pipeline	Km	7	N/A	N/
9	Construction of DN 110 PN 12.5 HDPE Pipeline	Km	10	N/A	N/
10	Construction of DN 80 PN 10 HDPE Pipeline	Km	3	N/A	
11	Civil Works: Construction of 150m3 Elevated Steel Tank	Nr	1	N/A	
12	Civil Works: Rehabilitation of 100m3 Elevated Steel Tank	Nr	1	N/A	N/
13	Civil Works: Rehabilitation of 150m3 Elevated Steel Tank	Nr	3	N/A	N/
14	Civil Works: Rehabilitation of 20-25m3/hr Composite Filtration Unit	Nr	1	N/A	N/
15	Civil Works: Rehabilitation of 20-25m3/hr Composite Filtration Unit	Nr	1	N/A	N/
16	Civil Works: Rehabilitation of Pumping sets	Nr	1	N/A	N/

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	DAYWORK SCHEDULE				, ,
	The rates entered in the following schedules will be used in assessing the cost of any extra work ordered by the Engineer for execution on a Daywork basis. If any rate is found to be grossly in excess of the prevailing market rates ,the Engineer shall use the market rate for this purpose. The rates entered shall constitute full compensation for all costs of organization of works, overheads, profits, duties, taxes, royalties, incidentals, wastage, transport to site and all other costs necessary for the performance of the works on a day-works basis				
A411	Day Works: Labour				
A411.0	Site Agent	Hr	1.00		
A411.1	General Foreman	Hr	1.00		
A411.2	Foreman	Hr	1.00		
A411.3	Technician (Water)	Hr	1.00		
A411.4	Assistant foreman	Hr	1.00		
A411.5	Unskilled labourer	Hr	1.00		
A411.6	Plant operator	Hr	1.00		
A411.7	Power Plant Mechanic	Hr	1.00		
A411.8	Pump Attendant	Hr	1.00		
A411.9	Vehicle driver	Hr	1.00		
A411.10	Graded Artisan	Hr	1.00		
A411.11	Carpenter	Hr	1.00		
A411.12	Pipefitter	Hr	1.00		
A411.13	Welder	Hr	1.00		
A411.14	Pipelayer	Hr	1.00		
A411.15	Electrician	Hr	1.00		
A411.16	Surveyor	Hr	1.00		
A411.17	Surveying Assistant	Hr	1.00		
A411.18	Staffman	Hr	1.00		
A411.19	Chainman	Hr	1.00		
A411.20	Painter	Hr	1.00		
A411.21	Lab Technician	Hr	1.00		
A411.22	Watchman	Hr	1.00		
	Section 1				
	Day Work Total : Labour				•

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
A413	Day Work: Materials	01111	Q0/IIIII	10 (12 (13113)	71110-0111 (110113
7413	All materials as per specifications. The rate to include for				
	delivery to site, storage and handling.				
A413.1	15mm Coarse aggregates for concrete	m <sup>3</sup>	5.00		
A413.2	20mm Coarse aggregates for concrete	m <sup>3</sup>	5.00		
A413.3	40mm Coarse aggregates for concrete	m <sup>3</sup>	5.00		
A413.4	Fine aggregates (sand) for concrete	m <sup>3</sup>	2.00		
A413.5	Ordinary portland cement	t	0.50		
A413.6	150mm thick building stone/concrete blocks	nr	10.00		
A413.7	200mm thick building stone/concrete blocks	nr	10.00		
A413.8	225mm thick building stone/concrete blocks	nr	10.00		
A413.9	Hardcore	m3	5.00		
A413.10	Murram/gravel	m3	5.00		
A413.11	uPVC PN 10 Socket Spigot pipe DN200	m	12.00		
A413.12	uPVC PN 10 Socket Spigot pipe DN160	m	12.00		
A413.13	uPVC PN 10 Socket Spigot pipe DN 110	m	12.00		
A413.14	uPVC PN 10 Socket Spigot pipe DN 80	m	12.00		
A413.15	GI Class B pipe 150mm dia	m	12.00		
A413.16	GI Class B pipe 100mm dia	m	12.00		
A413.17	DN 160 PN 12.5 HDPE Pipes	m	10.00		
A413.18	DN 110 PN 12.5 HDPE Pipes	Roll	1.00		
A413.19	DN 80 PN 10 HDPE Pipes	Roll	1.00		
A413.20	DN 160 HDPE male adaptors	nr	1.00		
A413.21	DN 110 HDPE male adaptors	nr	1.00		
A413.22	DN 80 HDPE male adaptors	nr	1.00		
A413.23	DN 160 stepped couplins	nr	1.00		
A413.24	DN 110 stepped couplins	nr	1.00		
A413.25	DN 80 stepped couplins	nr	1.00		
A413.26	Concrete Grade 15/40	m3	1.00		
A413.27	Concrete Grade 20/20	m3	1.00		
A413.28	Concrete Grade 25/20	m3	1.00		
A413.29	Petrol	I	100.00		
A413.30	Diesel	I	100.00		
	Day Works Total Materials				
	Day Works Total :Materials				

ITENA No	ITEM DESCRIPTION	LINIT	OLIANITITY	DATE (KChc)	ANAOLINIT /VCho
ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
A415	Day Works :Plant				
	Rate to include for all operation and maintenance costs, fuel, oil, grease, operators etc.Measured in machine hours				
A415.1	1 tonne pickup	hr	1		
A415.2	7 tonne lorry (tipper)	hr	1		
A415.3	10 tonne lorry (tipper)	hr	1		
A415.4	15 tonne lorry (tipper)	hr	1		
A415.5	20 tonne lorry (tipper)	hr	1		
A415.6	D7 bulldozer	hr	1		
A415.7	Hydraulic excavator/shovel (1.0m3)	hr	1		
A415.8	Backhoe tractor (1.0m3)	hr	1		
A415.9	Wheel loader	hr	1		
A415.10	Concrete mixer	hr	1		
A415.11	Concrete vibrator (petrol or diesel) with drive, flex and 50mm poker	hr	1		
A415.12	Concrete vibrator (petrol or diesel) with drive, flex and 40mm poker	hr	1		
A415.13	Water bowser ; capacity	hr	1		
A415.14	Portable dewatering pump (50mm dia)	hr	1		
A415.15	Portable dewatering pump (75mm dia)	hr	1		
A415.16	Vibrating plate compactor	hr	1		
A415.17	Air compressor machine (5000 I/min)	hr	1		
A415.18	Generator (15kVA)	hr	1		
A415.19	Electric welding set including electrodes	hr	1		
A415.20	Cutting and welding set including oxygen and acytylene	hr	1		
A415.21	Butt Fusion equipment	hr	1		
				_	
<del></del>	Day Works Total :Plant				

CLA	ITEM DESCRIPTION  LL No.1: PRELIMINARY AND GENERAL ITEMS	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
A100 <b>Co</b>	ASS A - GENERAL ITEMS				
	ontractual Requirements				
A120.0 Ins	surance of the Works	cum	1		
A120.0 IIIS	surance of the works	sum	1		
A120.1 Thi	nird Party insurance	sum	1	1	
A190.1 Set	etting out the Works as specified	sum	1		
Δ140)	rovisional sum for monthly site meetings as specified or rected by the Engineer	month	12	150,000.00	1,800,000.00
A190.3 All	low for the provision of record drawings.	sum	1		
A190.4 All	low for provision of O&M Manuals.	sum	1		
A190.5 % A	Adjustment to the Provisional Sum for Items A190.2	%	1,800,000.00		
A200 <b>Sp</b>	pecified Requirements				
A210 <b>Ac</b>	ccomodation for the Engineer				
Ι Δ/11 () Ι	rovisional Sum for monthly Office Accommodation rent or the Engineer and staff	Month	12	20,000.00	240,000.00
A211.1 % A	Adjustment to the Provisional Sum for Items A211.0	%	240,000.00		-
A220 Sei	ervices for the Engineer				
A221.0 vel	rovisional Sum for Maintainance/running costs of 1 No. whicle for Engineer's staff provided by the Employer over the period of the contract	month	12	300,000.00	3,600,000.00
A222.0 tel	rovisional Sum for Maintenance/operating costs for the elephone services provided to the Engineer's Staff rovisional)	month	12	12,000.00	144,000.00
1 A220 N I	rovisional Sum for Maintenance of the site offices for ngineer's Staff during the contract period (Provisional)	month	12	20,000.00	240,000.00
Ι Δ//9 1	rovisional Sum for monthly site allowancres for the ngineer's Staff over the duration of the contract	month	12	260,000.00	3,120,000.00
1 / 1/1/1/1	ovisional Sum for furnishing the rented site comodation for Engineer's Staff	sum	1	200,000.00	200,000.00
1 A//4 4 1	Adjustment to the Provisional Sum for Items A221.0- 229.2	%	7,304,000.00		
A230 <b>Eq</b>	quipment for use by the Engineer				
I A231.0 I	ovisional Sum for Provision of office equipment for use the Engineer	sum	1	120,000.00	120,000.00
Δ / 4 / 1 / 1	rovisional Sum for Provision of office equipment &	sum	1	5,000,000.00	5,000,000.00
sof	oftware for use by the Engineer				
-	age Total C/F to Bill No 1 Collection Sheet				

ITENA N.	ITEM DESCRIPTION	LINIT	OLIANITITY	DATE (KCha)	ANAOLINIT (VCha)
ITEM No.	Provisional Sum for monthly Maintenance of office	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
A231.2	equipment for use by the Engineer's Staff	Month	12	50,000.00	600,000.00
	, , ,				
A231.3	Provisional Sum for survey equipment as specified	sum	1	100,000.00	100,000.00
A239.0	Provisional Sum for Provision of protection, safety equipment and clothing for the use of the Engineer's Staff	sum	1	100,000.00	100,000.00
A239.1	Provisional Sum for camera equipment and site record and progress photographs as specified	sum	1	60,000.00	60,000.00
A239.2	% Adjustment to the provisional sum for Items A231.0 to A239.1	%	5,980,000.00		-
A 2 4 0	Attandance when the Fusiness				
A240	Attendance upon the Engineer				
A241	Provisional Sum for Attendance upon Engineer's Staff by 1 No. driver during the contract period	Month	12	52,500.00	630,000.00
A242	Provisional Sum for Attendance upon Engineer's staff by 3 No. chainmen during the contract period	Month	12	30,000.00	360,000.00
A243	Provisional Sum for Attendance upon Engineer's Staff by a secretary (1No.) during the contract period	Month	12	22,000.00	264,000.00
A244	% Adjustment to the provisional sum for Item No. A241 - A243	%	1,254,000.00		-
A250	Testing of Materials				
A250.1	Provisional Sum for testing of materials as specified or directed by the Engineer	sum	1	150,000.00	150,000.00
A250.2	% Adjustment to the Provisional Sum for Item A250.1	%	150,000.00		-
A260	Testing of the Works				
AZOO	results of the works				
A260.1	Provisional Sum for testing of the Works as specified or directed by the Engineer	sum	1	200,000.00	200,000.00
A260.2	% Adjustment to the provisional sum for Item A260.1	%	200,000.00		
A270	Temporary Works Provision, fixing and maintainance of signboards in				
A279.0	accordance with the drawings provided	nr	3		-
A400	Provisional Sums				
A410	Dayworks				
A411	Provisional Sum for Dayworks Labour b/f from Page 2	Sum	1	-	
A412	% Adjustment to Provisional Sum for Dayworks Labour	%	_		
7417	Zarkajustinent to Frovisional Sun for Dayworks Labout	/0			<u> </u>
A413	Provisional Sum for Dayworks Materials b/f from Page 3	Sum	1	-	
A414	% Adjustment to Provisional Sum for Dayworks Materials	%	-		
	Page Total C/F to Bill No 1 Collection Sheet				
	1		·		

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
A415	Provisional Sum for Dayworks Plant b/f from Page 4	Sum	1	-	-
A416	% Adjustment to Provisional Sum for Dayworks Plant	%	_		_
4200					
A300	Method-Related Charges				
	The Tenderer may insert here such items for Method-Related Charges as he may decide to cover items of work relating to his intended method of executing the works, the costs of which are not to be considered as proportional to the quantities of the other items and for which he has not allowed in the rates and prices for the other items. Each item inserted shall be fuly described so as to define precisely the extent of the work covered and to identify the resources to be used and the particular items of permanent Works or Temporary Works, if any, to which the item relates. Each item description for Method -Related Charge shall distinguish between Fixed and Time -Related charges				
A310	Accommodation and buildings				
A311	Provision of offices				-
A312	Provision of Stores				-
A320	Services				-
A321	Provision of Electricity				_
A322	Provision of Water				-
A323	Provision of Security				-
A325	Provision of Site Transport				-
A326	Provision of Personnel transport				-
A330	Plant				-
A331	Provision of lifting cranes				-
A332	Provision of Transport				-
					-
A333	Provision of earthmoving equipment				-
A334	Provision of compaction equipment				-
A335	Provision of concrete mixing equipment				-
A336	Provision of concrete transport equipment				-
A340	Plant				-
A341	Provision of pipelaying equipment				-
A341	rrovision or pipelaying equipment				-
	Page Total C/F to Bill No 1 Collection Sheet				-

A350 Temporary Works A351 Traffic Diversions A352 Traffic Regulation A356 Establishment of pumping equipment A357 Establishment of pumping equipment A350 Temporary Works A364 Fornwork A365 Hardstandings A370 Supervision and Labour A371 Supervision A371 Supervision A371 Supervision A372 Administration A373 Labour teams A373 Labour teams A374 Devictional Sums-Defined Work A376 Provisional Sum-Defined Work A371 Supervision A371 Supervision A371 Supervision A372 Administration A373 Labour teams A374 Labour teams A375 Labour teams A470 Provisional Sum for the supply and installation of lower Interview In	ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
A352 Traffic Regulation  A356 Establishment of pumping equipment  A367 Establishment of dewatering equipment  A368 Temporary Works  A369 Formwork  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Labour teams  A420 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A771 Provisional Sum for way leave acquisition and other fees required by the relevant Authorities  A772 Sum 1 400,000.00 400,000.00 400,000.00 6300,000.00			• • • • • • • • • • • • • • • • • • • •	20111111	(10110)	(10110)
A352 Traffic Regulation  A356 Establishment of pumping equipment  A367 Establishment of dewatering equipment  A368 Temporary Works  A369 Formwork  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Labour teams  A420 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A771 Provisional Sum for way leave acquisition and other fees required by the relevant Authorities  A772 Sum 1 400,000.00 400,000.00 400,000.00 6300,000.00						
A356 Establishment of pumping equipment  A360 Temporary Works  A364 Formwork  A366 Nardstandings  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Iabour teams  A42.0 Provisional Sum-Defined Work  Provisional Sum-Defined Work  A42.1.1 Provisional Sum-Defined Work  A42.1.2 Provisional Sum for the for the supply and installation of new yieave acquisition and other fees required by the relevant Authorities  Provisional Sum for supply, installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A42.1.2 Provisional Sum for the rehabilitation of 100m <sup>2</sup> Gababa elevated water tank  A42.1.3 Provisional Sum for the rehabilitation of 100m <sup>2</sup> Gababa elevated water tank  A42.1.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply cable by KPLC to the New Intake pump house as per special specifications provided  A42.1.5 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply cable by KPLC to the New Intake pump house as per special specifications provided  A42.1.5 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply cable by KPLC to the New Intake pump house as per special specifications provided  A42.1.5 Allow for a Provisional Sum for the Supply installation testing and commissioning of a stand since Electric Main Board and Motor Control Centre at the New Intake pump house as per special specifications provided  A42.1.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A42.1.7 Akappa and the A42.1.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A42.1.7 Akappa and the A42.1.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)	A351	Traffic Diversions				-
A357 Establishment of dewatering equipment  A360 Temporary Works  A361 Formwork  A362 Formwork  A363 Supervision and Labour  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Labour teams  A420 Provisional Sum-Defined Work  A774 Provisional Sum for the for the supply and installation of provisional Sum for the for the supply and installation of provisional Sum for way leave acquisition and other fees provided (Provisional)  A421.1 required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of intake pump house overhead manual travelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m² Gababa elevated water tank  A421.4 New Intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the Supply Installation, testing and commissioning of a stand shore Electric Main Board and Motor Control Centre at the New Intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumpling sets (Provisional)  A421.6 Provisional Sum for rehabilitation and installation of pumpling sets (Provisional)  A421.7 Nadjustment for Contractor's costs and profit for items  A421.7 Nadjustment for Contractor's costs and profit for items  A421.7 Nadjustment for Contractor's costs and profit for items  A421.7 Nadjustment for Contractor's costs and profit for items  A421.7 Nadjustment for Contractor's costs and profit for items  A421.7 Nadjustment for Contractor's costs and profit for items	A352	Traffic Regulation				-
A360 Temporary Works  A364 Formwork  A366 Hardstandings  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Labour teams  A420 Provisional Sums-Defined Work  A210 Provisional Sums-Defined Work  A221 Labour teams  A221 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A221 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A221.2 Provisional Sum for supply, installation & commissioning of Intake pump house overhead amanuta ruvelling Girder cane as per drawings and specifications provided  A221.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A221.4 Provisional Sum for the upgrading and relocation of the Main Power Supply (Cable by KPLC to the Supply, installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the Supply, installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the Supply, installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New Intake pump house as per special specifications provided  A221.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A221.7 X Adjustment for Contractor's costs and profit for items  A221.7 X Adjustment for Contractor's costs and profit for items  A221.7 X Adjustment for Contractor's costs and profit for items  A221.7 X Adjustment for Contractor's costs and profit for items  A221.7 X Adjustment for Contractor's costs and profit for items  A221.7 X Adjustment for Contractor's costs and profit for items	A356	Establishment of pumping equipment				-
A364 Formwork  A366 Hardstandings  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Labour teams  A20 Provisional Sums-Defined Work  A21.0 Provisional Sums for the for the supply and installation of provisional Sums for the for the supply and installation of provisional Sum for the for the supply and installation of provisional Sum for supply installation of provisional Sum for supply installation & Sum 1 6,300,000.00 6,300,000.00 provisional Sum for supply installation & Sum 1 400,000.00 400,000.00 provisional Sum for supply installation & commissioning of installation & supply installation & sum 1 4,000,000.00 4,000,000.00 provisional Sum for the rehabilitation of 100m² Gababa elevated water tank  A421.3 Provisional Sum for the rehabilitation of 100m² Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.6 Provisional Sum for the special specifications provided  A421.6 Provisional Sum for the special specifications provided  A421.6 Provisional Sum for the special specifications provided  A421.7 Septimal Form of a Provisional Sum for the special specifications provided  A421.7 Septimal Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items  A421.7 Adjustment for Contractor's costs and profit for items	A357	Establishment of dewatering equipment				-
A366 Hardstandings  A370 Supervision and Labour  A371 Supervision  A372 Administration  A373 Labour teams  A420 Provisional Sums-Defined Work  A21.0 New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Interest of the relevant Authorities  A421.3 Provisional Sum for supply, installation & commissioning of intake pumph ouse overhead manual travelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m² Gababa elevated water tank  A421.4 New Intake pumph pouse as per special specifications provided  A421.4 New Intake pumph ouse as per special specifications provided  A421.5 New Intake pumph bouse as per special specifications provided  A421.6 Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pumph bouse as per special specifications provided  A421.6 Provisional Sum for the upgrading and alone Electric Main Board and Motor Control Centre at the New Intake pumph bouse as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumpling sets (Provisional)  A421.7 SAdjustment for Contractor's costs and profit for items  A421.7 SAdjustment for Contractor's costs and profit for items  A421.7 SAdjustment for Contractor's costs and profit for items  A421.7 SAdjustment for Contractor's costs and profit for items  A421.7 SAdjustment for Contractor's costs and profit for items  A421.7 SAdjustment for Contractor's costs and profit for items	A360	Temporary Works				-
A370 Supervision A371 Supervision A372 Administration A373 Labour teams A420 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m² Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pump house as per special specifications provided  Allow for a Provisional Sum for the Supply Cable by KPLC to the New Intake pump house as per special specifications provided  Allow for a Provisional Sum for the New Intake pump house as per special specifications provided  A421.5 Sum 1 250,000.00 250,000.00 3,500,000.0	A364	Formwork				-
A371 Supervision  A372 Administration  A373 Labour teams  A420 Provisional Sums-Defined Work  Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Revisional Sum for the rehabilitation of 100m <sup>3</sup> Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  Allow for a Provisional Sum for the Supply Cable by KPLC to the New intake pump house as per special specifications provided  Allow for a Provisional Sum for the New Intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the Supply Installation, testing and commissioning of a stand and provided Sum for the Supply Installation for the New Intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  Sum 1 3,500,000.00  3,000,000.00  3,000,000.00  4421.7 % Adjustment for Contractor's costs and profit for items A221.0 and to A421.6	A366	Hardstandings				-
A373 Labour teams  A420 Provisional Sums-Defined Work  A421.0 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of Intake pump house overhead manual travelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A421.4 Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.5 Sum 1 250,000.00 250,000.00  A421.6 Provisional Sum for the Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 %Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A370	Supervision and Labour				-
A421.0 Provisional Sums-Defined Work  A421.0 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A421.4 Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the upgrading and alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 **Adjustment for Contractor's costs and profit for items A421.7 and to A421.6 Allow for a Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 **Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A371	Supervision				-
A421.1 Provisional Sums-Defined Work  A421.0 Provisional Sums-Defined Work  A421.1 Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of Intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the Supply Installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 % Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A372	Administration				-
Provisional Sum for the for the supply and installation of New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply, installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the Supply installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 % Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A373	Labour teams				-
A421.1 New Intake Pumphouse pipes and fittings as per drawings provided (Provisional)  A421.1 Provisional Sum for way leave acquistion and other fees required by the relevant Authorities  A421.2 Provisional Sum for supply ,installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the Supply Cable by KPLC to the New Intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 % Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A420	Provisional Sums-Defined Work				-
Provisional Sum for supply, installation & commissioning of intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A21.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A21.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  Allow for a Provisional Sum for the Supply installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A21.5 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A21.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A21.7 School Advisor Advis	A421.0	New Intake Pumphouse pipes and fittings as per drawings	Sum	1	6,300,000.00	6,300,000.00
A421.2 intake pump house overhead manual tarvelling Girder crane as per drawings and specifications provided  A421.3 Provisional Sum for the rehabilitation of 100m³ Gababa elevated water tank  A421.4 Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  A421.5 Allow for a Provisional Sum for the Supply, installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 % Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A421.1		Sum	1	400,000.00	400,000.00
Allow for a Provisional Sum for the upgrading and relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  Allow for a Provisional Sum for the Supply, installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.5 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A421.2	intake pump house overhead manual tarvelling Girder	Sum	1	4,000,000.00	4,000,000.00
relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications provided  Allow for a Provisional Sum for the Supply, installation, testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 % Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A421.3		Sum	1	500,000.00	500,000.00
Supply,installation,testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications provided  A421.6 Provisional Sum for rehabilitation and installation of pumping sets (Provisional)  A421.7 Adjustment for Contractor's costs and profit for items A421.0 and to A421.6	A421.4	relocation of the Main Power Supply Cable by KPLC to the New intake pump house as per special specifications	Sum	1	250,000.00	250,000.00
A421.6 pumping sets (Provisional)  A421.7 % Adjustment for Contractor's costs and profit for items A421.0 and to A421.6  Sum 1 3,000,000.00  17,950,000.00	A421.5	Supply,installation,testing and commissioning of a stand alone Electric Main Board and Motor Control Centre at the New intake pump house as per special specifications	Sum	1	3,500,000.00	3,500,000.00
A421.7 A421.0 and to A421.6 % 17,950,000.00	A421.6		Sum	1	3,000,000.00	3,000,000.00
	A421.7		%	17,950,000.00		
Hage Total C/E to Bill No 1 Collection Sheet		Page Total C/F to Bill No 1 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	Bill No 1 Collection Sheet			, ,	` '
	Description if any				
	Brought forward from page 5				-
	Brought forward from page 6				-
	Brought forward from page 7				-
	Brought forward from page 8				
	BILL No.1 TOTAL C/F TO BILLS SUMMARY SHEET				-
L		<u> </u>	<u> </u>	<u> </u>	L

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	BILL NO. 2 - CONSTRUCTION OF GABABA-MASALANI				
	PIPELINE				
	CLASS A CENEDAL ITEMS				
	CLASS A - GENERAL ITEMS				
	Testing of the Works				
1260.1	Carrying out tests on DN160 HDPE pipeline as specified .		7,000,00		
A260.1	Include provision of all equipment and materials	m	7,000.00		
	Carrying out tests on DN110 HDPEpipeline as specified .				
A260.2	Include provision of all equipment and materials	m	10,000.00		
	CLASS B - SITE INVESTIGATION				
	Trial holes where ordered to prove location,construction				
B111	size etc, of pipelines, services or existing structures, max	nr	6.00		
	depth ne 1m (Provisional)				
	Trial holes where ordered to prove location, construction				
B112	size etc, of pipelines, services or existing structures, max	nr	5.00		
	depth 1-2m (Provisional)				
	CLASS D - DEMOLITION AND SITE CLEARANCE				
	General site clearance through undeveloped land over the				
D100	wayleave (n.e 4m wide), rate to include for any additional	ha	6.50		
	clearance required ( provisional)				
D210	Removal of trees, girth 0.5-1m (provisional)	nr	6.00		
D220	Removal of trees, girth 1-2m (provisional)	nr	6.00		
	CLASS I: PIPEWORK - PIPES				
	The rates entered against the items in this section shall include for stripping top soil, laying aside or hauling ,and				
	subsequently replacing over refilled trench, excavation in				
	trench in material other than rock, shuttering where				
	necessary, refilling and compacting, spreading surplus soil				
	evenly over and alongside pipe trench compacting, supply lay and joint pipes to correct line and level. Depths are				
	stated from ground level to invert level.				
	HDPE PIPES				
1712.1	DN160HDPE pipe PN12.5 in trenches depth not exceeding	m	7,000.00		
17 14.1	1.5m		7,000.00		
	DN110HDPE pipe PN12.5 in trenches depth not exceeding				
1712.2	1.5m	m	10,000.00		
	CLASS J: PIPEWORK - FITTINGS AND VALVES (Including				
	Supply)				
	Installation of pipe fittings in trenches or in chambers				
	HDPE Bends				
J611	DN 160 ,90° Bend	Nr	3.00		
	Provided to the pillon of the				
	Page Total C/F to Bill No 2 Collection Sheet				

	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
ITEM No.	Steel junctions and Branches	ONT	QUANTITI	NATE (ROIIS)	AWOUNT (KSH3)
	-				
J321.0	DN 150 S All Flanged Equal Tee	Nr	3.00		-
J321.1	DN 150x 25 S Flanged Reducing Tee	Nr	7.00		-
J321.2	DN 100x 25 S Flanged Reducing Tee	Nr	11.00		-
J331.0	Tapers DN 150x 80 S Flanged Concentric taper	Nr	2.00		-
J331.1	DN 150x 100 S Flanged Concentric taper	Nr	2.00		
			2.00		
	Double Collars				
J341.0	DN 150 Stepped Coupling	Nr	16.00		-
J341.1	DN 110 Stepped Coupling	Nr	22.00		-
	Adaptors				
J351.1	DN 150S Flanged Adaptor	Nr	6.00		-
J351.2	DN 110 HDPE Adaptor	Nr	3.00		-
		NI.			
J351.3	DN 80 HDPE Adaptor	Nr	1.00		-
	Glands				
J361.0	DN 80 Clean water master meter ;minimum range	Nr	4.00		
1501.0	100m3/hr	INI	4.00		-
J361.1	DN 100 Clean water master meter ;minimum range	Nr	2.00		
	100m3/hr	141	2.00		
	Straight Specials				
J381.0	DN 150 S Flanged Special spigot pipe 1200mm long	Nr	8.00		
3301.0		141	0.00		
J381.1	DN 150 S Flanged Special spigot pipe 1200mm long, with CTF	Nr	11.00		-
J381.2	DN 150S Plain Special spigot pipe 1200mm long	Nr	6.00		-
J381.3	DN 100 S Flanged Special spigot pipe 1200mm long	Nr	11.00		
J381.4	DN 100 S Plain Special spigot pipe 1200mm long	Nr	11.00		-
	Installation of Valves				
J811	DN 150S Sluice Valve	Nr	6.00		-
	DNI 25 Circle Air Velve constitution with the state of th	N1	47.00		
J861	DN 25 Single Air Valve complete with inbuilt isolating Valve	Nr	17.00		-
	Page Total C/F to Bill No 2 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
TILIVITIO.	CLASS K: PIPEWORK - MANHOLES AND PIPEWORK	ONT	QUANTITI	NATE (NSH3)	AMOUNT (KSIIS
	ANCILLARIES				
	Excavation quantities are given net. The rates entered are				
	to include for manhole concrete slabs and covers, step				
	irons or ladder, excavation, working space, trimming the				
	base of the excavation, shuttering where necessary,				
	refilling and compacting around the finished manholes, and				
	disposing of surplus spoil local to the trench. Surplus spoil				
	is to be evenly spread.				
	Construction of Gate Valve Chambers complete as shown				
K 212.0	on the drawings WW/WD/874/SD/017 and 018;depth 1.5-	nr	3.00		
	2m				
W 242 4	Construction Air valve chambers as shown on Drawings		47.00		
K 212.1	WW/WD/874/SD/003 and SD/004; depth 1.5-2m	nr	17.00		
	Washout gate valve chambers type 1 as shown on Drawing				
K 212.2	No. WW/WD/874/SD/002; depth 1.5-2m	nr	1.00		
K 212.3	Washout gate valve chambers type 2 as shown on Drawing	nr	1.00		
	No. WW/WD/874/SD/002; depth 1.5-2m				
	Crossings				
	The rates inserted here shall cover all work associated				
	with the crossings including provision of sleeves as				
	specified				
K 661	Fence crossing and reinstatement; Pipe nominal bore n.e	nr	3.00		
	300mm	•••	5.00		
	Underground water mains crossing and reinstatement;Pipe				
K 681	nominal bore n.e 200mm	nr	2.00		
	Horimal Bore II.e 20011111				
	Reinstatement				
	The rates inserted here shall cover all work associated				
	with the crossings including provision of sleeves as				
	specified				
	Breaking up, temporary and permanent reinstatement of				
K 731	murram roads ;Pipe nominal bore n.e 300mm	m	48.00		
	Marker Posts as shown on Drawing No.				
	WW/WD/874/SD/011				
V022 4	Markor posts for Cata Values inceribed CV	~~	2.00		
K822.1	Marker posts for Gate Valves inscribed GV	nr	3.00		
K822.2	Ditto but for Washouts inscribed WO	nr	2.00		
			2.30		
K822.3	Ditto but for Air Valve inscribed AV	nr	17.00		
K822.4	Ditto but for Water Main inscribed WM	nr	85.00		
	Other pipework ancillaries				
	The rates inserted here shall include for keeping all				
	excavations free from water				
	Interconnection of new line to the Muhumed Dahir offtake				
K851	chamber along the DN 150 uPVC existing Backwash	nr	1.00		
	Elevated Water Tank line				
	Page Total C/F to Bill No 2 Collection Sheet				
		l	l .		<u> </u>

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
K861.0	Interconnection of Muhumed Dahir and Universal Health Care EWT the to Gababa pipe line	nr	2.00		-
K861.1	Interconnection to existing Gababa Elevated Water Tank	nr	1.00		-
K861.2	Interconnection to Ijara Technical and Vacational Training Center Elevated Water Tank	nr	1.00		-
	Mass concrete class 20/20 in thrust blocks				
	Thrust blocks for bends, tees and blank ends. Dimensions of each block as shown on Drawings No. WW/WD/874/SD/006 and SD/007 to suit.				
L711.1	Nominal bore 150mm Tees in GV chambers; volume n.e 0.1 m <sup>3</sup>	nr	3.00		-
L711.2	Nominal bore 150mm Tees in Air Valve chambers; volume n.e 0.1 m3	nr	17.00		-
	Mass concrete class 20/20 in anchor blocks				
	Anchor blocks for tapers and Gate valves. Dimensions of each anchor block as shown on Drawing No. WW/WD/874/SD/007 to suit.				
L711	Nominal bore 80mm; volume n.e 0.1 m <sup>3</sup>	nr	4.00		
L721	Nominal bore 80mm; volume 0.1 - 0.2 m <sup>3</sup>	nr	1.00		-
	CLASS X: MISCELLANEOUS WORK				
X135	Perimeter fence to Gababa EWT Compound  Provide materilas and erect precast concrete fence as per the specifications and as per Drawing  No.WW/WD/874/SD/008(a) provided	m	100		-
X222	Provide materials and fabricate a Single leaf gate size 4500x2000mm high gate as shown in Drawing No. WW/WD/874/SD/008(b)	Nr	1		-
	Page Total C/F to Bill No 2 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	Bill No.2 Collection Sheet			( /	
	Description if any				
	Description if any				
	Brought forward from page 10				
	blodgitt forward from page 10				
	Drawalst farmered from 1999 14				
	Brought forward from page 11				
	Brought forward from page 12				
	Brought forward from page 13				
	BILL No.2 TOTAL C/F TO BILLS SUMMARY SHEET				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KSh:
	BILL No.3:CONSTRUCTION OF 150m3 SECTIONAL STEEL ELEVATED WATER TANK- IJARA VOCATIONAL AND TECHNICAL TRAINING CENTRE				
	CLASS A - GENERAL ITEMS				
D100	Site Clearance				
D110.1	General clearance; removal of all bushes, grass and shrubs etc. haul distance n.e. 1km	ha	0.10		
	Testing of the Works				
D100	Site Clearance				
D100	Site clearance				
D110	General clearance; removal of all bushes, grass and shrubs etc. haul distance n.e. 1km	m <sup>2</sup>	625.00		
	EARTHWORKS				
3	Excavation for tank foundations in material other than rock, depth 0.5 - 5 m	m <sup>3</sup>	160.00		
4	Excavation for tank foundations in rock, depth 2 - 5 m	m <sup>3</sup>	5.00		
5	Compacted filling to foundations with selected excavated material other than topsoil or rock	m <sup>3</sup>	60.00		
	INSITU CONCRETE				
6	150 m <sup>3</sup> 10 m high Elevated Water Tank reinforced concrete Class 25 foundation bases and stub columns complete with all reinforcement. Rate to include provision and placing of the concrete including formwork, shoring etc.	Sum	1.00		
	FITTINGS AND VALVES				
7	Supply and install DN 100 Flanged GI Class C inlet pipework complete as shown on the Drawings including ball float, with flanges to BS4504. The pipework to terminate at the tank inlet chamber	М	18.00		
8	Supply and install ND 100 Flanged GI Class C outlet pipework complete as shown on the Drawings . The pipework to terminate at the outlet chamber	m	12.00		
9	Supply and install ND 100 GI Class C overflow with bellmouth and ND 100 Flanged GI Class C drainage pipework including. gate valve complete as shown on the Drawings The pipework to terminate at the overflow chamber.	Sum	1.00		
	STRUCTURAL STEEL WORK				
10	Design to BS449, fabricate, and supply ex-works 10m high steel structure tower designed to take sectional steel tank 150 m3 capacity when full of water. Tower to standard finish of 1 coat zinc chromate primer backed by 2 coats of aluminium paint.	nr	1.00		
	Page Total C/F to Bill No 3 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	Design to BS1564, fabricate, and supply ex-works pressed				
11	water steel tank 150 m <sup>3</sup> capacity when full of water complete with roof cover, level indicator, access covers and vent. Tank to standard finish of 1 coat of primer and 2 coats of non-toxic bituminous	nr	1.00		
12	Transport to site and erect the tank tower and assemble on the tower 150 m3 pressed steel tank complete with access ladders, walkway and handrailing, access cover and roof vent.	Sum	1.00		
13	Fabricate, supply ex-works 1 m wide walkway with 1.2 m high railings. Walkway to standard finish 1 coat zinc chromate primer backed by 2 coats aluminium paint.	nr	1.00		
14	Fabricate, supply ex-works internal access ladder. Ladder to standard finish 1 coat primer and 2 coats non-toxic bituminous paint.	nr	1.00		
15	Fabricate, supply ex-works external access ladder with safety hoops. Ladders to standard finish 1 coat zinc chromate primer backed by 2 coats aluminium paint.	nr	1.00		
16	SITE WORKS  Overflow masonry collection chamber complete as shown on the drawings with cover depth 1.5 - 2.0m	nr	1.00		
17	Tank Outlet masonry chamber complete as shown on the drawings with cover depth 1.5 - 2.0m	nr	1.00		
18	Provide and erect precast concrete fencing posts as per the specifications and as per Drawing No.WW/WD/874/SD/008(a) provided. Rate to include providing and fixing GI chain link mesh GI staples (including the cost of GI staples,line wire, earthwork, concrete,struts, steel binding wire etc - 4mm (10.5swg) x 50mm)	m	100		
X222	Provide materials and fabricate a Single leaf gate size	Nr	1		
	Page Total C/F to Bill No 3 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	Bill No.3 Collection Sheet		-	, ,	
	Description if any				
	Brought forward from page 15				
	Brought forward from page 16				
	BILL No.3 TOTAL C/F TO BILLS SUMMARY SHEET				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
TILIVI NO.	BILL No.4- REHABILITATION OF EXISTING TREATMENT	ONIT	QUANTITY	RATE (KSHS)	AMOUNT (KSHS)
	WORKS				
	PART 4.1 - REHABILITATION OF EXISTING COMPOSITE				
	FILTRATION UNIT GENERAL ITEMS				
	Testing and Commissioning of Treatment Plant and				
	Masonry Storage Tank as per specifications				
3CFU3.1.1	Rate to include Testing, Cleansing and Sterilisation in				
JCI 03.1.1	Accordance with Specifications				
3CFU3.1.2	225m3 Composite Flitration Unit	nr	1		
	MISCELLANEOUS WORK				
	Surface finishes on Composite Filtration Unit ( Rate to include supply of materials,hacking and brushing				
	of existing walls to the satisfaction of the Engineer )				
	20mm thick cement sand mortar screed(1:3) internal	m2	243		
3CFU3.1.4	rendering with water proof cement on walls finished				
	smooth with a steel trowel				
205112.4.5	20mm thick cement sand mortar screed(1:3) internal	m2	44		
3CFU3.1.5	rendering with water proof cement on benching				
	Joint Sealant ( Rate to include supply of materials,				
	removal and replacement of existing bondex )				
3CFU3.1.6	25mm thick bondex joint of approved material on joint	m	60		
	between external wall and benching				
3CFU3.1.7	Standard finish 1 coat primer and 2 coats non-toxic	m2	180		
301 03.1.7	bituminous paint finished surface of benching				
	Access Ladder and Walkway ( Rate to include supply of				
	materials, cutting, bending and fabrication and painting				
	).All pipe to be supplied complete with one GI plain				
	socket.				
3CFU3.1.8	Nominal bore 50mm GI pipe class B	m	36		
3CFU3.1.9	Nominal bore 20mm GI pipe class B	m	168		
	Fabricate 9m long x 900mm wide walkway with 1.1 m high	nr	1		
3CFU3.1.10	railings. Walkway to standard finish 1 coat zinc chromate				
	primer backed by 2 coats aluminium paint.				
205112 1 1 1	Fabricate and fix 1100mm guard rails on existing access	nr	2		
3CFU3.1.11	ladder as directed				
	Filter Media ( Rate to include supply , placing in filters and				
	testing as directed )				
3CFU3.1.12	Gravel effective size 38-20mm	m3	1		
	Page Total C/F to Bill No 4 Collection Sheet				
	Page Total C/F to Bill No 4 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
3CFU3.1.13	Grave effective size 20-12mm	m3	1		
3CFU3.1.14	Gravel effective size 12-5mm	m3	1		
		m3	1		
3CFU3.1.15	Gravel effective size 5-2mm		-		
3CFU3.1.16	Coarse aggregate effecitive size 1.0 mm	m3	1		
3CFU3.1.17	Sand effective size 0.5mm and uniformity coefficient 1.5	m3	1		
	Other accessories ( Supply,installation,testing and commissioning). Items to be supplied with all necessary pipework and fittings				
3CFU3.1.18	FRO Chlorine doser	nr	2		
3CFU3.1.19	FRO Aluminium Sulphate solution doser	nr	2		
3CFU3.1.20	1000 litre Fibre Glass Tropical Chloride of lime solution Tank	nr	2		
3CFU3.1.21	1000 litre Fibre Glass Aluminium Sulpahte solution Tank	nr	2		
	Site works				
	( Stone pitching as anti-erosion works)  Cost to include supply hand packing as directed by the Engineer				
3CFU3.1.24	Imported rock material laid in cement sand mortar 1:3 to form 200mm thick stone pitching	m2	150		
	PIPEWORK - FITTINGS AND VALVES (Including Supply of fittings, valves and jointing material)				
	Installation of pipe fittings in trenches or in chambers on existing mains.(Rate to include removal of existing faulty fittings)				
	Adaptors				
3CFU3.1.26	Flange Adaptor, nominal bore 100mm	nr	7		
3CFU3.1.27	Flange Adaptor, nominal bore 150mm	nr	1		
	Page Total C/F to Bill No 4 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
TILIVI NO.	Valves	ONT	QUANTITI	NATE (KSH3)	AMOUNT (KSIIS)
	valves				
		nr	3		
3CFU3.1.28	Gate Valves; nominal bore 50mm as pegler	nr	3		
3CFU3.1.29	Double flanged Sluice Valves; nominal bore 100mm	nr	7		
		nr	6		
3CFU3.1.30	Double flanged Sluice Valves; nominal bore 150mm				
	PIPEWORK - MANHOLES AND PIPEWORK ANCILLARIES.				
	Construction of chambers complete as shown on the drawings .NWSB/1/2007-2008/9 on existing and replacement mains.				
	Gate valve chambers as shown on Drawings No.				
	.NWSB/1/2007-2008/9				
3CFU3.1.31	Gate Valve chamber Type 1A with Cover Type A; depth 1.5 - 2.0 m; internal area n.e 2 m2	nr	5		
	2.0 m; internal area n.e 2 m2				
3CFU3.1.32	Gate Valve chamber Type 1B with Cover Type A; depth 1.5 -	nr	2		
JCI 03.1.32	2.0 m; internal area 4 - 5 m2				
	Reinforced concrete class 25/20 in anchor blocks				
	Remoteu Concrete class 23/20 in anchor blocks				
	Anchor blocks for pipes and Gate valves. Dimensions and reinforcement details of each anchor block as shown on Drawing NosNWSB/1/2007-2008/8				
	Drawing NosNW3B/1/2007-2008/8				
205112 4 22	Namically and 400 and address at 0.4 at 2	nr	7		
3CFU3.1.33	Nominal bore n.e 100mm; volume n.e 0.1 m3				
3CFU3.1.34	Nominal bore n.e. 150 mm; volume 0.1 - 0.2 m3	nr	6		
	MISCELLANEOUS WORK				
	Surface finishes on chambers ( Rate to include supply of				
	materials)				
3CFU3.1.35	cement sand mortar screed rendering on Gate Valve	m <sup>2</sup>	15		
	Chamber floor finished smooth with a steel trowel				
		m <sup>2</sup>	60		
3CFU3.1.36	Cement sand mortar screed rendering on internal walls of Gate Valve Chambers finished smooth with a steel trowel				
	duce valve chambers imistica smooth with a steel flower				
	Page Total C/F to Bill No 4 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
HEIVI NO.	Bill No.4 Collection Sheet	UNIT	QUANTITY	NATE (NSIIS)	AIVIOUNT (KSNS
	bii No.4 Collection Sheet				
	Description if any				
	Description if any				
	Brought forward from page 18				
	Brought forward from page 18				
	Draught famuard from page 10				
	Brought forward from page 19				
	Draught famuard from page 20				
	Brought forward from page 20				
	BILL No.4 TOTAL C/F TO BILLS SUMMARY SHEET				
	DIE HOLF TO THE GITTO DIELS SOUNIVIANT SHEET	1	<u> </u>	<u> </u>	<u>'</u>

ITEM No.	ITEM DESCRIPTION	LINUT	OLIANITITY	DATE (KChe)	ANAQUINIT /I/Chc)
HEIVI NO.	ITEM DESCRIPTION  BILL No.5-INSTITUTIONAL CAPACITY BUILDING	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	Part 5.1 RATIONALISATION OF CONSUMER CONNECTIONS				
	BILL No. 5 RATIONALISATION AND INSTALLATION OF CONSUMER CONNECTIONS				
	Testing of the Works				
	Watertightness Testing, Cleansing and Sterilisation of Pipelines in Accordance with Specifications				
5.1A260.1	15mm nominal bore consumer connections HDPE pipes	m	5,000		
5.1A260.2	20 mm nominal bore consumer connections HDPE pipes	m	3,320		
5.1A260.3	25 mm nominal bore consumer connections HDPE pipes	m	1,680		
	CLASS D: DEMOLITION AND SITE CLEARANCE				
5.1D5.10	General clearance; width n.e. 2 metre on either side of center line for laying of pipelines.	ha	12.8		
	Cutting of trees, removal of stumps with holes backfilled with excavated material				
5.1D25.1	Tree girth 500mm - 1m	nr	20		
5.1D220	Tree girth 1 - 2m	nr	5		
	SUPPLY OF CONNECTIONS PIPES AND FITTINGS ( Supply Only)				
	Includes delivery to site. Remaining materials at the end of the works to be handed over to the employer for future connections				
	NP 10 High Density Polyethylene (HDPE) connections pipes to DIN8074				
5.11711.1	Nominal bore 15 mm, HDPE	m	5,000		
5.11711.2	Nominal bore 20 mm, HDPE	m	3,320		
5.11711.2	Nominal bore 25 mm, HDPE	m	1,680		
J.11/11.2	PVC pipe connections Tapping Saddle Clamps		1,080		
5.1 391.1	63 mm PVC pipe Tapping Saddle Clamps for 15 mm HDPE connection	nr	375		
5.1 391.2	80 mm PVC pipe Tapping Saddle Clamps for 15 mm HDPE connection	nr	250		
5.1 391.3	110 mm PVC pipe Tapping Saddle Clamps for 15 mm HDPE connection	nr	125		
5.1 5.112	63 mm PVC pipe Tapping Saddle Clamps for 20 mm HDPE connection	nr	250		
	Page Total C/F to Bill No 5 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
5.11391.5.1	80 mm PVC pipe Tapping Saddle Clamps for 20 mm HDPE	nr	164	. ,	, -,
	connection				
5.11391.6	110 mm PVC pipe Tapping Saddle Clamps for 20 mm HDPE connection	nr	84		
5.11391.9	80 mm PVC pipe Tapping Saddle Clamps for 25 mm HDPE connection	nr	109		
5.11391.5.1	110 mm PVC pipe Tapping Saddle Clamps for 25 mm HDPE connection	nr	143		
	HDPE Outlet Type Tapping Swilel Ferrule for Connections				
5.11391.22	15 mm HDPE connection Tapping Ferrule	nr	825		
5.11391.23	20 mm HDPE connection Tapping Ferrule	nr	548		
5.11391.24	25 mm HDPE connection Tapping Ferrule	nr	277		
	NEW CONSUMER CONNECTIONS (Construction Only)				
	Take delivery of materials, construct new consumers connections length n.e 20 m as detailed on the drawings, and prepare records of the connections as detailed in Special Specifications Clause SS.874B.05 where directed by the Engineer. Rate to include main tapping, fixing of connection pipe, meter and fittings, excavations, backfilling and reinstatement.				
5.11912.1	Nominal bore 15 mm, new consumer connections from PVC	nr	250		
5.11912.2	Nominal bore 20 mm, new consumer connections from PVC	nr	166		
5.11912.3	Nominal bore 25 mm, new consumer connections from PVC	nr	84		
	RATIONALISATION OF EXISTING CONSUMER CONNECTIONS (Construction Only)				
	Take delivery of materials, search and rationalise existing spaghetti or multiple consumers connections length n.e 20m as detailed on the drawings, and prepare records of the connections as detailed in Special Specifications Clause SS.874B.05 where directed by the Engineer. Rate to include disconnection of existing connection(s), main tapping, excavations and backfilling and fixing of connection pipe and fittings.				
5.11912.4	Nominal bore 15 mm, new consumer connections from PVC or steel mains	nr	500		
5.11912.4	Nominal bore 20 mm, new consumer connections from PVC or steel mains	nr	332		
5.11912.4	Nominal bore 25 mm, new consumer connections from PVC or steel mains	nr	168		
	Page Total C/F to Bill No 5 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	CONSUMER METER REPLACEMENT IN EXISTING				
	CONNECTIONS (Construction Only)				
	Take delivery of materials, replace defective stop valve and				
	meter consumers on existing connections as detailed on				
	the drawings, and prepare records of the connections as				
	detailed in Special Specifications Clause SS.874B.05 where				
	directed by the Engineer. Rate to include searching of the				
	existing connection(s), excavations and backfilling and				
	fixing of connection pipe and fittings. All removed materials to be delivered to the DWO.				
	materials to be delivered to the DWO.				
5.11311.1	Nominal bore 15 mm, exsiting consumer connections	nr	1,336		
5.1 311.2	Nominal bore 20 mm, existing consumer connections	nr	592		
5.11511.2	Nothinal bore 20 min, existing consumer connections	nr	392		
5.11311.3	Nominal bore 25 mm, existing consumer connections	nr	38		
				,	
	Page Total C/F to Bill No 5 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	Bill No.5 Collection Sheet	0	ζον	(	7
	Description if any				
	,				
	Brought forward from page 22				
	broagne for ward from page 22				
	Brought forward from page 23				
	Drought for ward from page 25				
	Brought forward from page 24				
	brought forward from page 24				
	BILL No.5 TOTAL C/F TO BILLS SUMMARY SHEET				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	BILL No. 6 -REHABILITATION OF EXISTING ELEVATED		<u> </u>		· · · · · · · · · · · · · · · · · · ·
	STEEL WATER TANKS				
	PART 6.1-REPLACEMENT OF ELEVATED STEEL WATER				
	TANK			+	
	- 150 m <sup>3</sup> GUMERAY ELEVATED SECTIONAL WATER TANK				
	(TANK ARRANGEMENT 7x7x3)				
	CLASS A: GENERAL ITEMS				
	SPECIFIED REQUIREMENTS				
A211.0	Allow for mobilisation to site	sum	1		
	Testing of the Works				
A260	Watertightness Testing, Cleansing, Sterilization and	No.	1		_
71200	commissioning of 150 m <sup>3</sup> Elevated Tank	110.			
	CLASS D: DEMOLITION AND SITE CLEARANCE				
	CLASS D. DEMOLITION AND SITE CLEARANCE				
D100	General site clearance of Tank Area	m <sup>2</sup>	625		-
	Remove old tank panels from the 10m high tank tower to				
D100.1	a designated area within the water supply treatment	sum	1		-
	works,average distance 1.5km				
	CLASS J: FITTINGS AND VALVES				
	Tank Exposed Pipework				
	( The rates inserted here shall include for				
	supply,delivery,installatiob and all the necessary jointing materials)				
	in account of				
J351	Flange Adaptor, nominal bore 150mm	nr	1		-
J831	Ball Valve; nominal bore 150mm	nr	1		-
1202.4	Supply and install DN150 steel inlet pipework with flanges	Na	4		
J382.1	to BS4504. The pipework to be connected to the existing inlet next to tank	No.	1		-
	met next to tank				-
	Supply and install DN150 steel outlet pipework with				
J382.2	flanges to BS4504. The pipework to be connected to the	No.	1		-
	existing distribution line at the ground.				
	Supply and install DN 150 steel overflow with bellmouth				-
	and DN 100 drainage pipework including gate valve with				
J383	flanges to BS4504. The pipework to terminate at the	No.	1		-
	overflow chamber				
	CLASS M: STRUCTURAL STEELWORK				
	-				
	Panels and Auxiliaries				
M490.1	Wire brush tank tower and apply 2 coats aluminium paint.	No.	1		
	Page Total C/F to Bill No 6 Part 6.1 Collection Sheet				

ITENAN-	ITEM DESCRIPTION	LINUT	OLIANITITY	DATE (VCF-)	AMOUNT (VCL.)
ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
M490.2	Design to BS1564, fabricate, and supply ex-works replacement pressed steel water tank panels 150 m <sup>3</sup> capacity when full of water complete with roof cover, reflective level indicator, access covers and vent to fit into the existing 10m high steel structure tower. Tank internal painting to standard finish of 1 coat of primer and 2 coats of non-toxic bituminous and external finish three coats of paint; 1 coat zinc chromate primer backed by 2 coats of aluminium paint.	No.	1		-
M799	Transport to site and assemble on the tower 150 m <sup>3</sup> pressed steel tank replacement panels complete with access cover and roof vent.	No.	1		-
N120.1	Carry out minor rehabilitation works on 1 m wide walkway with 1.2 m high railings. Walkway to standard finish 2 coats of aluminium paint. (The works to include the following)	No.	1		-
	a).Making good the existing handrail all around the walkway     b).Making good all the supporting brackets under the				
	walkway  c).Replacing all the missing fasteners				
N130.1	Fabricate, supply ex-works internal access ladder. Ladder to standard finish 1 coat primer and 2 coats non-toxic bituminous paint.	No.	1		-
N130.2	Fabricate, supply ex-works external access ladder with safety hoops (Excluding the 10m Tower Section). Ladders to standard finish 1 coat zinc chromate primer backed by 2 coats aluminium paint.	No.	1		-
	Page Total C/F to Bill No 6 Part 6.1 Collection Sheet				
	I .	L		<u> </u>	l .

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	BILL No 6 : Part 6.1 Collection Sheet				
	DESCRIPTION (if any)				
	Brought forward from page 26				-
	Brought forward from page 27				-
	Part 6.1 Collection Sheet Total C/F to Bill No. 6 Summary				-
	Sheet	]			]

ITEM No.	ITEM DESCRIPTION	LINIT	QUANTITY	DVIE (Norve)	ANAOLINIT (VCha)
HEIVI NO.	PART 6.2-REPLACEMENT OF ELEVATED STEEL WATER	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	TANK				
	- 150 m <sup>3</sup> IDD GROUND ELEVATED SECTIONAL WATER				
	TANK (TANK ARRANGEMENT 7x7x3)				
	CLASS A: GENERAL ITEMS				
	SPECIFIED REQUIREMENTS				
A211.0	Allow for mobilisation to site	sum	1		_
71211.0	/ How for Hoshisution to site	Juin	<u> </u>		
	Testing of the Works				
	Watertightness Testing, Cleansing, Sterilization and				
A260	commissioning of 150 m <sup>3</sup> Elevated Tank	No.	1		-
	CLASS D: DEMOLITION AND SITE CLEARANCE				
D100	General site clearance of Tank Area	m <sup>2</sup>	625		_
D100	General site dedicance of Talik Area	111	023		
	Remove old tank panels from the 10m high tank tower to				
D100.1	a designated area within the water supply treatment works, average distance 1.5km	sum	1		-
	works, average distance 1.5km				
	CLASS J: FITTINGS AND VALVES				
	Tool Succeed States of				
	Tank Exposed Pipework (The rates inserted here shall include for				
	supply,delivery,installatiob and all the necessary jointing				
	materials)				
J351	Flange Adaptor, nominal bore 150mm	nr	1		_
J831	Ball Valve; nominal bore 150mm	nr	1		-
	Supply and install DN150 steel inlet pipework with flanges				
J382.1	to BS4504. The pipework to be connected to the existing inlet next to tank	No.	1		-
	INCLUDING TO WITH				-
	Supply and install DN150 steel outlet pipework with				
J382.2	flanges to BS4504. The pipework to be connected to the existing distribution line at the ground.	No.	1		-
	existing distribution line at the ground.				-
	Supply and install DN 150 steel overflow with bellmouth				
J383	and DN 100 drainage pipework including gate valve with	No.	1		-
	flanges to BS4504. The pipework to terminate at the overflow chamber				
	CLASS M: STRUCTURAL STEELWORK				
	Panels and Auxiliaries				
M490.1	Wire brush tank tower and apply 2 coats aluminium paint.	No.	1		-
	Design to BS1564, fabricate, and supply ex-works				
	replacement pressed steel water tank panels 150 m <sup>3</sup>				
	capacity when full of water complete with roof cover,				
M490.2	reflective level indicator, access covers and vent to fit into	No	1		
101490.2	the existing 10m high steel structure tower. Tank internal painting to standard finish of 1 coat of primer and 2 coats	No.	1		_
	of non-toxic bituminous and external finish three coats of				
	paint; 1 coat zinc chromate primer backed by 2 coats of				
	aluminium paint.				
	Page Total C/F to Bill No 6 Part 6.2 Collection Sheet				-

NWWDA

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
M799	Transport to site and assemble on the tower 150 m <sup>3</sup> pressed steel tank replacement panels complete with access cover and roof vent.	No.	1		-
N120.1	Carry out minor rehabilitation works on 1 m wide walkway with 1.2 m high railings. Walkway to standard finish 2 coats of aluminium paint. (The works to include the following)  a). Making good the existing handrail all around the	No.	1		-
	walkway b).Making good all the supporting brackets under the walkway				
	c).Replacing all the missing fasteners				
N130.1	Fabricate, supply ex-works internal access ladder. Ladder to standard finish 1 coat primer and 2 coats non-toxic bituminous paint.	No.	1		-
N130.2	Fabricate, supply ex-works external access ladder with safety hoops (Excluding the 10m Tower Section). Ladders to standard finish 1 coat zinc chromate primer backed by 2 coats aluminium paint.	No.	1		-
	Page Total C/F to Bill No 6 Part 6.2 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	BILL No 6 : Part 6.2 Collection Sheet				, 3,0,
	DESCRIPTION (if any)				
	Brought forward from page 29				-
	Brought forward from page 30				-
	Doub C 2 Collection Check Tatal C/F to Bill No. C Co.				
	Part 6.2 Collection Sheet Total C/F to Bill No. 6 Summary Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	PART 6.3-REPLACEMENT OF ELEVATED STEEL WATER				
	TANK				
	- 150 m <sup>3</sup> EXISTING TREATMENT WORKS ELEVATED				
	SECTIONAL WATER TANK (TANK ARRANGEMENT 10x7x3)				
	CLASS A: GENERAL ITEMS				
	SPECIFIED REQUIREMENTS				
1A211.0	Allow for mobilisation to site	sum	1		
IAZII.U	Allow for mobilisation to site	Juili	1		
	Testing of the Works				
	Watertightness Testing, Cleansing, Sterilization and				
A260	commissioning of 150 m <sup>3</sup> Elevated Tank	No.	1		-
	CLASS D: DEMOLITION AND SITE CLEARANCE				
D100	General site clearance of Tank Area	m <sup>2</sup>	0		-
D100.1	Remove old tank panels from the 10m high tank tower to a designated area within the water supply treatment	sum	1		_
	works,average distance 100m				
	CLASS J: FITTINGS AND VALVES				
	CEASS STITINGS AND VALVES				
	Tank Exposed Pipework				
	(The rates inserted here shall include for				
	supply,delivery,installation and all the necessary jointing materials)				
J351	Flange Adaptor, nominal bore 150mm	nr	1		-
J831	Ball Valve; nominal bore 150mm  Supply and install DN150 steel inlet pipework with flanges	nr	1		-
J382.1	to BS4504. The pipework to be connected to the existing inlet next to tank	No.	1		-
	Supply and install DN150 steel outlet pipework with				-
J382.2	flanges to BS4504. The pipework to be connected to the	No.	0		-
	existing distribution line at the ground.				
	Supply and install DN 150 steel overflow with bellmouth				<del>-</del>
J383	and DN 100 drainage pipework including gate valve with	No.	1		_
1303	flanges to BS4504. The pipework to terminate at the	110.	-		
	overflow chamber				
	CLASS M: STRUCTURAL STEELWORK				
	Panels and Auxiliaries				
M490.1	Wire brush tank tower and apply 2 coats aluminium paint.	No.	1		-
	Page Total C/F to Bill No 6 Part 6.3 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
M490.2	Design to BS1564, fabricate, and supply ex-works replacement pressed steel water tank panels 150 m <sup>3</sup> capacity when full of water complete with roof cover, reflective level indicator, access covers and vent to fit into the existing 10m high steel structure tower. Tank internal painting to standard finish of 1 coat of primer and 2 coats of non-toxic bituminous and external finish three coats of paint; 1 coat zinc chromate primer backed by 2 coats of aluminium paint.	No.	1		-
M799	Transport to site and assemble on the tower 150 m <sup>3</sup> pressed steel tank replacement panels complete with access cover and roof vent.	No.	1		-
N120.1	Carry out minor rehabilitation works on 1 m wide walkway with 1.2 m high railings. Walkway to standard finish 2 coats of aluminium paint. (The works to include the following)	No.	1		-
	a). Making good the existing handrail all around the walkway				
	b). Making good all the supporting brackets under the walkway				
N130.1	Fabricate, supply ex-works internal access ladder. Ladder to standard finish 1 coat primer and 2 coats non-toxic bituminous paint.	No.	1		-
	Page Total C/F to Bill No 6 Part 6.3 Collection Sheet				
	rage rotal C/r to bill NO 6 Part 6.5 Collection Sheet	L	<u> </u>		

ITEM No.	BILL No 6 : Part 6.3 Collection Sheet	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
				1	
	DESCRIPTION (if any)				
	Brought forward from page 32				-
	Brought forward from page 33				-
	Part 6.3 Collection Sheet Total C/F to Bill No. 6 Summary				
	Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	PART 6.4-REPLACEMENT OF ELEVATED STEEL WATER TANK				•
	- 100 m <sup>3</sup> EXISTING MANYATTA DUALE ELEVATED SECTIONAL WATER TANK (TANK ARRANGEMENT 5x5x3)				
	CLASS A: GENERAL ITEMS				
	SPECIFIED REQUIREMENTS				
A211.0	Allow for mobilisation to site	sum	1		-
	Testing of the Works				
A260	Watertightness Testing, Cleansing, Sterilization and commissioning of 100 m <sup>3</sup> Elevated Tank	No.	1		-
	CLASS D: DEMOLITION AND SITE CLEARANCE				
D100	General site clearance of Tank Area	m <sup>2</sup>	625		-
D100.1	Remove old tank panels from the 10m high tank tower to a designated area within the water supply treatment works, average distance 1.5km	sum	1		-
	CLASS J: FITTINGS AND VALVES				
	Tank Exposed Pipework  ( The rates inserted here shall include for supply,delivery,installatiob and all the necessary jointing materials)				
J351	Flange Adaptor, nominal bore 100mm	nr	1		
J831	Ball Valve; nominal bore 100mm	nr	1		
J382.1	Supply and install DN100 steel inlet pipework with flanges to BS4504. The pipework to be connected to the existing inlet next to tank	No.	1		-
J382.2	Supply and install DN100 steel outlet pipework with flanges to BS4504. The pipework to be connected to the existing distribution line at the ground.	No.	1		-
J383	Supply and install DN 100 steel overflow with bellmouth and DN 100 drainage pipework including gate valve with flanges to BS4504. The pipework to terminate at the overflow chamber	No.	1		-
	CLASS M: STRUCTURAL STEELWORK				
	Panels and Auxiliaries				
M490.1	Wire brush tank tower and apply 2 coats aluminium paint.	No.	1		-
	Page Total C/F to Bill No 6 Part 6.3 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
M490.2	Design to BS1564, fabricate, and supply ex-works replacement pressed steel water tank panels 100 m <sup>3</sup> capacity when full of water complete with roof cover, reflective level indicator, access covers and vent to fit into the existing 10m high steel structure tower. Tank internal painting to standard finish of 1 coat of primer and 2 coats of non-toxic bituminous and external finish three coats of paint; 1 coat zinc chromate primer backed by 2 coats of aluminium paint.	No.	1		-
M799	Transport to site and assemble on the tower 100 m <sup>3</sup> pressed steel tank replacement panels complete with access cover and roof vent.	No.	1		-
N120.1	Carry out minor rehabilitation works on 1 m wide walkway with 1.2 m high railings. Walkway to standard finish 2 coats of aluminium paint. (The works to include the following)	No.	1		-
	a). Making good the existing handrail all around the walkway b). Making good all the supporting brackets under the walkway				
	c).Replacing all the missing fasteners				
N130.1	Fabricate, supply ex-works internal access ladder. Ladder to standard finish 1 coat primer and 2 coats non-toxic bituminous paint.	No.	1		-
	Page Total C/F to Bill No 6 Part 6.4 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	BILL No 6 : Part 6.4 Collection Sheet			, ,	,
	DESCRIPTION (if any)				
	Brought forward from page 35				-
	Brought forward from page 36				-
	Day C 4 O. H. Was Charter 1 O. T. 1 O. T. 1 O. T. 1				
	Part 6.4 Collection Sheet Total C/F to Bill No. 6 Summary Sheet				
	Sileet			<u> </u>	<u> </u>

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	BILL No 6 : SUMMARY SHEET				
	DESCRIPTION (if any)				
	Part 6.1 Collection Sheet Total B/F from page 28				-
	Death C. 2 Cellestine Chart Tabel D/F from a case 24				
	Part 6.2 Collection Sheet Total B/F from page 31				-
	Part 6.3 Collection Sheet Total B/F from page 34				
	Tart 0.5 concetton sheet rotal by monipage 54				
	Part 6.4 Collection Sheet Total B/F from page 37				_
	+				
	_				
	_				
	+				
	BILL No.6 TOTAL C/F TO BILLS SUMMARY SHEE	T			-

BILL NO.7: IMPROVEMENT OF MASALANI WATER SUPPLY EXTING FACILITIES  PART 7.1 INTAKE WORKS STATION  CONSTRUCTION OF INTAKE STATION FERMINTER FENCE AND GATE  Provide and erect precast concrete fencing posts as per the specifications and Drawing No. WW/ND/S74/S50/008(a) provided. Rate to include, find-unding did chain link mesh di staples (including the cost of di staples, line wire, earthwork, concrete, struts, steel binding wire etc.  2222 ASDOCADOmm high including 1000-2000mm pedestrian gate as shown in Drawing No. WW/ND/874/S0/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E-8300 E-8311 Topsoil depth n.e. 0.25 m m³ 3.00   E-8312 Topsoils maximum depth 0.25 -0.5 m m³ 3.00   E-8313 Topsoil depth n.e. 0.25 m m³ 3.00   E-8314 Topsoil depth n.e. 0.25 m m³ 3.00   E-8315 Topsoil distance of haul n.e. 1.5 km m³ 5.50   E-8316 Disposal of excavated material  E-831 Topsoil distance of haul n.e. 1.5 km m³ 5.50   E-832 Selected imported material for hardcore m³ 70.00   CLASS F: IN SITU CONCRETE  Provide materials and mix concrete to the specified class; command and concrete to the specified class; concrete material for hardcore m³ 1.50   Placing of Concrete  Provide materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and mix concrete to the specified class; concrete materials and prinths; thickness 150 - m³ 1.50   Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure so per details on drawings.  Reinforced Concrete; Class 25/20   Page Total C/F to Bill No 7 Part 7.1 Collection Sheet	ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
PART 71. INTAKE WORKS STATION CONSTRUCTION OF INTAKE STATION PERIMETER FENCE AND GATE Provide and erect precast concrete fending posts as per the specifications and Drawing No. WW/WD/874/SD/008(a) provided. Rate to including Chain link mesh GI staples (including the cost of GI staples, line wire, earthwork, concrete, struts, steel binding wire etc  Provide materials and fabricate a bouble leaf gate size as shown in Drawing No. WW/WD/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E:EARTHWORKS  CLASS E:EARTHWORKS  Excavation for foundations					. ,	
CONSTRUCTION OF INTAKE STATION PERIMETER FENCE AND GATE Provide and erect precast concrete fending posts as per the specifications and Drawing No. WWW/W/978/150/008(a) provided. Rate to include providing and fixing. Gi chain link end is staples (including the cost of Gi staples, line wire, earthwork, concrete-struts, steel binding wire etc  Provide materials and fabricate a Double leaf gate size 4500x2000mm high including 10.00x2000mm pedestrian gate as shown in Drawing No. WW/W0/874/50/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E300 Excavation for foundations  E311 Topsoil: depth n.e. 0.25 m m³ 3.00  E322 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m  E530 Disposal of excavated material  Disposal of excavated material  F531 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E600 Filling  E617 Selected imported material for hardcore  Provision of Concrete  Provision of Concrete  Provision of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete (Increte) in the following elements of the structure as per details on drawings.  Reinforced Concrete (Increte) in the following elements of the structure as per details on drawi						
AND GATE Provide and erect precast concrete fending posts as per the specifications and Drawing No.WWW.WD/874/SD/008(a) provided. Rate to included. Rate to include a providing and thing Gi chain link mesh Gi stables (including the cost of Gi staples, line wire, earthwork, concrete, struts, steel binding wire etc  X222 Provide materials and fabricate a Double leaf gate size 4500x2000mm high including 1000x2000mm pedestrian gate as shown in Drawing No. WW/WD/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E300 Exavation for foundations  E311 Topsoil; depth n.e. 0.25 m						
the specifications and Drawing No.WW/ND/874/SD/008(a)  2						
provided. Rate to include providing and fixing is of chain link earthwork, concrete, struts, steel binding wire etc.  Provide materials and fabricate a bouble leaf gate size 4500x2000mm high including 1000x2000mm pedestrian gate as shown in Drawing No. WW/WD/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E300 Excavation for foundations  F311 Topsoil; depth n.e. 0.25 m m³ 3.00  - Topsoil; depth n.e. 0.25 m m³ 3.00  - Topsoil; depth n.e. 0.25 m m³ 3.00  - Topsoil; maximum depth 0.25 - 0.5 m m³ 3.00  - Topsoil; maximum depth 0.25 - Topsoil; maximum depth 0.25 - 0.5 m m³ 3.00  - Topsoil; maximum depth 0.25 - 0.5 m m³ 3.00  - Topsoil; maximum depth 0.25 - 0.5 m m³ 3.00  - Topsoil; maximum depth 0.25 - Topsoil; maximum depth 0.25 - Topsoil; maximum depth 0.25 - Topsoil; maximum depth 0.2						
mesh Gi staples (including the cost of Gi staples, line wire, earthwork, concrete, struts, steel binding wire etc  Provide materials and fabricate a Double leaf gate size 4500x2000mm high including 1000x2000mm pedestrian gate as shown in Drawing No. WW/WO/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m² 3.00  E312 Topsoil; depth n.e. 0.25 m m³ 3.00  E313 Topsoil; depth n.e. 0.25 m m³ 3.00  E314 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E315 Topsoil; maximum depth 0.5 - 1m m³ 5.50 m³ 5.50  E530 Disposal of excavated material maximum depth 0.5 - 1m m³ 5.50 m³ 5.50  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E607 Filling  E617 Selected imported material for hardcore m³ 70.00  CLASS F: IN SITU CONCRETE  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 1.46  F253 Design mix; Grade C25/20 m³ 12.00  Place, wibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete: Class 25/20 m³ 10.00  E662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50						
earthwork, concrete, struts, steel binding wire etc  Provide materials and fabricate a Double leaf gate size  8222 450x2000mm high including 1000x2000mm pedestrian gate as shown in Drawing No. WW/WD/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E300 Excavation for foundations  E311 Topsoil, depth n.e. 0.25 m m³ 3.00  E312 Topsoil, maximum depth 0.25 - 0.5m m³ 3.00  E313 Topsoil, maximum depth 0.25 - 0.5m m³ 1.50  E323 Materials other than topsoil, rock or artificial hard material m3 m3 1.50  E331 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E331 Topsoil distance of haul n.e. 1.5 km m³ 5.50  CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class, crement to 85 12 or 85 146  F253 Design mix, Grade C25/20 m³ 12.00  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F322 Bases, flootings, ground slabs and plinths; thickness 150 - m³ 1.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	X135		m	120.00		-
concrete, struts, steel binding wire etc  Provide materials and fabricate a Double leaf gate size 4500x2000mm high including, 1000x2000mm pedestrian gate as shown in Drawing No. WW/WIO/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E-EARTHWORKS  E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m						
Provide materials and fabricate a Double leaf gate size 4500x2000mm high including 1000x2000mm pedestrian gate as shown in Drawing No. WW/WD/874/SD/008(b)  CONSTRUCTION OF INTAKE STATION GUARD HOUSE  CLASS E:EARTHWORKS  E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m³ 3.00 - E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00 - E313 Topsoil; maximum depth 0.5 - 1.5m m³ 1.50 - E323 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1.5m m² 1.50 - E530 Disposal excavated material maximum depth 0.5 - 1.5m m³ 5.50 - E600 Filling  E617 Selected imported material for hardcore m³ 70.00 - CLASS F: IN SITU CONCRETE  Provision of Concrete  Provision of Concrete Provision of Concrete Provision of Concrete Place, vibrate and cure concrete to the specified class; cement to 85 12 or 85 146  F253 Design mix; Grade C25/20 m³ 12.00 - Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, Tootings, ground slabs and plinths; thickness 150 - 300mm n³ 1.50 - F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 -						
### According to the provided material for hardcore ### According to the structure as per details and mix concrete to the specified classycement to 85 12 or 85 146  ### Provided materials and mix concrete to the specified classycement to 85 12 or 65 120 or 67 1200 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 120 or 67 200 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 124 0r 600 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 124 0r 65 120 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 124 0r 65 124 0r 65 124 0r 65 125 0r 65 126 0r 65 125 0r 65 126 0r 65 125 0r 65 126 0r 65						
### According to the provided material for hardcore ### According to the structure as per details and mix concrete to the specified classycement to 85 12 or 85 146  ### Provided materials and mix concrete to the specified classycement to 85 12 or 65 120 or 67 1200 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 120 or 67 200 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 124 0r 600 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 124 0r 65 120 mm  ### Provided material and mix concrete to the specified classycement to 85 12 or 65 124 0r 65 124 0r 65 124 0r 65 125 0r 65 126 0r 65 125 0r 65 126 0r 65 125 0r 65 126 0r 65		Provide materials and fabricate a Double leaf gate size				
CLASS E: EARTHWORKS  E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m³ 3.00 E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00 E313 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1 m m³ 1.50 E330 Disposal of excavated material E331 Topsoil distance of haul n.e. 1.5 km m³ 5.50 E600 Filling  E617 Selected imported material for hardcore m³ 70.00 CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified classicement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 m³ 10.00 F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	X222	=	Nr	1.00		-
CLASS E:EARTHWORKS  E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m³ 3.00  E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E323 Materials other than topsoil, rock or artificial hard material m³ 1.50  E330 Disposal of excavated material  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E600 Filling  E617 Selected imported material for hardcore m³ 70.00  CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to 85 12 or 85 146  F253 Design mix; Grade C25/20 m³ 12.00  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 · 0.1m² m³ 1.50		gate as shown in Drawing No. WW/WD/874/SD/008(b)				
CLASS E:EARTHWORKS  E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m³ 3.00  E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E323 Materials other than topsoil, rock or artificial hard material m³ 1.50  E330 Disposal of excavated material  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E600 Filling  E617 Selected imported material for hardcore m³ 70.00  CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to 85 12 or 85 146  F253 Design mix; Grade C25/20 m³ 12.00  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 · 0.1m² m³ 1.50						
E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m³ 3.00  E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E323 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m m³ 1.50  E323 Disposal of excavated material m³ 1.50  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E600 Filling		CONSTRUCTION OF INTAKE STATION GUARD HOUSE				
E300 Excavation for foundations  E311 Topsoil; depth n.e. 0.25 m m³ 3.00  E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00  E323 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m m³ 1.50  E323 Disposal of excavated material m³ 1.50  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50  E600 Filling						
E311 Topsoil; depth n.e. 0.25 m m³ 3.00		CLASS E:EARTHWORKS				
E311 Topsoil; depth n.e. 0.25 m m³ 3.00						
E312 Topsoil; maximum depth 0.25 - 0.5m	E300	Excavation for foundations				
E312 Topsoil; maximum depth 0.25 - 0.5m m³ 3.00 -  E323 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m 1.50 -  E530 Disposal of excavated material m³ 1.50 -  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50 -  E600 Filling -  E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE -  Provision of Concrete -  Provide materials and mix concrete to the specified class; cement to B5 12 or B5 146 -  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete -  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20 m³ 10.00 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 -	E311	Topsoil; depth n.e. 0.25 m	m <sup>3</sup>	3.00		-
Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m  E530 Disposal of excavated material  E531 Topsoil distance of haul n.e. 1.5 km  E600 Filling  E617 Selected imported material for hardcore  CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  - F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50  - 1.50						-
E323 Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m  E530 Disposal of excavated material  E531 Topsoil distance of haul n.e. 1.5 km  E600 Filling  E617 Selected imported material for hardcore  CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50  - 1.50  - 1.50  - 1.50  - 1.50  - 1.50  - 1.50  - 1.50  - 1.50  - 1.50  - 1.50	E312	Topsoil; maximum depth 0.25 - 0.5m	m <sup>3</sup>	3.00		-
E530 Disposal of excavated material  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50 -  E600 Filling  E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50		Materials other than tensoil rock or artificial hard material				-
E530 Disposal of excavated material  E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50 -  E600 Filling  E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 m³ 10.00 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 -	E323		m³	1.50		-
E531 Topsoil distance of haul n.e. 1.5 km m³ 5.50 -  E600 Filling  E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50 -						
E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to Bs 12 or Bs 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	E530	Disposal of excavated material				
E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to Bs 12 or Bs 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	EE21	Toncoil dictance of hauling 1.5 km	3	E E0		-
E617 Selected imported material for hardcore m³ 70.00 -  CLASS F: IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	L331	Topson distance of flaul fi.e. 1.5 km	m	3.30		
CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	E600	Filling				
CLASS F : IN SITU CONCRETE  Provision of Concrete  Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50			2			
Provision of Concrete  Provide materials and mix concrete to the specified class; cement to Bs 12 or Bs 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50	E617	Selected imported material for hardcore	m³	70.00		-
Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50		CLASS F : IN SITU CONCRETE				
Provide materials and mix concrete to the specified class; cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50						
class;cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50		Provision of Concrete				
class;cement to BS 12 or BS 146  F253 Design mix; Grade C25/20 m³ 12.00 -  Placing of Concrete  Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm m³ 10.00 -  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50		Provide materials and mix concrete to the specified				
Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50 -		·				
Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50 -			2			
Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  **Reinforced Concrete; Class 25/20**  **Bases, footings, ground slabs and plinths; thickness 150 - 300mm*  **F662**  **200x200mm ring beam , cross sectional area 0.03 - 0.1m²*  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **T	F253	Design mix; Grade C25/20	m³	12.00		-
Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.  **Reinforced Concrete; Class 25/20**  **Bases, footings, ground slabs and plinths; thickness 150 - 300mm*  **F662**  **200x200mm ring beam , cross sectional area 0.03 - 0.1m²*  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the following elements of the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **Total concrete in the structure as per details on drawings.  **T		Placing of Concrete				
of the structure as per details on drawings.  Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50  -						
Reinforced Concrete; Class 25/20  F722 Bases, footings, ground slabs and plinths; thickness 150 - 300mm  F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50  -						
F722 Bases, footings, ground slabs and plinths; thickness 150 - m³ 10.00 - F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50		of the structure as per details on drawings.				
F722 Bases, footings, ground slabs and plinths; thickness 150 - m³ 10.00 - F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m² m³ 1.50		Reinforced Concrete; Class 25/20				
F/22 300mm						
F662 200x200mm ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup> m <sup>3</sup> 1.50 -	F722		$m^3$	10.00		-
		30011111				-
	ECCO	200v200mm ring hoom areas scational area 0.03 0.42	3	1 50		
Page Total C/F to Bill No 7 Part 7.1 Collection Sheet	r002	zooxzoomini ring beam , cross sectional area 0.03 - 0.1m	m	1.50		-
Page Total C/F to Bill No 7 Part 7.1 Collection Sheet		-				
Page Total C/F to Bill No 7 Part 7.1 Collection Sheet	. <u></u>					
		Page Total C/F to Bill No 7 Part 7.1 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	CLASS G: CONCRETE ANCILLARIES				
	Dimensions as per details on Drawings of specific structural elements				
	Forwork: Fair Finish				
G142	Plane vertical to External sides for base slab and strip footings; width 0.1 - 0.2m	m <sup>2</sup>	25.00		-
G113	Plane horizontal to Soffits for lintel, window and door spaces; width 0.2 - 0.4 m	m <sup>2</sup>	1.50		-
G143.2	Plane vertical to External sides for beams; width 0.2 - 0.4 m	m <sup>2</sup>	15.00		-
	Reinforcement				-
G522	Deformed high yield steel bars to BS 4449 Nominal size 8mm	t	0.10		-
G523	Deformed high yield steel bars to BS 4449 Nominal size 10mm	t	-		-
G524	Deformed high yield steel bars to BS 4449 Nominal size 12mm	t	0.20		-
G561	Steel wire fabric mesh reinforcement to BS 4483 ref. A142 inconcrete bed	m <sup>2</sup>	35.00		-
	CLASS H: PRECAST CONCRETE				-
H900	200 mm square permanent air vents as per drawings	nr	12.00		-
	CLASS U: BRICKWORK, BLOCK WORK AND MASONRY				-
	To include supplying stones and erecting masonry walls with 15mm mortar joints reinforced with 25mm wide hoop iron .Include for raking out and pointing joints on outer surfaces of external walls				-
U721	Dressed masonry vertical straight walls, thickness 200mm	m <sup>2</sup>	100.00		-
	CLASS U: MISCELLANEOUS METALWORK				-
	To include fixing to other work, supply of fixing components, and drilling or cutting to other work				-
N164	100mm circulat hollow section for truss support  CLASS V: PAINTING	m	6.00		-
V553	Apply one coat of plastic emulsion paint on plastered internal walls ( 1 u/c) and two caots of gloss paint ( 2 f/c)	m²	100.00		-
					-
					-
					-
	Dago Total C/E to Rill No 7 Dart 7.1 Collection Shoot				-
	Page Total C/F to Bill No 7 Part 7.1 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	CLASS W: WATERPROOFING				
W100	Damp Proofing				
W131	5000 Gauge diothene or other equal and approved polyethene sheeting as damp proof membrane laid on blinded hardcore with laps.	m <sup>2</sup>	30.00		-
W300	Roofing				-
W321	Prepainted Corrugated Galvanised Iron sheets gauge 28 ( rate to include for ridge cap of same gauge)	m <sup>2</sup>	60.00		-
	CLASS Z: SIMPLE WORKS INCIDENTAL TO CIVIL				-
	ENGINEERING WORKS				-
	Windows, Doors and Glazing				-
	Rate to include supply of materials/fittings, fixing and/or drilling, cutting of associated works and painting with 3 coats of paint				-
Z321.1	Window size 1200 x 1200mm with 5mm ordinary quality clear sheet glass glazing in panes	nr	3.00		-
Z321.2	High level windows size 600 x 450mm alternate with glass louvres, with 5mm ordinary quality clear sheet glass glazing as per drawings provided	nr	1.00		-
	Doors				-
	Cost to include frames, hinges, locks, handles, stoppers, fixing in accordance with specifications, and painting with1 coat red lead oxide primer and two coats gloss paint (1 u/c + 2 f/c)				-
					-
Z323.1	Steel door size 2100 x 900mm steel door	nr	3.00		-
	CLASS Z: SIMPLE BUILDING WORKS				-
	INCIDENTAL TO CIVIL ENGINEERING WORKS				-
	Capentry and Joinery				-
	Rate to include fixing, boring, cutting, joining, supply of fixing components and drilling or cutting associated work				-
Z118	Provide materials, fabricate and fix 100x50mm treated sawn timber trusses as detailed in drawing	nr	6.00		-
Z151	100x20mm Ceramic tiles skirting	m <sup>2</sup>	3.00		-
Z451	20mm thick chipboards ceiling	m <sup>2</sup>	36.00		-
		- ""	33.00		-
	Surface Finishes				-
Z411.2	Ceramic tiles finish on floors. (provisional)	m <sup>2</sup>	30.00		-
	Cabled building services				-
Z7**	Electrical installation and fittings which include 18 lighting points and switches, as per clause 4.5 of the specifications	Sum	1.00		-
					-
					_
	Page Total C/F to Bill No 7 Part 7.1 Collection Sheet				-

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	Part 7.1 Collection Sheet			(	-
					-
	DESCRIPTION (if any)				
	Part 7.1 Collection Sheet Total B/F from page 39				-
	Part 7.1 Collection Sheet Total B/F from page 40				-
	Part 7.1 Collection Sheet Total B/F from page 41				-
	, , ,				
					-
					-
					-
					-
					-
					-
					-
	<u> </u>				
	<del> </del>				
-					
		<b>†</b>			
	Part 7.1 Collection Sheet Total C/F to Bill No. 7 Summary				
	Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
	PART 7.2: EXISTING TREATMENT WORKS STATION			` ,	
	CONSTRUCTION OF SHED TO THE CHEMICAL MIXING UNIT				
	ВАУ				
	CLASS M: STRUCTURAL METALWORK				
	Fabrication work using BS 4360 grade 43 steel jointed				
	using 6mm fillet welds .Rate to include supply of material				
	and fabrication.				
14254.2	Doding shortals and a second short and a second	Less	100.00		
M351.2	Purlins straight on plan as detailed in drawing	kgs	180.00		
	Erection work				
M6251.1	Erection of trusses and purlins as detailed in drawing	t	180.00		
	Surface treatment				
	Julyuce treatment				
M870	Off-site surface treatment of metal surfaces by painting	Cum	1.00		
101070	with one coat red lead-oxide primer	Sum	1.00		
	In-situ painting of metal surfaces with epoxy paint ( 1 u/c +				
V770	1 f/c)	Sum	1.00		
	-1,0				
	CLASS U: BRICKWORK, BLOCK WORK AND MASONRY				
	To include supplying stones and erecting masonry walls				
	with 15mm mortar joints reinforced with 25mm wide				
	hoop iron .Include for raking out and pointing joints on				
	outer surfaces of external walls				
11724		2	00.00		
U721	Dressed masonry vertical straight walls, thickness 200mm	m <sup>2</sup>	90.00		
	CLASS V: PAINTING				
V553	Apply one coat of plastic emulsion paint on plastered	m <sup>2</sup>	90.00		
	internal walls (1 u/c) and two caots of gloss paint (2 f/c)				
**8V531.2	Apply three coats of plastic emulsion paint on rendered external walls	m <sup>2</sup>	90.00		
	external waiis				
	Roofing				
\A/221	IT4 Gauge 24 fixed with self tapping screws complete with	m²	20.00		
W321	rubber covers to connect to the existing pump house roof	m	30.00		
-	CLASS N: MISCELLANEOUS METALWORK				
	Rate to include the cost for fixing to other work, supply of				
	fixing components, drilling or cutting of other work				
N22	100x100 square hollow sections	m	45.00		
	Page Total C/F to Bill No 7 Part 7.2 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
TILIVI NO.	CONSTRUCTION OF THE FILTER GALLERY PROTECTION R.C	ONIT	QUANTITY	KATE (KSIIS)	AWOUNT (KSIIS
	WALLS				
	CLASS E:EARTHWORKS				
E300	Excavation for foundations				
		2			
E311	Topsoil; depth n.e. 0.25 m	m <sup>3</sup>	4.00		
E312	Topsoil; maximum depth 0.25 - 0.5m	m <sup>3</sup>	3.00		
E323	Materials other than topsoil, rock or artificial hard material maximum depth 0.5 - 1m	m <sup>3</sup>	5.00		
E530	Disposal of excavated material				
E531	Topsoil distance of haul n.e. 1.5 km	m <sup>3</sup>	15.00		
E600	Filling				
E617	Selected imported material for hardcore	m <sup>3</sup>	6.00		
	CLASS F : IN SITU CONCRETE				
	Provision of Concrete				
	Provide materials and mix concrete to the specified				
	class;cement to BS 12 or BS 146				
F133	Designed Concrete strength C15/20; 20mm aggregate	m <sup>3</sup>	1.00		
F253	Design mix; Grade C25/20	m <sup>3</sup>	15.00		
	Placing of Concrete				
	Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.				
F600	Mass Concrete				
F611	Blinding under bases, footings and ground slab; thickness n.e. 150mm	m <sup>3</sup>	1.00		
	Reinforced Concrete; Class 25/20				
F722	Bases, footings, ground slabs and plinths; thickness 150 - 300mm	m³	6.00		
F732	Suspended slab; thickness 200 mm	m <sup>3</sup>	1.50		
F742	Walls; thickness 250mm	m <sup>3</sup>	7.50		
. , , , _		111	7.30		
	Page Total C/F to Bill No 7 Part 7.2 Collection Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	CLASS G: CONCRETE ANCILLARIES	• • • • • • • • • • • • • • • • • • • •	201111111	()	The state of the s
	Dimensions as per details on Drawings of specific structural elements				
	Forwork: Fair Finish				
G142	Plane vertical to External sides for base slab and strip footings; width 0.1 - 0.2m	m <sup>2</sup>	20.00		
G145	Plane vertical to External sides for walls; width exceeding 1.22 m	m <sup>2</sup>	65.00		
G125	Plane Sloping :Stair case; width exceeding 1.22 m	m <sup>2</sup>	10.00		
	Reinforcement				
G522	Deformed high yield steel bars to BS 4449 Nominal size 8mm	t	0.50		
G523	Deformed high yield steel bars to BS 4449 Nominal size 10mm	t	0.50		
G524	Deformed high yield steel bars to BS 4449 Nominal size 12mm	t	0.50		
	Page Total C/F to Bill No 7 Part 7.2 Collection Sheet				

NWWDA

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	Part 7.2 Collection Sheet				
	DESCRIPTION (if any)				
	Part 7.2 Collection Sheet Total B/F from page 43				-
	Part 7.2 Collection Sheet Total B/F from page 44				-
	Part 7.2 Collection Sheet Total B/F from page 45				-
		1			
		-			
	Part 7.2 Collection Sheet Total C/F to Bill No. 7 Summary				
	Sheet	<u> </u>			

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
TIEWING.	Part 7.3: EXTENSION OF TREATED WATER PUMP HOUSE:SUPER STRUCTURE WORKS	01411	QOARTITI	TOTTE (RSH3)	AWICONT (KOIIS)
	CLASS F: IN SITU CONCRETE				
	Provision of Concrete				
	Provide materials and mix concrete to the specified				
	class;cement to BS 12 or BS 146				
F253	Design mix; Grade C25/20	m <sup>3</sup>	5.50		-
	Placing of Concrete				
	Place, vibrate and cure concrete in the following elements of the structure as per details on drawings.				
	Reinforced Concrete; Class 25/20				
F662	450X200 ring beam , cross sectional area 0.03 - 0.1m <sup>2</sup>	m <sup>3</sup>	3.00		-
F662	Columns, cross sectional area 0.03 - 0.1m <sup>2</sup>	m <sup>3</sup>	2.50		-
	CLASS G: CONCRETE ANCILLARIES				
	Dimensions as per details on Drawings of specific structural elements				
	Forwork: Fair Finish				
	Plane Vertical				
G281	External sides of ring beam	m <sup>2</sup>	30.00		-
G282.1	External sides of columns	m <sup>2</sup>	40.00		-
	Reinforcement				
G522	Deformed high yield steel bars to BS 4449 Nominal size 8mm	t	0.15		-
G523	Deformed high yield steel bars to BS 4449 Nominal size 16mm (Y16) for columns	t	0.50		-
	CLASS M: STRUCTURAL METALWORK Fabrication work using BS 4360 grade 43 steel jointed using 6mm fillet welds .Rate to include supply of material and fabrication.				
M351.1	Structural steel truss straight on plan as detailed in drawing	t	1.50		-
M351.2	Purlins straight on plan as detailed in drawing	t	1.00		-
	Erection work				
M6251.1	Erection of trusses and purlins as detailed in drawing	t	2.50		-
	Surface treatment				
M870	Off-site surface treatment of metal surfaces by painting with one coat red lead-oxide primer	Sum	1.00		-
V770	In-situ painting of metal surfaces with epoxy paint ( 1 u/c + 1 f/c)	Sum	1.00		-
	Part 7.3 Collection Sheet Total C/F to Bill No. 7.3 Summary Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
	CLASS U: BRICKWORK, BLOCK WORK AND MASONRY				
	To include supplying stones and erecting masonry walls with 15mm mortar joints reinforced with 25mm wide hoop iron .Include for raking out and pointing joints on outer surfaces of external walls				
U721	Dressed masonry vertical straight walls, thickness 200mm	m <sup>2</sup>	85.00		-
	CLASS V: PAINTING				
V553	Apply one coat of plastic emulsion paint on plastered internal walls (1 u/c) and two coats of gloss paint (2 f/c)	m²	85.00		-
**8V531.2	Apply three coats of plastic emulsion paint on rendered external walls	m <sup>2</sup>	85.00		-
	Roofing				
W321	IT4 Gauge 24 fixed with self tapping screws complete with ruber covers to connect to the existing pump house roof	m <sup>2</sup>	81.00		-
W321	IT4 Gauge 24 fixed with self tapping screws complete with ruber covers to connect to the existing pump house roof	m <sup>2</sup>	30.00		-
W321	Box gutter to connect to the existing pump house	m	20.00		-
	CLASS Z: SIMPLE WORKS INCIDENTAL TO CIVIL				
	ENGINEERING WORKS				
	Windows, Doors and Glazing				
	Rate to include supply of materials/fittings, fixing and/or drilling, cutting of associated works and painting with 3 coats of paint				
	Doors				
	Cost to include frames, hinges, locks, handles, stoppers, fixing in accordance with specifications, and painting with1 coat red lead oxide primer and two coats gloss paint (1 u/c + 2 f/c)				
Z323.1	Steel door size 2836x3150mm faced both sides with plane sheet as in clause 2.62 of the specifications.	nr	1.00		-
Z323.2	Single door 900x3150mm faced both sides with plane sheet as in clause 2.62 of the specifications.	nr	1.00		-
	Miscellaneous metal works				
N14	Handrails	m	22.00		_
N13	Ladder as specified	m	12.00		-
	Surface finish				
	CLASS Z: SIMPLE BUILDING WORKS				
	INCIDENTAL TO CIVIL ENGINEERING WORKS				
	Surface Finishes				
Z411.2	Cement/sand 20mm screed finish on floors. (provisional)	m <sup>2</sup>	20.00		-
	Part 7.3 Collection Sheet Total C/F to Bill No. 7.3 Summary Sheet				-

BoQ

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
Z413	Cement/sand 25mm plaster on internal walls	m <sup>2</sup>	85.00		-
** Z413.1	Cement sand mortar screed rendering on Externall walls	m <sup>2</sup>	85.00		-
	Cabled building services				
					1
Z7**	Electrical installation and fittings which include 12 lighting points and switches, according to clause 4.5 of the specifications	Sum	1.00		
	CLASS N: MISCELLANEOUS METALWORK				
	Wire mesh panel				
	Rate to include the cost for fixing to other work, supply of fixing components,drilling or cutting of other work				
		2			
N22	Welded wire mesh panelling	m <sup>2</sup>	20.00		
					1
					1
	Part 7.3 Collection Sheet Total C/F to Bill No. 7.3 Summary Sheet				

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs
-	Part 7.3 Collection Sheet				, ,,,,,
	DESCRIPTION (if any)				
	Part 7.3 Collection Sheet Total B/F from page 47				-
	Ture 7.5 concector street rotal by From page 47				
	Part 7.3 Collection Sheet Total B/F from page 48				_
	Tark the defication sheet retail 2,1 mem page 10				
	Part 7.3 Collection Sheet Total B/F from page 49				_
	, , , ,				
	Part 7.3 Collection Sheet Total C/F to Bill No. 7 Summary				
	Sheet	<u> </u>			

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KSh
	BILL No 7: SUMMARY SHEET				
	DESCRIPTION (if any)				
	Part 7.1 Collection Sheet Total B/F from page 42				-
	Part 7.2 Collection Sheet Total B/F from page 46				-
	Part 7.3 Collection Sheet Total B/F from page 50				

BoQ

ITEM No.	ITEM DESCRIPTION	UNIT	QUANTITY	RATE (KShs)	AMOUNT (KShs)
BILL No	BILLS SUMMARY SHEET				· · · · ·
1	PRELIMINARY AND GENERAL ITEMS				-
2	CONSTRUCTION OF GABABA-MASALANI PIPELINE AND				
	ASSOCIATED WORKS				<del>-</del>
	CONSTRUCTION OF 1NO 150m <sup>3</sup> SECTIONAL STEEL				
	ELEVATED WATER TANK- IJARA VOCATIONAL AND				
3	TECHNICAL TRAINING CENTRE				-
	REHABILITATION OF EXISTING 25m³/HR COMPOSITE				
4	FILTRATION UNIT				_
	T ETO TO STORY				
	INSTITUTIONAL CAPACITY BUILDING :-RATIONALIZATION				
_	AND INSTALLATION OF CONSUMER CONNECTIONS				-
5					
	REHABILITATION OF 3No 150m <sup>3</sup> AND 1No. 100m <sup>3</sup> EXISTING				
6	ELEVATED STEEL WATER TANKS	<u> </u>			<u> </u>
7	IMPROVEMENT OF MASALANI WATER SUPPLY EXISTING				-
	FACILITIES				
	SUB-TOTAL			ļ <b>ļ</b>	-
	ADD 5% GENERAL CONTIGENCY ALLOWANCE			$\Box$	
	SUB TOTAL			<u> </u>	_
	30B TOTAL				-
	ADD 16% VAT				
				$\Box$	
	BILLS GRAND TOTAL C/F TO FORM OF TENDER				
	<u>.</u>	İ	I .	<u> </u>	